

C-2220


High-Low Pressure Selector

The master modules provide the restricted air supply for the high and low output signals. One master and as many subordinates as required makeup a selector arrangement for a typical multizone unit.

All restrictors in the masters and subordinates modules are of the .005 in. 20 scim output type.


Various combinations of masters and subordinates which can be used are as follows:

1. Master for non-relay (T-4100 or T-4600) controller with subordinate for non-relay (T-4100 or T-4600) controller.
2. Master for relay (T-4002) controller with subordinate for relay (T-4002) controller.
3. Master for non-relay (T-4100 or T-4600) controller with subordinate for relay (T-4002) controller.
4. Master for relay (T-4002) controller with subordinate for non-relay (T-4100 or T-4600) controller.

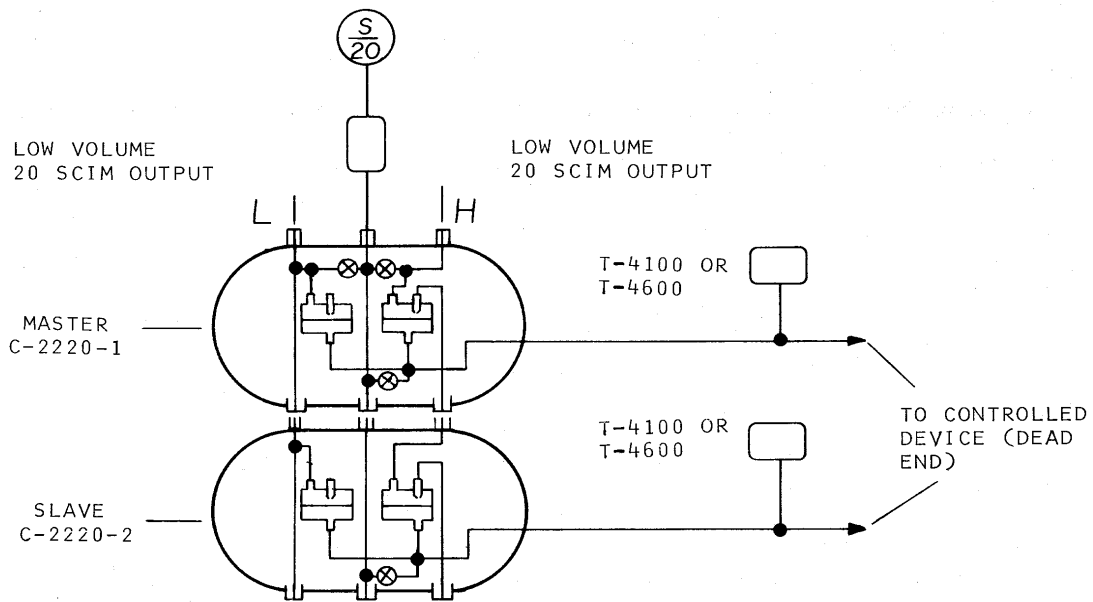

MASTER AND SLAVE USED WITH NON-RELAY (LOW VOLUME) CONTROLLERS.

FIG. 1

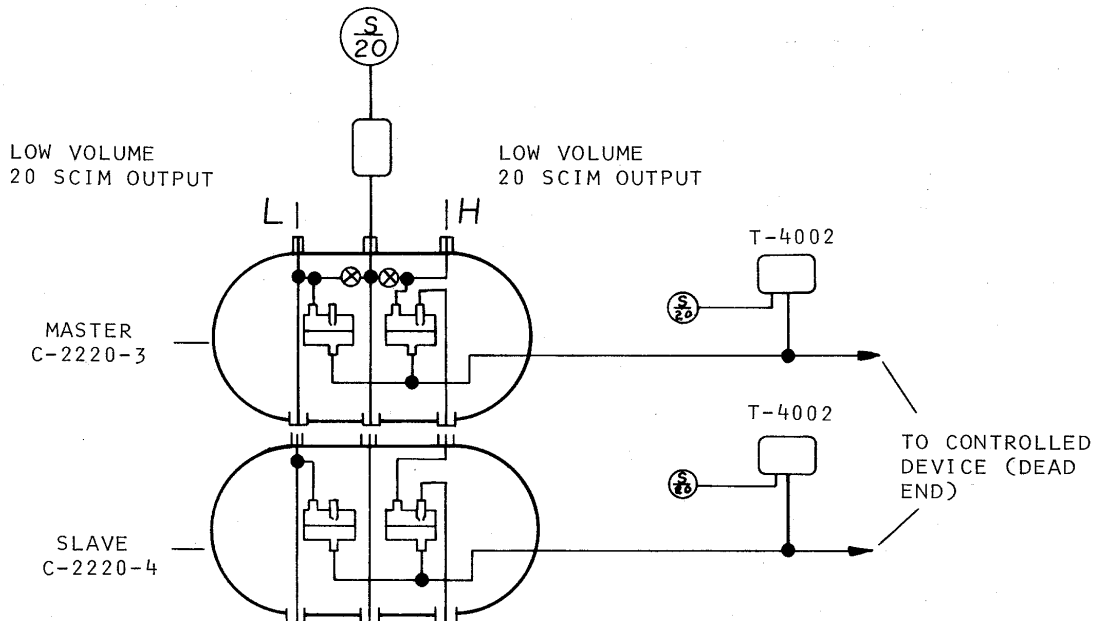

MASTER AND SLAVE USED WITH RELAY (HIGH VOLUME) CONTROLLERS

FIG. 2

**JOHNSON
CONTROLS**

Controls Group
507 E. Michigan Street
P.O. Box 423
Milwaukee, WI 53202

Printed in U.S.A.