

SIEMENS

SIPROTEC 5

Operation

V8.30 and higher

Manual

Preface

Open Source Software

Table of Contents

First Steps 1

Expanding Devices 2

Fitting the Devices 3

Handling of Plug-In Modules 4

Using On-Site Operation Panel 5

Using DIGSI 5 6

Operation Using a Browser-Based User Interface 7

Operation in the Operating State 8

Commissioning 9

Maintenance, On-the-Spot Assistance and Test 10

Security Settings in the Device 11

Literature

Glossary

Index

C53000-G5040-C003-C

**NOTE**

For your own safety, observe the warnings and safety instructions contained in this document, if available.

Disclaimer of Liability

Subject to changes and errors. The information given in this document only contains general descriptions and/or performance features which may not always specifically reflect those described, or which may undergo modification in the course of further development of the products. The requested performance features are binding only when they are expressly agreed upon in the concluded contract.

Document version: C53000-G5040-C003-C.01

Edition: 08.2020

Version of the product described: V8.30 and higher

Copyright

Copyright © Siemens 2020. All rights reserved.

The disclosure, duplication, distribution and editing of this document, or utilization and communication of the content are not permitted, unless authorized in writing. All rights, including rights created by patent grant or registration of a utility model or a design, are reserved.

Trademarks

SIPROTEC, DIGSI, SIGRA, SIGUARD, SIMEAS SAFIR, SICAM, and MindSphere are trademarks of Siemens. Any unauthorized use is prohibited.

Preface

Purpose of the Manual

This manual describes the operation of the device and gives information about safety, commissioning and operation as well as checks and tests.


Target Audience

Protection system engineers, commissioning engineers, persons entrusted with the setting, testing and maintenance of automation, selective protection and control equipment, and operational crew in electrical installations and power plants.

Scope

This manual applies to the SIPROTEC 5 device family.

Further Documentation

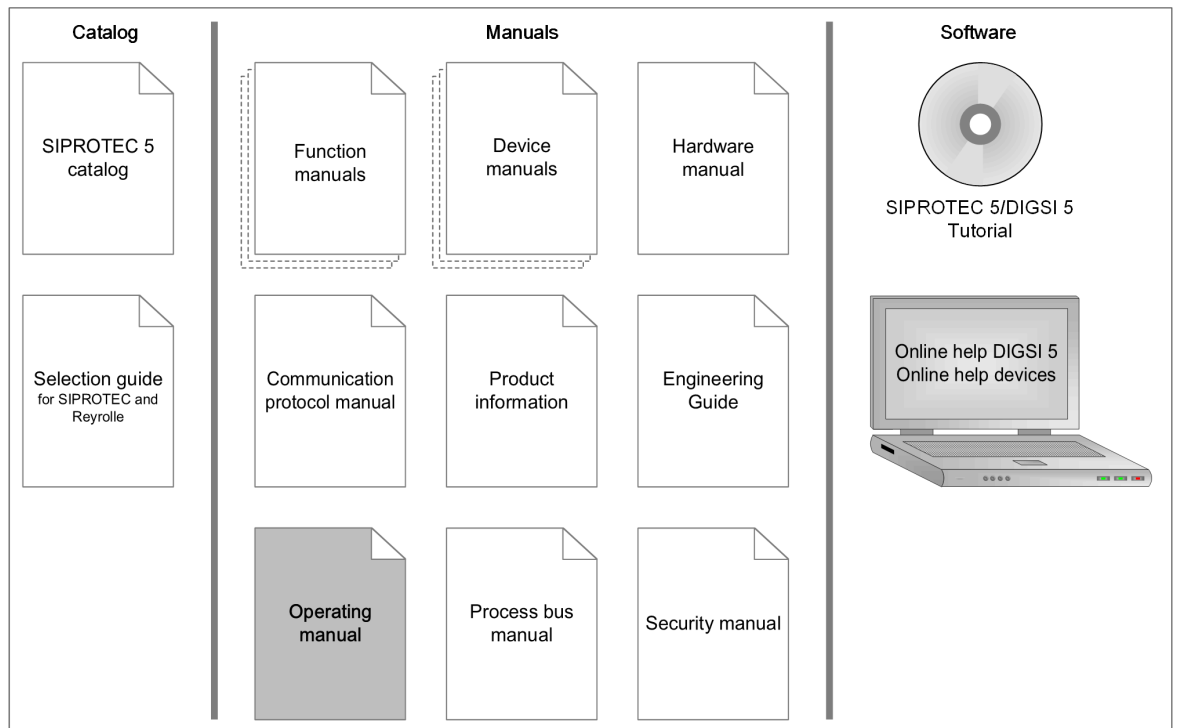

[dw_Product-overview_SIP5_Operating-manual, 4, en_US]

- **Device manuals**
Each Device manual describes the functions and applications of a specific SIPROTEC 5 device. The printed manual and the online help for the device have the same informational structure.

- **Hardware manual**
The Hardware manual describes the hardware building blocks and device combinations of the SIPROTEC 5 device family.
- **Operating manual**
The Operating manual describes the basic principles and procedures for operating and assembling the devices of the SIPROTEC 5 range.
- **Communication protocol manual**
The Communication protocol manual contains a description of the protocols for communication within the SIPROTEC 5 device family and to higher-level network control centers.
- **Security manual**
The Security manual describes the security features of the SIPROTEC 5 devices and DIGSI 5.
- **Process bus manual**
The process bus manual describes the functions and applications specific for process bus in SIPROTEC 5.
- **Product information**
The Product information includes general information about device installation, technical data, limiting values for input and output modules, and conditions when preparing for operation. This document is provided with each SIPROTEC 5 device.
- **Engineering Guide**
The Engineering Guide describes the essential steps when engineering with DIGSI 5. In addition, the Engineering Guide shows you how to load a planned configuration to a SIPROTEC 5 device and update the functionality of the SIPROTEC 5 device.
- **DIGSI 5 online help**
The DIGSI 5 online help contains a help package for DIGSI 5 and CFC.
The help package for DIGSI 5 includes a description of the basic operation of software, the DIGSI principles and editors. The help package for CFC includes an introduction to CFC programming, basic examples of working with CFC, and a reference chapter with all the CFC blocks available for the SIPROTEC 5 range.
- **SIPROTEC 5/DIGSI 5 Tutorial**
The tutorial on the DVD contains brief information about important product features, more detailed information about the individual technical areas, as well as operating sequences with tasks based on practical operation and a brief explanation.
- **SIPROTEC 5 catalog**
The SIPROTEC 5 catalog describes the system features and the devices of SIPROTEC 5.
- **Selection guide for SIPROTEC and Reyrolle**
The selection guide offers an overview of the device series of the Siemens protection devices, and a device selection table.

Indication of Conformity



This product complies with the directive of the Council of the European Communities on harmonization of the laws of the Member States concerning electromagnetic compatibility (EMC Directive 2014/30/EU), restriction on usage of hazardous substances in electrical and electronic equipment (RoHS Directive 2011/65/EU), and electrical equipment for use within specified voltage limits (Low Voltage Directive 2014/35/EU).

This conformity has been proved by tests performed according to the Council Directive in accordance with the product standard EN 60255-26 (for EMC directive), the standard EN 50581 (for RoHS directive), and with the product standard EN 60255-27 (for Low Voltage Directive) by Siemens.

The device is designed and manufactured for application in an industrial environment. The product conforms with the international standards of IEC 60255 and the German standard VDE 0435.

Standards

IEEE Std C 37.90

The technical data of the product is approved in accordance with UL.

For more information about the UL database, see ul.com

You can find the product with the **UL File Number E194016**.



IND. CONT. EQ.
69CA

Additional Support

For questions about the system, contact your Siemens sales partner.

Customer Support Center

Our Customer Support Center provides a 24-hour service.

Siemens AG

Customer Support Center

Humboldtstrasse 59

90459 Nuremberg

Germany

E-mail: support.energy@siemens.com

Training Courses

Inquiries regarding individual training courses should be addressed to our Training Center:

Siemens AG

Siemens Power Academy TD

Humboldtstrasse 59

90459 Nuremberg

Germany

Phone: +49 (911) 433-7415

Fax: +49 (911) 433-7929

E-mail: poweracademy@siemens.com

Internet: www.siemens.com/poweracademy

Notes on Safety

This document is not a complete index of all safety measures required for operation of the equipment (module or device). However, it comprises important information that must be followed for personal safety, as well as to avoid material damage. Information is highlighted and illustrated as follows according to the degree of danger:



DANGER

DANGER means that death or severe injury **will** result if the measures specified are not taken.

- ✧ Comply with all instructions, in order to avoid death or severe injuries.



WARNING

WARNING means that death or severe injury **may** result if the measures specified are not taken.

- ✧ Comply with all instructions, in order to avoid death or severe injuries.



CAUTION

CAUTION means that medium-severe or slight injuries **can** occur if the specified measures are not taken.

- ✧ Comply with all instructions, in order to avoid moderate or minor injuries.

NOTICE

NOTICE means that property damage **can** result if the measures specified are not taken.

- ✧ Comply with all instructions, in order to avoid property damage.



NOTE

Important information about the product, product handling or a certain section of the documentation which must be given attention.

Qualified Electrical Engineering Personnel

Only qualified electrical engineering personnel may commission and operate the equipment (module, device) described in this document. Qualified electrical engineering personnel in the sense of this document are people who can demonstrate technical qualifications as electrical technicians. These persons may commission, isolate, ground and label devices, systems and circuits according to the standards of safety engineering.

Proper Use

The equipment (device, module) may be used only for such applications as set out in the catalogs and the technical description, and only in combination with third-party equipment recommended and approved by Siemens.

Problem-free and safe operation of the product depends on the following:

- Proper transport
- Proper storage, setup and installation
- Proper operation and maintenance

When electrical equipment is operated, hazardous voltages are inevitably present in certain parts. If proper action is not taken, death, severe injury or property damage can result:

- The equipment must be grounded at the grounding terminal before any connections are made.
- All circuit components connected to the power supply may be subject to dangerous voltage.
- Hazardous voltages may be present in equipment even after the supply voltage has been disconnected (capacitors can still be charged).
- Operation of equipment with exposed current-transformer circuits is prohibited. Before disconnecting the equipment, ensure that the current-transformer circuits are short-circuited.
- The limiting values stated in the document must not be exceeded. This must also be considered during testing and commissioning.

Selection of Used Symbols on the Device

Nr.	Symbol	Description
1	---	Direct current, IEC 60417, 5031
2	~	Alternating current, IEC 60417, 5032

Nr.	Symbol	Description
3		Direct and alternating current, IEC 60417, 5033
4		Earth (ground) terminal, IEC 60417, 5017
5		Protective conductor terminal, IEC 60417, 5019
6		Caution, risk of electric shock
7		Caution, risk of danger, ISO 7000, 0434
8		Protective Insulation, IEC 60417, 5172, Safety Class II devices
9		Guideline 2002/96/EC for electrical and electronic devices
10		Guideline for the Eurasian Market

Open Source Software

The product contains, among other things, Open Source Software developed by third parties. The Open Source Software used in the product and the license agreements concerning this software can be found in the Readme_OSS. These Open Source Software files are protected by copyright. Your compliance with those license conditions will entitle you to use the Open Source Software as foreseen in the relevant license. In the event of conflicts between Siemens license conditions and the Open Source Software license conditions, the Open Source Software conditions shall prevail with respect to the Open Source Software portions of the software. The Open Source Software is licensed royalty-free. Insofar as the applicable Open Source Software License Conditions provide for it you can order the source code of the Open Source Software from your Siemens sales contact – against payment of the shipping and handling charges – for a period of at least 3 years after purchase of the product. We are liable for the product including the Open Source Software contained in it pursuant to the license conditions applicable to the product. Any liability for the Open Source Software beyond the program flow intended for the product is explicitly excluded. Furthermore any liability for defects resulting from modifications to the Open Source Software by you or third parties is excluded. We do not provide any technical support for the product if it has been modified.

When using DIGSI 5 in online mode, you are provided with the option to go to the main menu **Show open source software information** and read and display the Readme_OSS file containing the original license text and copyright information.

To do this, the following steps are necessary:

- Switch to online mode.
- Select the device.
- Select **Online** in the menu bar.
- Click **Show open source software information**.



NOTE

To read the Readme_OSS file, a PDF viewer must be installed on the computer.
In order to operate SIPROTEC 5 devices, a valid DIGSI 5 license is required.

Table of Contents

	Preface.....	3
	Open Source Software.....	9
1	First Steps.....	17
1.1	Unpacking, Repacking, Returning, and Storing.....	18
1.2	Environmental Protection Hints.....	20
1.3	Incoming Inspection	21
1.4	Electrical Inspection.....	22
2	Expanding Devices.....	25
2.1	Flush-Mounting Devices.....	26
2.1.1	Basic Rules for Expansion.....	26
2.1.2	Expanding 1st Device Row.....	27
2.2	Surface-Mounted Devices with Integrated On-Site Operation Panel.....	29
2.2.1	Basic Rules for Expansion.....	29
2.2.2	Expanding 1st Device Row.....	30
2.3	Surface-Mounted Devices with Detached On-Site Operation Panel.....	33
2.3.1	Basic Rules for Expansion.....	33
2.3.2	Expanding 1st Device Row.....	34
3	Fitting the Devices.....	37
3.1	Flush-Mounting Devices.....	38
3.1.1	Fitting the Devices.....	46
3.1.2	Activating the Battery	47
3.1.3	Grounding and Connecting Devices.....	48
3.1.4	Tightening Torques of Fastening Screws.....	48
3.2	Surface-Mounted Devices with Integrated On-Site Operation Panel.....	50
3.2.1	Fitting Devices.....	58
3.2.2	Activating the Battery	59
3.2.3	Grounding and Connecting Devices	59
3.2.4	Tightening Torques of Fastening Screws.....	60
3.3	Surface-Mounted Devices with Detached On-Site Operation Panel.....	61
3.3.1	Fitting the Devices.....	64
3.3.2	Activating the Battery	65
3.3.3	Grounding and Connecting Devices.....	66
3.3.4	Tightening Torques of Fastening Screws.....	66
4	Handling of Plug-In Modules.....	67
4.1	Installation, Removal, Replacement.....	68
4.1.1	Fasteners.....	68

4.1.2	Installation.....	68
4.1.3	Removing	69
4.1.4	Replacement.....	71
5	Using On-Site Operation Panel.....	73
5.1	General.....	74
5.2	Overview of Operator Elements and Display Elements.....	75
5.3	Displays for Indication and Control.....	83
5.4	Structure of the Menu.....	85
5.5	Menu Tree	86
5.6	Notification Windows and Dialogs.....	88
5.7	Displaying Device Mode.....	90
5.8	Display of Routings and Status.....	92
6	Using DIGSI 5.....	97
6.1	General	98
6.2	Operator Actions in the Offline and Online Area	100
6.3	Initializing a Device.....	102
6.4	Transferring Device Data from the PC to the Device.....	103
6.5	Changing Data on the Online Device	105
6.6	Retrieving Fault Records and Log Contents.....	106
7	Operation Using a Browser-Based User Interface.....	107
7.1	General.....	108
7.2	Operation.....	109
7.3	Buttons.....	115
7.3.1	General.....	115
7.3.2	Device.....	115
7.3.3	Engineering.....	115
7.3.4	Monitoring.....	117
7.3.5	Measured Values.....	120
7.3.6	Terminal Assignment.....	123
7.3.7	Recording.....	125
7.3.8	Diagnosis.....	126
7.3.9	Administration.....	128
7.3.10	Service.....	130
7.4	Examples.....	132
7.4.1	General.....	132
7.4.2	Example 1: Reading out Operational Indications.....	132
7.4.3	Example 2: Changing Settings.....	134
8	Operation in the Operating State.....	137
8.1	Overview.....	138
8.2	Safety Notes and Access Rights.....	139
8.2.1	Safety Notes.....	139
8.3	Operation Options.....	140
8.3.1	General.....	140
8.3.2	Online Operation Using DIGSI 5.....	140

8.3.3	Offline Operation Using DIGSI 5.....	143
8.3.4	Using the On-Site Operation Panel.....	145
8.4	Indications.....	146
8.4.1	General.....	146
8.4.2	Reading Indications on the On-Site Operation Panel.....	146
8.4.3	Reading Indications from the PC with DIGSI 5.....	148
8.4.4	Displaying Indications.....	149
8.4.5	Spontaneous Indication Display in DIGSI 5.....	152
8.4.6	Spontaneous Fault Display on the On-Site Operation Panel.....	152
8.4.7	Stored Indications in the SIPROTEC 5 Device.....	154
8.4.8	Acknowledgment of Stored Indications	155
8.4.9	Test Mode and Influence of Indications on Substation Automation Technology	157
8.5	Logs.....	158
8.5.1	General.....	158
8.5.2	Operational Log.....	159
8.5.3	Fault Log.....	161
8.5.4	Ground-Fault Log.....	162
8.5.5	Setting-History Log.....	164
8.5.6	User Log.....	166
8.5.7	Security Log.....	167
8.5.8	Device-Diagnosis Log.....	168
8.5.9	Communication Log.....	170
8.5.10	Communication-Supervision Log.....	171
8.5.11	Motor-Starting Log.....	172
8.5.12	Saving and Deleting the Logs.....	174
8.6	Edit Measured and Metered Values.....	176
8.6.1	Overview of Measured and Metered Values.....	176
8.6.2	Reading Measured Values and Metered Values.....	177
8.6.3	Setting and Resetting Energy Values.....	179
8.6.4	Setting and Resetting User-Defined Metered Values.....	180
8.6.5	Resetting Min./Max./Average Values.....	181
8.6.6	Setting and Resetting Statistical Values.....	181
8.7	Fault Recording.....	183
8.7.1	General.....	183
8.7.2	Reading Fault Records.....	183
8.7.3	Displaying Fault Records.....	184
8.7.4	Saving and Exporting Fault Records.....	185
8.7.5	Deleting Fault Records.....	186
8.7.6	Recording a Test Fault Record.....	186
8.7.7	Configuration of Fault-Record Channels.....	186
8.7.8	Configuration of the Start Criterion.....	187
8.8	Change Device Settings.....	189
8.8.1	Date and Time Synchronization.....	189
8.8.2	Setting Time and Date	189
8.8.3	Setting Time Keeping Parameters.....	190
8.8.4	Status and Monitoring of Time Keeping.....	192

8.8.5	Setting the Contrast of the Device Display.....	193
8.8.6	Changing the Language on the Device.....	193
8.8.7	Changing Confirmation IDs.....	195
8.8.8	Setting Function Settings.....	196
8.8.9	Settings Group Switching.....	199
8.9	Control System on Site.....	202
8.9.1	General.....	202
8.9.2	Menu Structure.....	202
8.9.3	Switching Authority	203
8.9.4	Switching Mode	203
8.9.5	Control with Graphic Display.....	204
8.9.6	Control with Small Display.....	205
8.9.7	Acquisition Blocking and Manual Updating.....	206
8.9.8	Status Display	208
8.9.9	Setting a Marker.....	209
8.9.10	Assignment of Authorizations with Confirmation ID.....	209
8.9.11	Control with Function Keys.....	210
9	Commissioning.....	211
9.1	Overview.....	212
9.2	Test Suite Integrated in the Device.....	213
9.2.1	Test Functions.....	213
9.2.2	Testing Current and Voltage Inputs.....	214
9.2.3	Testing Protection Functions.....	215
9.2.4	Creating Signals for Communication Interfaces.....	217
9.2.5	Testing Switching Devices.....	217
9.2.6	Circuit-Breaker Test.....	219
9.2.7	Device Information and Diagnosis.....	219
9.3	Initial Startup.....	222
9.3.1	Establishing Readiness for Operation State.....	222
9.3.2	Using a Project with DIGSI 5.....	222
9.3.3	Initializing Device and Verifying Basic Status.....	223
9.3.4	Testing Readiness for Operation.....	224
9.4	Secondary Tests.....	225
9.4.1	Scope of Inspection and Methodology.....	225
9.4.2	Recommendation for Testing of Functions	225
9.4.3	Testing Interfaces in the Compound System.....	227
9.5	Primary Tests.....	228
9.5.1	Testing System Integration.....	228
9.5.2	Methodical Procedure for Primary Tests of Functions.....	230
9.5.3	Testing Measured Values During Operation.....	231
10	Maintenance, On-the-Spot Assistance and Test.....	233
10.1	Execute Checks.....	234
10.1.1	General Information.....	234
10.1.2	Protection-Function Test.....	234

10.2	Error Search and Correction.....	236
10.2.1	Troubleshooting.....	236
10.2.2	Measures for Error Correction.....	237
10.2.3	Fallback Mode.....	237
10.2.4	Error Indications.....	241
10.3	Replace and Return Defective Device.....	246
10.3.1	Backup Module.....	246
10.3.2	Replacing a Device.....	246
10.3.3	Returning a Device.....	246
10.4	Update Firmware and Configuration.....	247
10.4.1	General.....	247
10.4.2	Importing and Managing Device Drivers.....	247
10.4.3	Special Features when Handling Protocols.....	252
10.4.4	Upgrading Project Devices.....	252
10.5	Test and Diagnostics.....	256
10.5.1	Establishing Test Mode.....	256
10.5.2	Switching the Simulation Mode On and Off.....	257
10.5.3	Switching Block Monitoring Direction On and Off.....	257
11	Security Settings in the Device.....	259
11.1	Security Design.....	260
11.2	Multi-Level Security Concept.....	261
	Literature.....	263
	Glossary.....	265
	Index.....	269

1 First Steps

1.1	Unpacking, Repacking, Returning, and Storing	18
1.2	Environmental Protection Hints	20
1.3	Incoming Inspection	21
1.4	Electrical Inspection	22

1.1 Unpacking, Repacking, Returning, and Storing

Unpacking a Device

**NOTE**

Devices are tested prior to delivery. The test certificate is a component of the devices and can be called up with DIGSI.

Devices are packed on site in a way that meets the requirements of standard ISO 2248.

- ✧ Check the packaging for external transport damage. Damaged packaging may indicate that the devices inside have also sustained damage.
- ✧ Unpack devices carefully; do not use force.
- ✧ Check the devices via a reception control to ensure they are in perfect mechanical condition.
- ✧ Check the enclosed accessories against the delivery note to make sure everything is complete.
- ✧ Keep the packaging in case the devices must be stored or transported elsewhere.
- ✧ Return damaged devices to the manufacturer, stating the defect. Use the original packaging or transport packaging that meets the requirements of standard ISO 2248.

Repacking a Device

- ✧ If you store devices after reception control, they must be packed in appropriate storage packaging.
- ✧ If the device is to be transported, pack it in transport packaging.
- ✧ Enclose the accessories supplied and the test certificate in the package with the device.

Returning a Device

- ✧ Return devices to the manufacturer, stating the defect.
 - ✧ Use the original packaging or transport packaging that meets the requirements of standard ISO 2248.
 - ✧ Send damaged devices to the following address:
Siemens AG
EM DG PRO MF Rückwaren
Rohrdamm 7
13629 Berlin
Germany
 - ✧ Ensure that the devices are either shipped with the original current and voltage terminals or, alternatively - if the wired terminals are to remain in the system - with the designated transport safety devices.
-

**NOTE**

If there are green single-row voltage terminals, it is irrelevant in terms of transport whether or not they are plugged in. They do not require any alternative transport safety device.

- ✧ Protect the optical interfaces on the communication or arc protection modules against the ingress of dust.
- ✧ Use, for example, the protective covers provided in the delivery condition.

Storing a Device

- ✧ Only store devices on which you have carried out an incoming inspection. This action ensures that the warranty remains valid. The incoming inspection is described in the Operating manual.

**NOTE**

SIPROTEC devices must be stored in rooms that are clean and dry. Devices or associated replacement modules must be stored at a temperature of -25 °C to +55 °C.

The relative humidity must be at a level where condensed water and ice are prevented from forming.

Siemens recommends observing a restricted storage temperature range of +10 °C to +35 °C in order to prevent the electrolytic capacitors used in the power supply from aging prematurely.

If the device has been in storage for more than 2 years, connect it to an auxiliary voltage for 1 to 2 days. This action will cause the electrolytic capacitors to form on the printed circuit board assemblies again.

If devices are to be shipped elsewhere, you can reuse the transport packaging. When using different packaging, you must ensure that the transport requirements according to ISO 2248 are met. Storage packing of the individual devices is not adequate for transport purposes.

The lithium batteries contained in SIPROTEC devices meet all international requirements of the hazardous goods specifications for the various carriers (Special Provision 188 of the UN Recommendations on the Transport of Dangerous Goods, Special Provision A45 of the IATA Dangerous Goods Regulations, and the ICAO Technical Instructions). This action only applies to the original battery or genuine replacement batteries.

Battery Disposal**NOTICE**

Exercise caution when replacing the battery

Noncompliance with the specified measures means that material damage can occur.

- ✧ Batteries can only be replaced by ones of the same type or by batteries of another type recommended by the manufacturer. Replacing with the wrong type can cause an explosion hazard. Comply with the relevant national/international regulations when disposing of batteries.
- ✧ Only have the lithium battery in the device replaced by skilled personnel.
- ✧ Only replace the battery with VARTA or Panasonic CR 2032 or BR 2032 batteries. If you use a different type of battery, this can cause a fire or explosion hazard. Observe the safety notes in the manual.

**CAUTION**

Caution against chemical reaction

Noncompliance with the safety notes can result in minor to medium injuries.

- ✧ The battery used in the device can cause fire or chemical burns if handled improperly. Do not recharge it, take it apart, or subject it to a temperature in excess of 100 °C.
- ✧ Replace dead batteries immediately and keep them out of reach of children.

1.2 Environmental Protection Hints

Disposal of Old Equipment and Batteries (Applicable only for European Union and Countries with a Recycling System)

The disposal of our products and possible recycling of their components after decommissioning has to be carried out by an accredited recycling company, or the products/components must be taken to applicable collection points. Such disposal activities must comply with all local laws, guidelines and environmental specifications of the country in which the disposal is done. For the European Union the sustainable disposal of electronic scrap is defined in the respective regulation for "waste electrical and electronic equipment" (WEEE).



The crossed-out wheeled bin on the products, packaging and/or accompanying documents means that used electrical and electronic products and batteries must not be mixed with normal household waste.



According to national legislation, penalties may be charged for incorrect disposal of such waste.

By disposing of these products correctly you will help to save valuable resources and prevent any potential negative effects on human health and the environment.



NOTE

Our products and batteries must not be disposed of as household waste. For disposing batteries it is necessary to observe the local national/international directives.

Disposal of Mobile Storage Devices (e.g. USB Sticks and Memory Cards)

When disposing of/transferring mobile storage devices, using the **format** or **delete** functions only changes the file management information and does not completely delete the data from your mobile storage device. When disposing of or transferring a mobile storage device, Siemens strongly recommends physically destroying it or completely deleting data from the mobile storage device by using a commercially available computer data erasing software.

REACH/RoHS Declaration

You can find our current **REACH/RoHS** declarations at:

<https://www.siemens.com/global/en/home/products/energy/ecotransparency/ecotransparency-downloads.html>



NOTE

You can find more information about activities and programs to protect the climate at the EcoTransparency website:

<https://www.siemens.com/global/en/home/products/energy/ecotransparency.html>

1.3 Incoming Inspection

Siemens recommends that you check devices which are not assembled.

Safety Notes



DANGER

Danger during incoming inspection

Noncompliance with the safety notes, can result in death, severe injury or considerable material damage.

- ✧ Comply with all given safety notes when carrying out the incoming inspection.
 - ✧ Please note that hazardous voltages are present when you perform the incoming inspection.
-
- ✧ If you identify a defect during the incoming inspection, do not rectify it yourself. Repack the device and return it to the manufacturer, stating the defect. Use the original packaging or transport packaging that meets the requirements of standard ISO 2248.

Performing a Follow-Up Inspection on a Device

- ✧ Visually check for external damage as soon as you have unpacked the devices; they must not show any signs of dents or cracks.

Checking the Rated Data and Functions

- ✧ Check the rated data and functions using the complete order designation/the product code. The device manual contains all technical data and a description of the functions.
- ✧ Check the information provided on the rating plate too. The device features a product label sticker, which contains the Technical data.
- ✧ Make sure that the rated data of the device properly matches the power-system data. You can find the necessary information in the device manual.

1.4 Electrical Inspection

Device Protection



DANGER

Danger when connecting the SIPROTEC 5 device

Noncompliance with the safety notes will result in death, severe injury or considerable material damage.

- ✧ The device must be situated in the operating area for at least 2 hours before you connect it to the power supply for the first time. This prevents condensed water from forming in the device.
- ✧ If the device has been in storage for more than 2 years, connect it to an auxiliary voltage for 1 to 2 days. This will cause the electrolytic capacitors to form on the printed circuit board assemblies again.

-
- ✧ Perform the electrical inspection.

Activating the Battery



NOTE

The battery is covered by a protective film, which also prevents premature discharge.

The battery compartment is located on the rear of the base module. You do not have to take the battery out of the battery compartment in order to remove the protective film.

-
- ✧ Pull out the battery compartment including the battery.
 - ✧ Remove the protective film from the battery by simply pulling on the film tab.
 - ✧ Push the battery compartment including the battery back in again.

Grounding a Device

The SIPROTEC 5 devices are protection class I equipment must be connected with the system ground prior to commissioning.

- ✧ Ground each module with solid low-impedance system grounding (cross-section $\geq 4.0 \text{ mm}^2$ ($\geq 0.0062 \text{ in}^2$), grounding area $\geq \text{M4}$, torque: at least 1.2 Nm).
- ✧ In order to ensure the electromagnetic compatibility (EMC) of the device, connect the protective grounding terminals of the modules to each other in series connection. Use the double protective grounding terminals of the individual modules for this purpose.
- ✧ Connect the protective conductor of the protection device (connected modules) to the protective grounding terminal of the installation (for example control cabinet) with a single connection to the base module of the protection device.

Connecting a Device

- ✧ Connect all cables and lines. Use the connection diagrams in the Hardware Manual and Device Manual.
- ✧ Tighten the terminal screws to the prescribed torques .

Grounding an On-Site Operation Panel

- ✧ Join several on-site operation panels to one another with firm contact.
Siemens recommends the use of contact washers on painted metal mounting walls. If the mounting wall is not metallic, place a metal layer, for example a metal sheet, between the mounting wall and the on-site operation panels. Then connect this sheet to the system grounding.

Safety Notes



DANGER

Danger during electrical inspection

Noncompliance with the safety notes will result in death, severe injury or considerable material damage.

- ✧ Comply with all given safety notes when carrying out the electrical inspection.
- ✧ Please note that hazardous voltages are present when you perform the electrical inspection.

-
- ✧ During the electrical inspection, check that the device becomes ready for operation once it has been connected to the power supply.

Performing the Electrical Inspection

- ✧ Connect the power supply.
- ✧ Activate the power supply.
After (initial) activation, there is no Device Configuration File (DCF) in the device and the device is in fallback mode. The green and red LEDs light in fallback mode.
- ✧ Once you have loaded the DCF file into the SIPROTEC 5 device, the green **RUN** LED lights continuously and the device is ready for operation.
- ✧ If the device does not assume the normal operating state (process mode), switch off the power supply. Disconnect the wiring and the grounding.
- ✧ Pack this device and return it to the manufacturer, stating the defect. Use transport packaging that meets the requirements of standard ISO 2248.

2 Expanding Devices

2.1	Flush-Mounting Devices	26
2.2	Surface-Mounted Devices with Integrated On-Site Operation Panel	29
2.3	Surface-Mounted Devices with Detached On-Site Operation Panel	33

2.1 Flush-Mounting Devices

2.1.1 Basic Rules for Expansion




NOTE

Prepare the following tools for the device expansion:

- Phillips screwdriver size PZ1 and PZ2
- Screwdriver DIN 4 x 0.8
- During assembly, use the prescribed torques

Comply with the following basic rules when expanding devices:

- ✧ Always fit the base module on the left in the 1st device row.
- ✧ Always fit the expansion modules from left to right.
- ✧ Always fit the expansion module with the key switches as the 1st module next to the base module.
- ✧ Always fit the expansion modules without LEDs last.
- ✧ Always install a power-supply module PS203 on the left as the first unit in the 2nd device row.
- ✧ Note that the PS203 must always have the same rated voltage as the base module.
- ✧ In the 2nd device row, mount only input and output modules without LEDs.
- ✧ Always mount the redundant power-supply module PS204 at the very right in the corresponding row (seen from the front). If a CB202 PCB assembly is used in the row, this CB202 PCB assembly must always be plugged on the right of the power-supply module PS204 (at the very right).
- ✧ Note that the power-supply module PS204 must always have the same rated voltage as the base module.

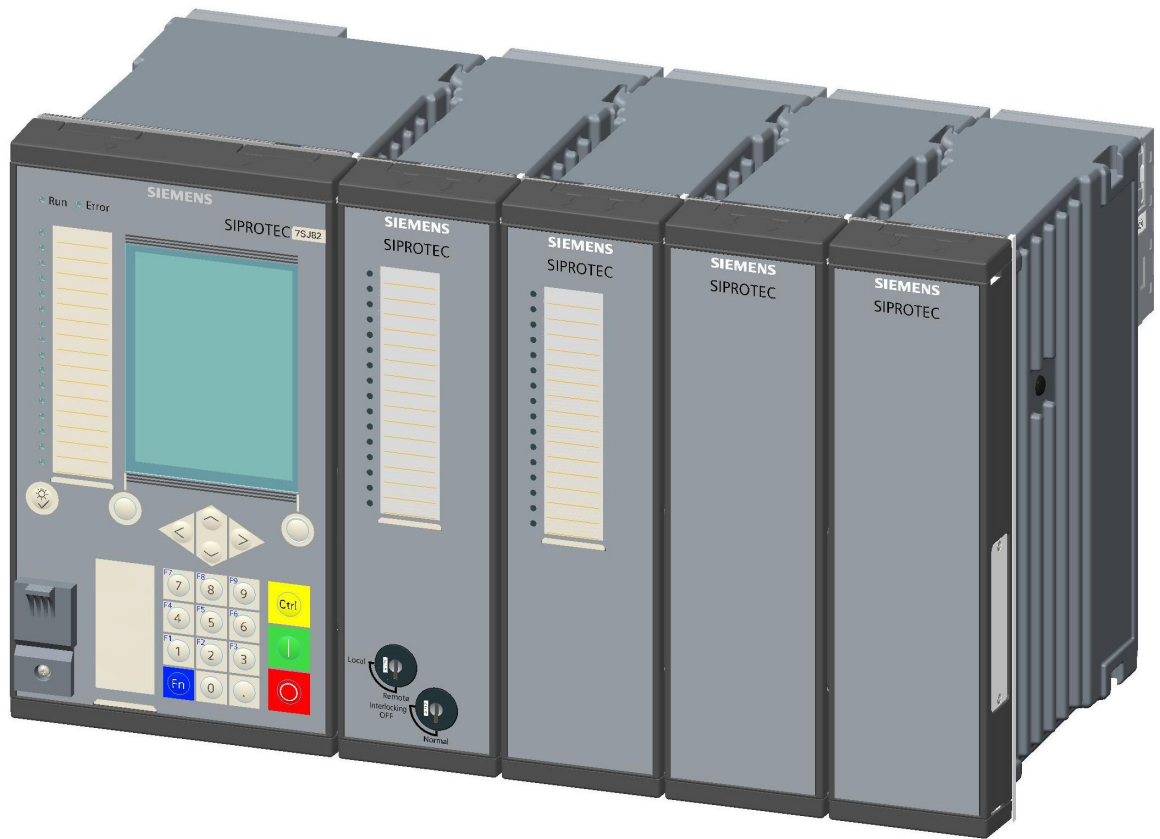

[dweinsel-030211-01.tif, 2, --,--]

Figure 2-1 Device Row of a Flush-Mounting Device

2.1.2 Expanding 1st Device Row

Preparation



NOTE

Reordered modules are not contained in the original device configuration. Use DIGSI to perform the corresponding extension in the **Hardware and Protocols** Editor.

Carry out the steps described in this chapter if you wish to expand an installed device later on with expansion modules.

- ✧ Shut down the device.
- ✧ Use the screwdriver to carefully bend the left and right spring clips on the rear plate terminals outwards.
- ✧ Completely detach the wired current and voltage terminal blocks from the device.
- ✧ Remove all communication lines.
- ✧ Remove the plastic screw covers.
- ✧ Remove the device.
- ✧ Expand the cut-out in the control cabinet.
- ✧ Then continue with assembly.

Assembling the Devices

- ✧ Remove the bus cover from the extreme right-hand module of the device to be expanded.

- ✧ Remove the plastic screw covers from the expansion module.
- ✧ Remove the right sealing strips from the base device.
- ✧ Place the expansion module on the right next to the device. Insert the 2 hinged angle clips of the expansion module in the cut-outs of the device.
- ✧ Slip ring the expansion module in the direction of the device so that the bottom snap-in spring engages.
- ✧ Bolt the 2 on-site operation panels of the module to one another through the contact tab.
- ✧ Check that the bus connection is screwed on at the extreme right of the expansion module.

Installation and Commissioning

- ✧ Reinstall the device.
- ✧ Reinstall the plastic screw covers.
- ✧ Refasten the terminal blocks and the necessary communication lines.
- ✧ Connect the current and voltage blocks of the expansion module.
- ✧ Connect any available plug-in modules.
- ✧ Use the supplied grounding cable to connect the expansion module with the device and reconnect the device to service ground.
- ✧ Extend the device configuration in DIGSI and load this configuration to the device.
- ✧ Resume operation of the device.

2.2 Surface-Mounted Devices with Integrated On-Site Operation Panel

2.2.1 Basic Rules for Expansion

**NOTE**

Prepare the following tools for the device expansion:


- Phillips screwdriver size PZ1 and PZ2
- Screwdriver DIN 4 x 0.8
- During assembly, use the prescribed torques

Comply with the following basic rules when expanding devices:

- Always fit the base module on the right in the 1st device row.
- Always fit the expansion modules from right to left.
- Always fit the on-site operation panel of the base module on the left.
- Always fit the on-site operation panels of the expansion modules from left to right.
- Always fit the on-site operation panel of the expansion module with the key switches in the 1st place next to the on-site operation panel of the base module.
- Always fit the on-site operation panels without LEDs last.
- Join the on-site operation panels to one another with 2 mounting brackets.
- Always install a power-supply module PS203 on the right as the first unit in the 2nd device row.
- Note that the PS203 must always have the same rated voltage as the base module.
- Always mount the redundant power-supply module PS204 at the very right in the corresponding row (seen from the front). If a CB202 PCB assembly is used in the row, this CB202 PCB assembly must always be plugged on the right of the power-supply module PS204 (at the very right).
- Note that the power-supply module PS204 must always have the same rated voltage as the base module.
- In the 2nd device row, you do not need any on-site operation panels, mounting brackets, or distance frames.

**NOTE**

When expanding a device in the 1st device row, order 2 mounting brackets that match the width of the expanded device.

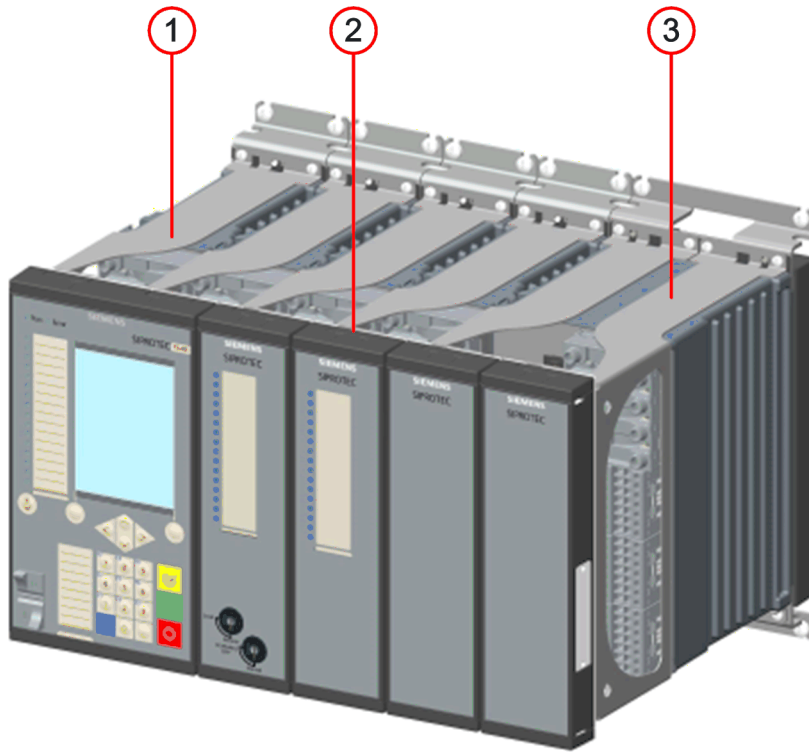

[dwauize1-040211-01.tif, 2, --,--]

Figure 2-2 Device Row

- (1) Distance frame
- (2) Mounting bracket
- (3) Distance frame on base module rotated by 180°

2.2.2 Expanding 1st Device Row

Preparation



NOTE

Reordered modules are not contained in the original device configuration. Use DIGSI to perform the corresponding extension in the **Hardware and Protocols Editor**.

Carry out the steps described in this chapter if you wish to expand an installed device later on with expansion modules.

- ✧ Shut down the device.
- ✧ Detach all on-site operation panels from the distance frames.
- ✧ Remove the mounting brackets.




NOTE

If the device is an expanded device, then detach the 2 mounting brackets. You must replace these mounting brackets with 2 new mounting brackets that match the width of the device.

- ✧ Use a screwdriver to carefully bend the left and right spring clips on the terminals outwards.
- ✧ Completely detach the wired current and voltage terminal blocks from the device.
- ✧ Remove all communication lines.

- ✧ Remove the device completely.

Assembling the On-Site Operation Panel into One Block

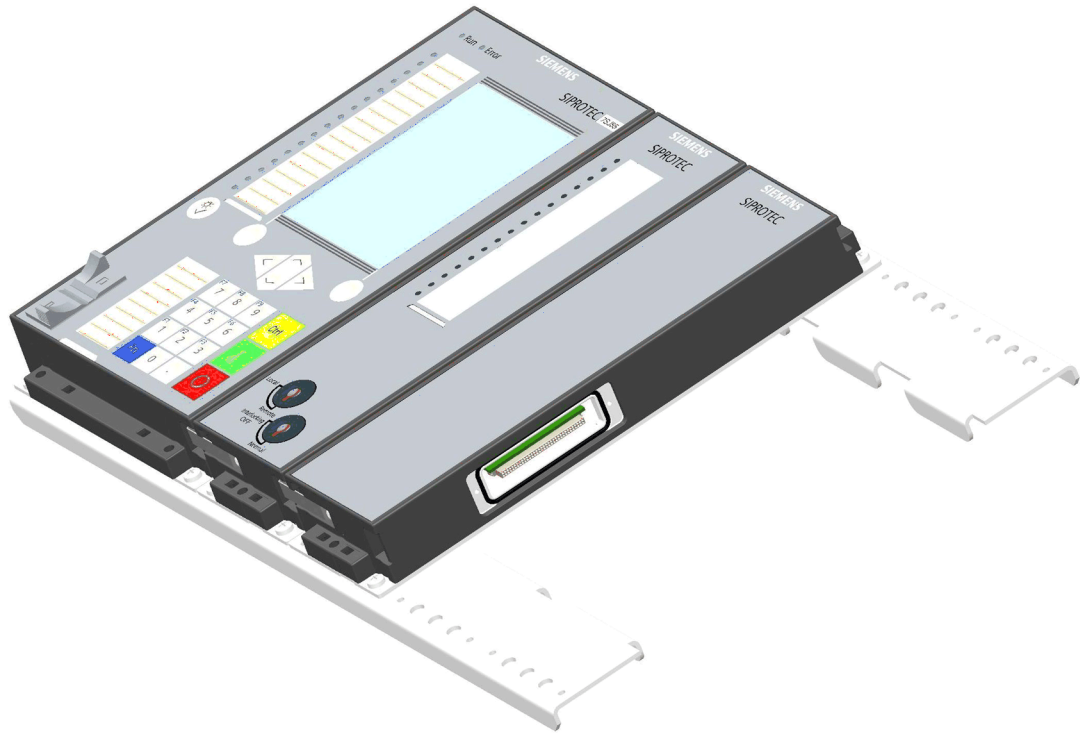

[dwaublo1-040211-01.tif, 2, --, --]

Figure 2-3 On-Site Operation Panel Fitted on Mounting Bracket

- ✧ Place the 2 mounting brackets intended for expansion in parallel to one another on a flat surface.
- ✧ Bolt the 1st (left-hand) on-site operation panel to the 2 mounting brackets. Do not firmly tighten the screws.
- ✧ Place the 2nd on-site operation panel on the right of the 1st one and screw these panels onto the 2 mounting brackets. Do not firmly tighten the screws. Make sure that the snap-in spring is engaged!
- ✧ Bolt the 2 operation panels to one another through the contact tab. Do not firmly tighten the screws.
- ✧ Repeat the last 2 steps for the remaining operation panels. Leave all screws loose.

Assembling the Devices

- ✧ Remove the distance frame from the expansion module.
- ✧ Remove the bus cover from the extreme left-hand module.
- ✧ Remove the plastic screw covers from the extreme left-hand module and from the expansion module.
- ✧ Place the expansion module on the left next to the device. Insert the 2 hinged angle clips of the expansion module in the cut-outs of the device.
- ✧ Swivel the expansion module in the direction of the device so that the bottom snap-in spring engages.
- ✧ Bolt the contact tab to the 2 modules.

Installation and Commissioning

- ✧ Install the distance frame intended for expansion.
- ✧ Wire and, if required, fasten the current and voltage terminal blocks.

- ✧ Fit the device back onto the wall without fastened on-site operation panels.
- ✧ Use the supplied grounding cable to connect the expansion module with the device and reconnect the device to service ground.
- ✧ Fasten the connecting cable for the on-site operation panel on the extreme left-hand operation panel of those on-site operation panels assembled beforehand into a block.
- ✧ Place the block of assembled operation panels on the distance frames of the device. In doing so, guide the connecting cable for the on-site operation panel through the cut-outs of the distance frame to the terminal of the base module.
- ✧ Fasten the connecting cable for the on-site operation panel to the base module.
- ✧ Bolt the operation panels to the distance frames and firmly tighten the screws.
- ✧ Tighten all loose screws on the contact tabs and on the mounting brackets.
- ✧ Reinstall all plastic screw covers.
- ✧ Extend the device configuration in DIGSI and load it to the device.
- ✧ Resume operation of the device.

2.3 Surface-Mounted Devices with Detached On-Site Operation Panel

2.3.1 Basic Rules for Expansion




NOTE

Prepare the following tools for the device expansion:

- Phillips screwdriver size PZ1 and PZ2
- Screwdriver DIN 4 x 0.8
- During assembly, use the prescribed torques


Comply with the following basic rules when expanding devices:

- Always fit the base module on the right in the 1st device row.
- Always fit the expansion modules from right to left.
- Always fit the on-site operation panel of the base module on the left.
- Always fit the on-site operation panels of the expansion modules from left to right.
- Always install a power-supply module PS203 on the right as the first unit in the 2nd device row.
- Note that the PS203 must always have the same rated voltage as the base module.
- Always mount the redundant PS204 power-supply module at the position at the very left in the corresponding row (seen from the front). If a CB202 PCB assembly is used in the row, this CB202 PCB assembly must always be plugged on the left of the power-supply module PS204 (at the very left).
- Note that the power-supply module PS204 must always have the same rated voltage as the base module.
- The distance between the device and the on-site operation panel is limited to not more than 5 m (196.85 in) by the length of the connecting cable.

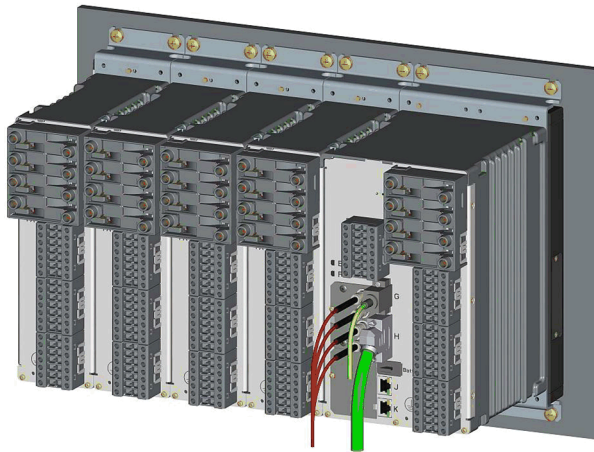

[dwauizei-040211-01.tif, 1, --,--]

Figure 2-4 Device Row

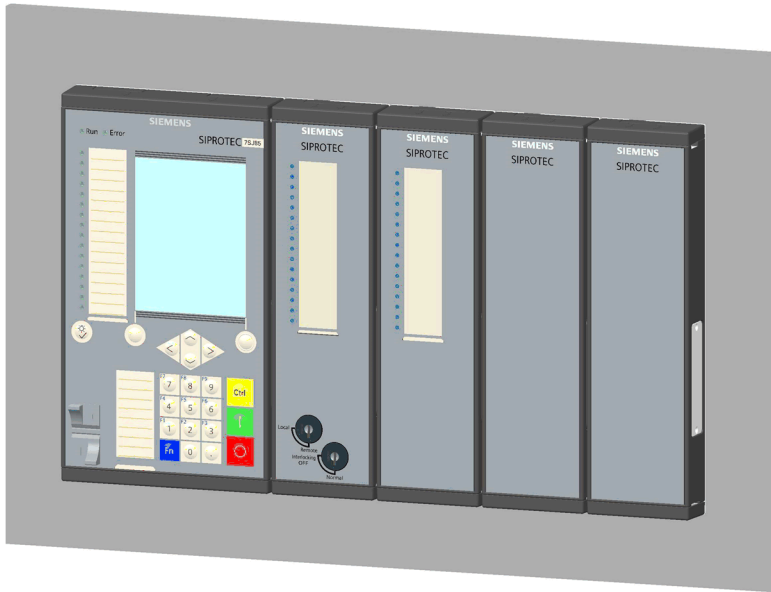

[dwabosop-040211-01.vsd, 2, en_US]

Figure 2-5 Detached On-Site Operation Panel

2.3.2 Expanding 1st Device Row

Preparation



NOTE

Reordered modules are not contained in the original device configuration. Use DIGSI to perform the corresponding extension in the **Hardware and Protocols** Editor.

Carry out the steps described in this chapter if you wish to expand an installed device later on with expansion modules.

- ✧ Shut down the device.
- ✧ Use a screwdriver to carefully bend the left and right spring clips outwards.
- ✧ Completely detach the wired current and voltage terminal blocks from the device.
- ✧ Remove all communication lines.
- ✧ If you want to expand the device, then detach it completely.
- ✧ If you want to expand the on-site operation panel, then remove the on-site operation panel from the installation space.



NOTE

The device and the on-site operation panel can be expand independently of one another. Therefore, you need only detach those components that are to be expanded.

Installing the Devices (with View to the Installation Plane)

- ✧ Remove the bus cover from the extreme left-hand module of the device to be expanded.
- ✧ Remove the plastic screw covers from the extreme right-hand module and from the expansion module.
- ✧ Place the expansion module on the left next to the device. Insert the 2 hinged angle clips of the expansion module in the cut-out of the device.

- ✧ Swivel the expansion module in the direction of the device so that the bottom snap-in spring engages.
- ✧ Bolt the on-site operation panels of the 2 modules to one another through the contact tab.
- ✧ Check that the bus connection is screwed on at the extreme left of the expansion module.

Assembly and Commissioning


- ✧ Reinstall the plastic screw covers.
- ✧ Use the supplied grounding cable to connect the expansion module with the device and reconnect the device to service ground.
- ✧ Fit the device back onto the wall.
- ✧ Expand the on-site operation panel with the on-site operation panel of the expansion modules. Make sure that the bus connection is plugged in reliably and that the snap-in springs have engaged.
- ✧ Bolt the on-site operation panels to one another through the contact tab.
- ✧ Check that the bus connection on the expansion module on the extreme right is covered.
- ✧ Connect all communication lines again.
- ✧ Extend the device configuration in DIGSI and load this configuration to the device.
- ✧ Resume operation of the device.

3 Fitting the Devices

3.1	Flush-Mounting Devices	38
3.2	Surface-Mounted Devices with Integrated On-Site Operation Panel	50
3.3	Surface-Mounted Devices with Detached On-Site Operation Panel	61

3.1 Flush-Mounting Devices

Drilling Patterns and Dimension Specifications

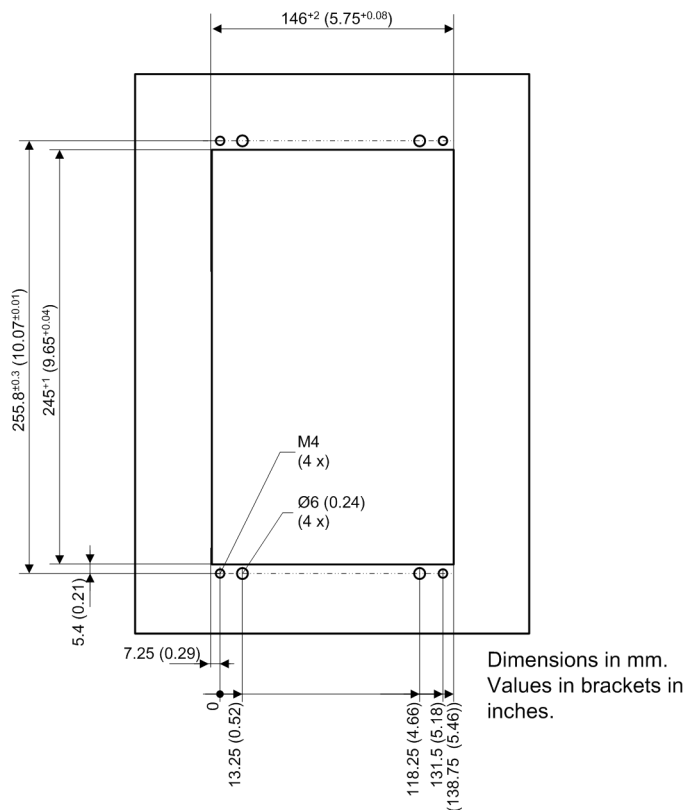

[dw_z1_1-3, 2, en_US]

Figure 3-1 Cut-Out Widths and Drilling Pattern – 1/3 Device, 1st Device Row






Figure 3-2 Cut-Out Widths and Drilling Pattern – 1/2 Device, 1st Device Row

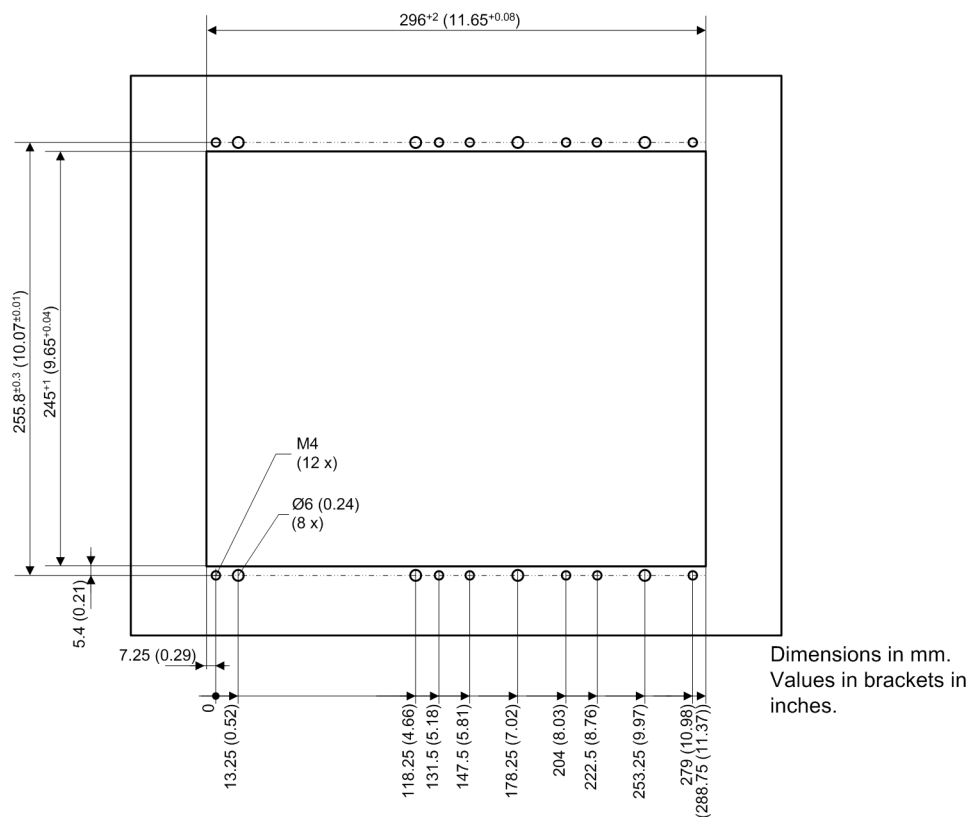


[dw_z1_2-3, 2, en_US]

Figure 3-3 Cut-Out Widths and Drilling Pattern – 2/3 Device, 1st Device Row

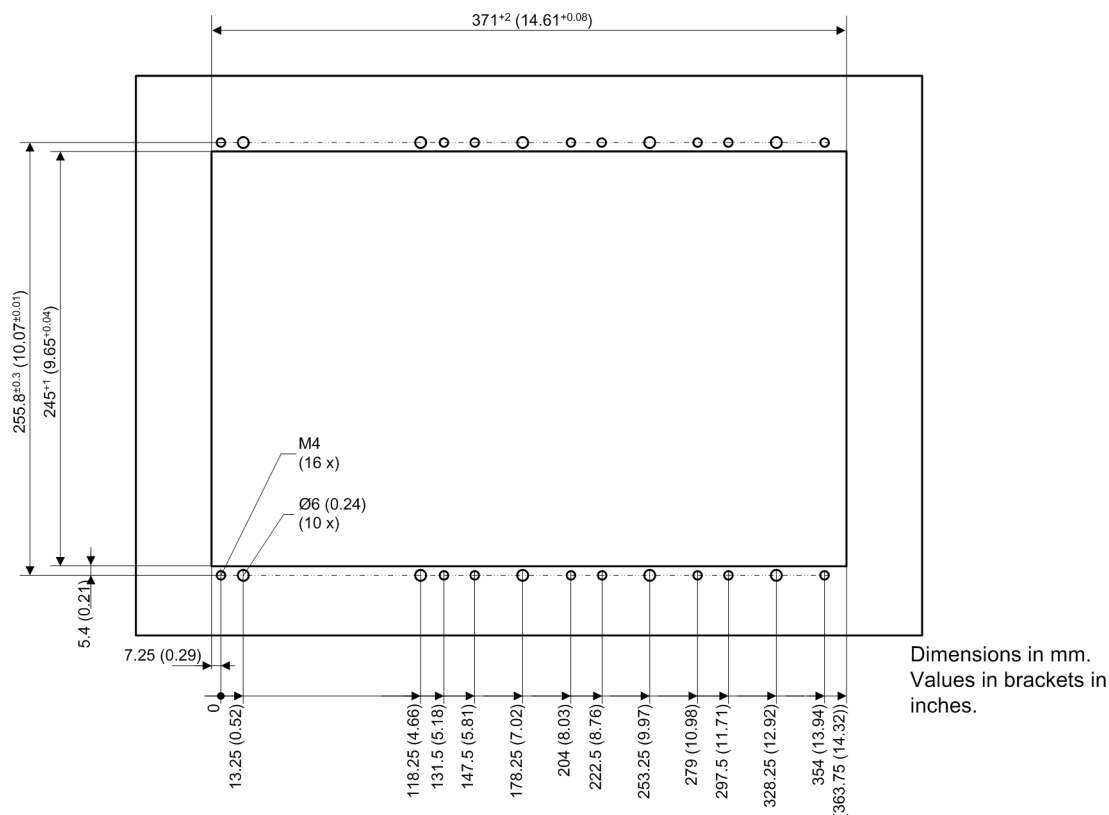

[dw_z1_5-6, 2, en_US]


Figure 3-4 Cut-Out Widths and Drilling Pattern – 5/6 Device, 1st Device Row

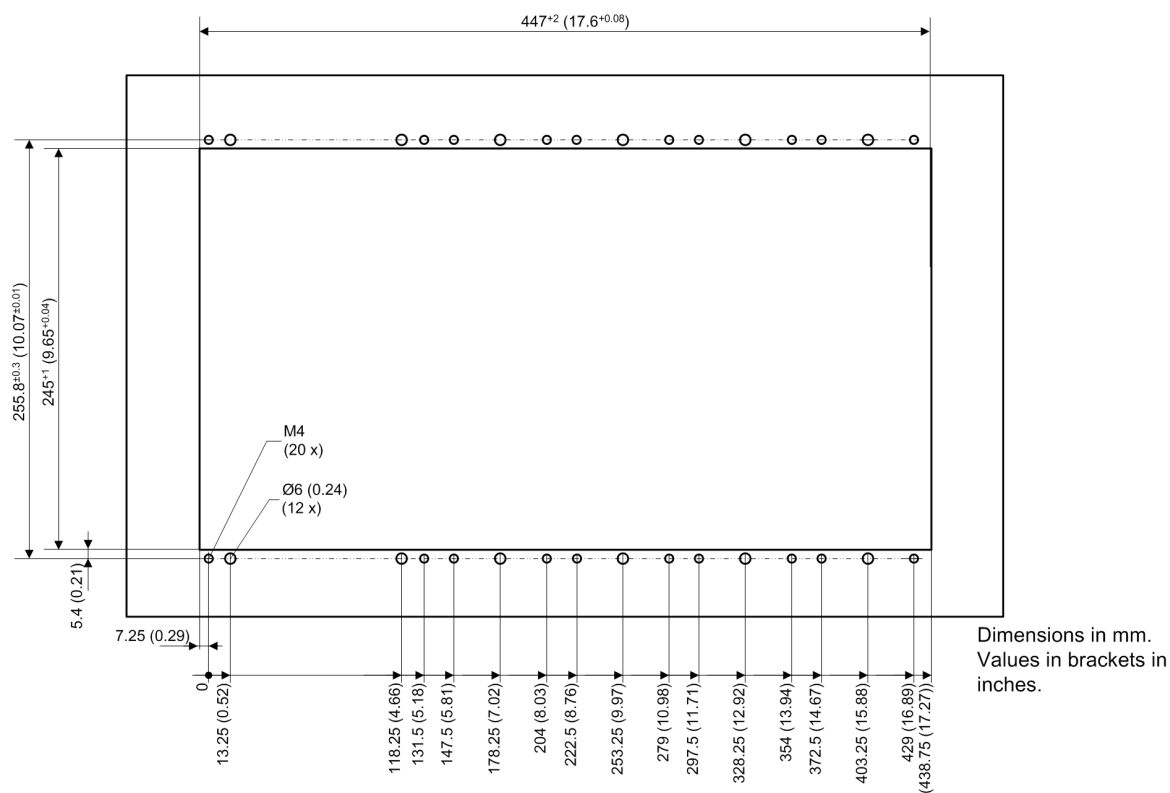

[dw_z1_1-1, 3, en_US]


Figure 3-5 Cut-Out Widths and Drilling Pattern – 1/1 Device, 1st Device Row

All drillings in the area of the specific device cut-out widths (see [Table 3-1](#)) must comply with the dimensions in the corresponding figures.

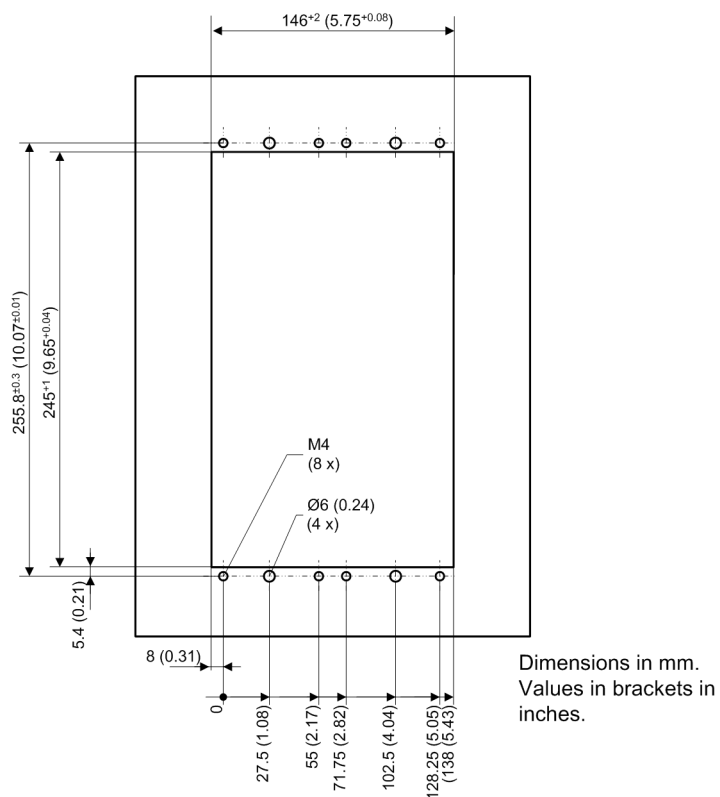


[dw_z2_2-6, 2, en_US]

Figure 3-6 Cut-Out Widths and Drilling Pattern – 1/3 Device, 2nd Device Row

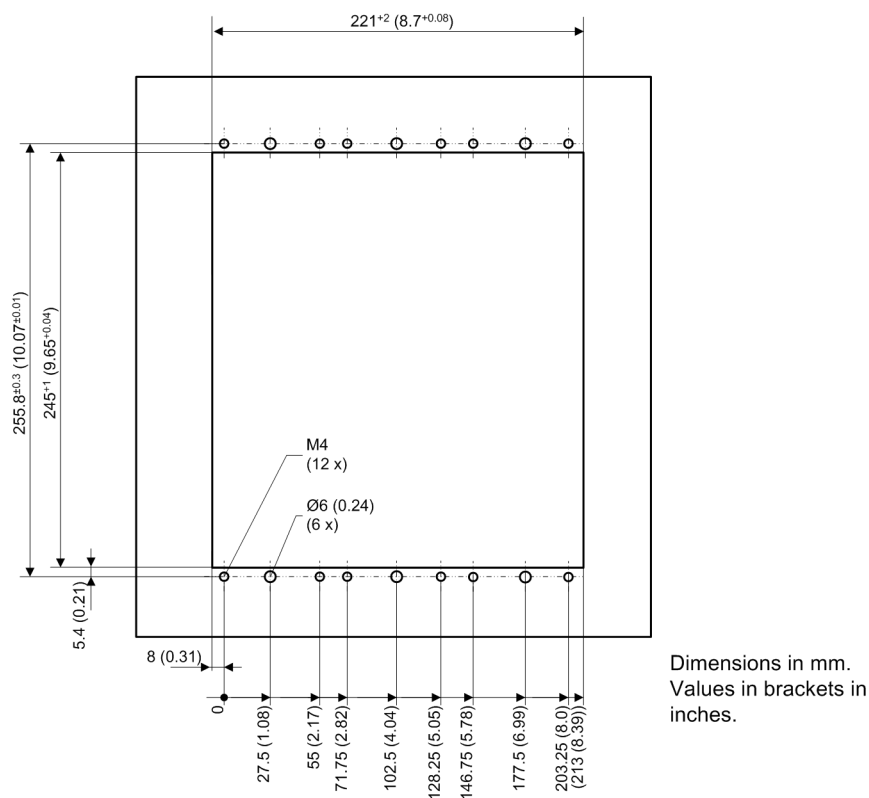


[dw_z2_3-6, 2, en_US]

Figure 3-7 Cut-Out Widths and Drilling Pattern – 1/2 Device, 2nd Device Row

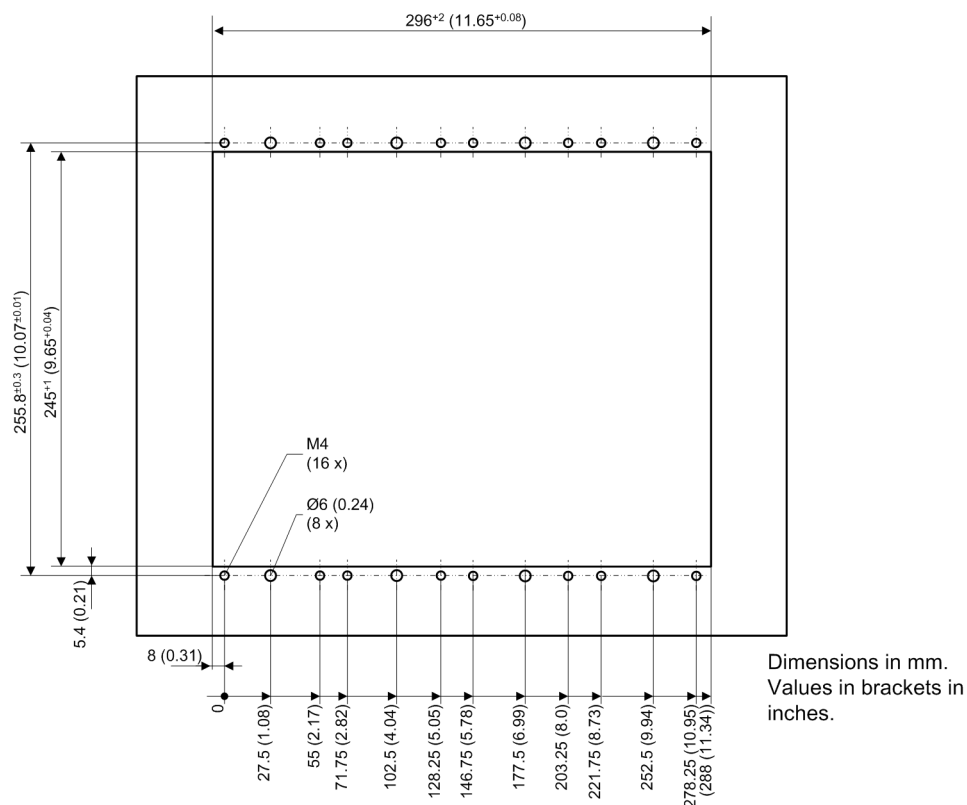


[dw_z2_4-6, 2, en_US]

Figure 3-8 Cut-Out Widths and Drilling Pattern – 2/3 Device, 2nd Device Row

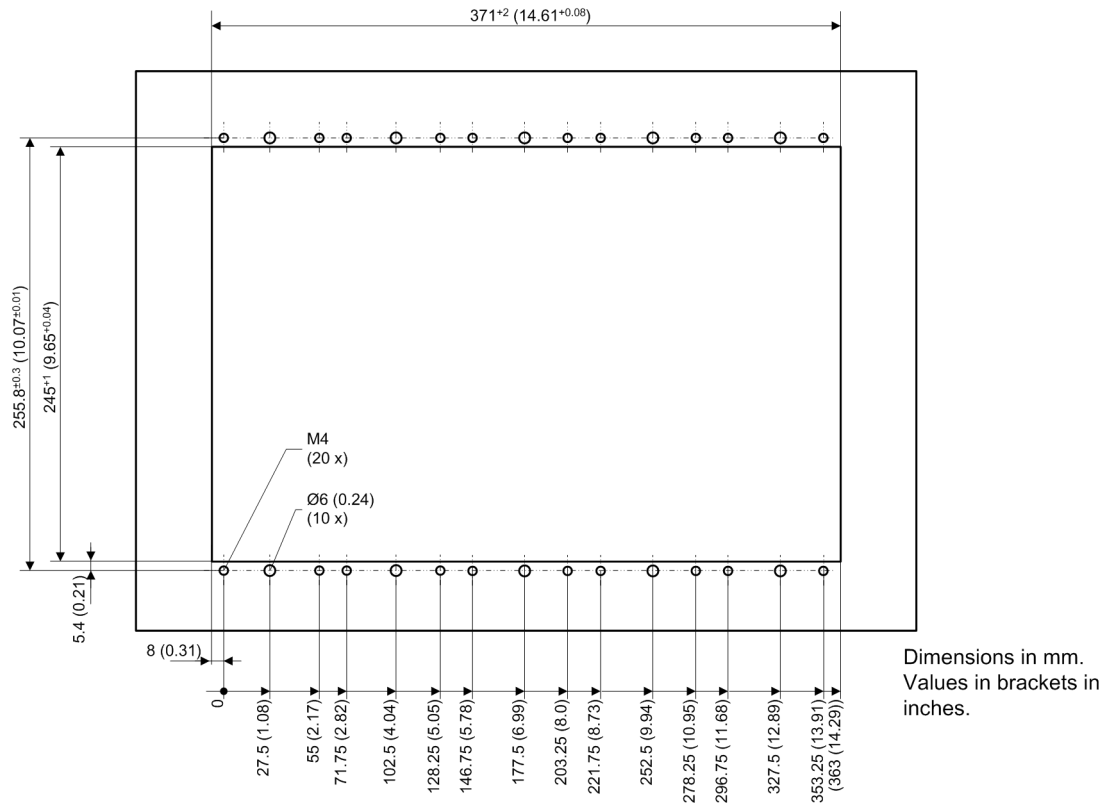


[dw_z2_5-6, 2, en_US]

Figure 3-9 Cut-Out Widths and Drilling Pattern – 5/6 Device, 2nd Device Row

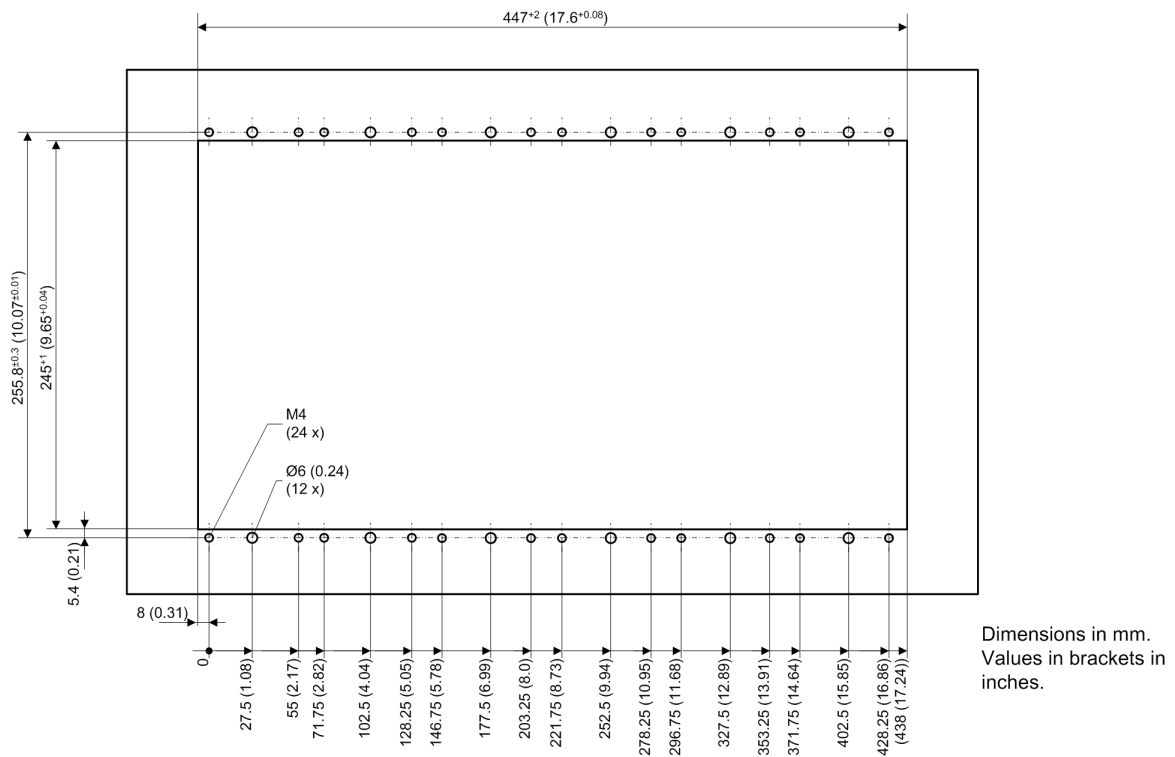

[dw_z2_6-6, 3, en_US]


Figure 3-10 Cut-Out Widths and Drilling Pattern – 1/1 Device, 2nd Device Row

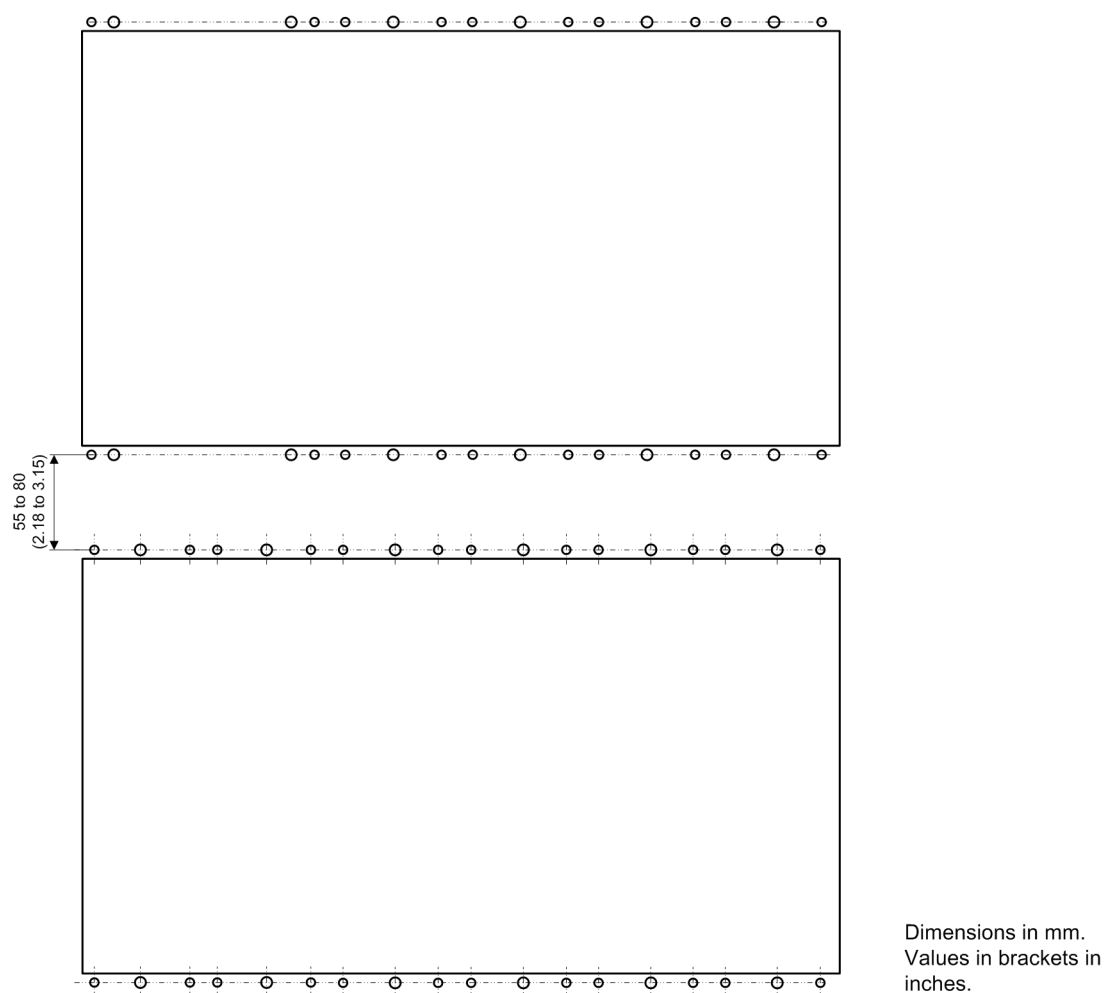

[dw_first and second device row, 1, en_US]

Figure 3-11 Drilling Pattern – 1/1 Devices, 1st and 2nd Device Row

Siemens recommends a drilling space of at least 55 mm (2.17 in) between the 1st and 2nd device row. Due to the connecting-cable length, the maximum space may be approx. 80 mm (3.15 in). The length of the cable is 890 mm (35.04 in) from the center of the plug to the center of the plug.

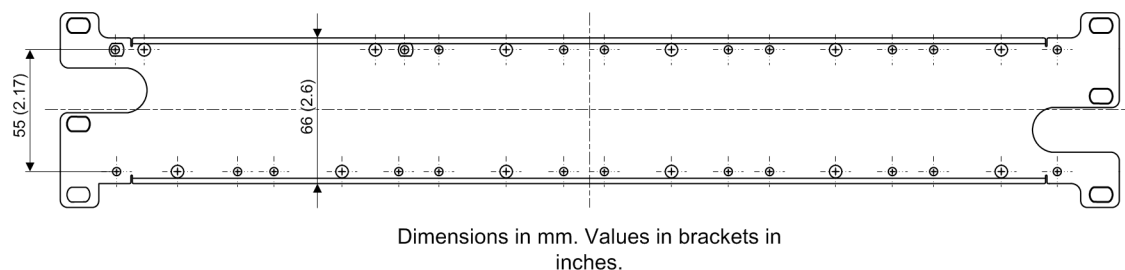

[dw_angle rail, 1, en_US]

Figure 3-12 Angle Rail for Connection of the 1st and 2nd Device Row


Table 3-1 Cut-Out Widths

	Width of the Assembly Opening in mm (in Inches)
1/3 device (base module)	146 ⁺² mm (5.75 ^{+0.08})
1/2 device (base module with one expansion module)	221 ⁺² mm (8.7 ^{+0.08})
2/3 device (base module with 2 expansion modules)	296 ⁺² mm (11.65 ^{+0.08})

	Width of the Assembly Opening in mm (in Inches)
5/6 device (base module with 3 expansion modules)	371 ⁺² mm (14.61 ^{+0.08})
1/1 device (base module with 4 expansion modules)	447 ⁺² mm (17.6 ^{+0.08})

Table 3-2 Variable Housing Widths

	Dimension a Housing Widths in mm (in Inches) (Total Width: Housing Width + 4.6 mm (0.18 in))
1/3 device	145 (5.71)
1/2 device	220 (8.66)
2/3 device	295 (11.61)
5/6 device	370 (14.57)
1/1 device	445 (17.52)

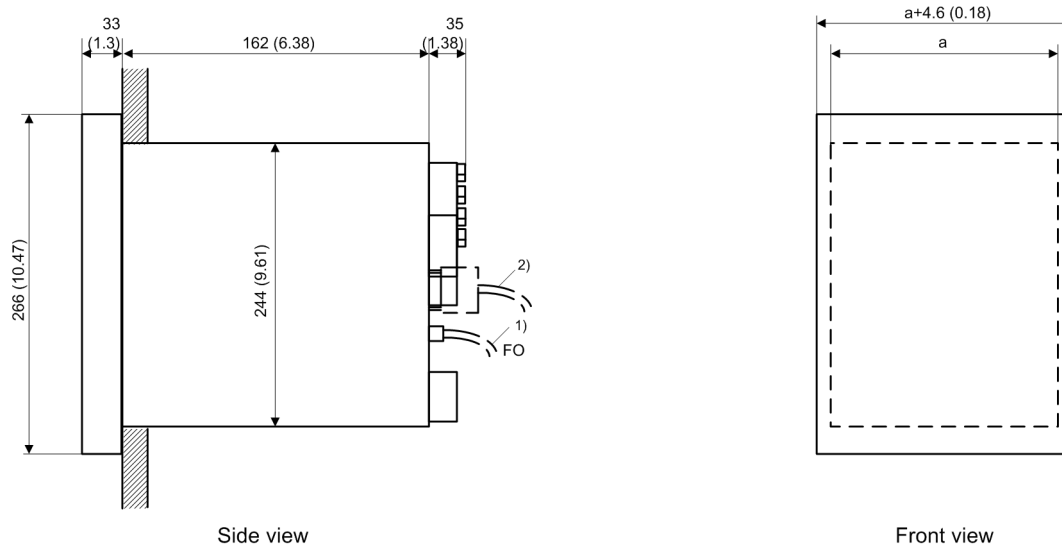

Dimensions in mm. Values in brackets in inches.

Attention!

- 1) For FO cables, a minimum bending radius $R = 50$ mm (1.97 inch) must be considered according to the type.
- 2) For D-sub connector plugs, the axial length of the plug + cable bending radius must be considered.
Minimum bending radius $R = 50$ mm (1.97 inch)

[dw_surface_mounting_in, 2, en_US]

Figure 3-13 Flush-Mounting Devices, Dimensions from the Side and Front Views

3.1.1 Fitting the Devices

Preparations



NOTE

You must mount the devices vertically.



NOTE

The installation depth for 1 device is at least 275 mm (11.83 in). This dimension includes the necessary bending radius for the various connectors of the plug-in modules.

The M4 holes are the holes for the fastening screws of the device. The Ø 6 holes are the openings for the fastening screws of the on-site operation panels on the device.



NOTE

Use a PZ2-size Phillips screwdriver.

For each module, you need 4 fastening screws with a shank diameter of 4 mm (0.16 in)



WARNING

Danger due to device being improperly screw-fastened

Incomplete and careless screw-fastening can lead to death, severe injury, and considerable material damage.

- ✧ Ensure that screw-fastening is complete at all intended bolting points. Tighten the screws to a torque of 1.2 Nm.

- ✧ If no assembly opening is prepared, then cut out the required assembly opening.
- ✧ Produce the holes as shown in the drilling plan.

Fitting the Devices

- ✧ Detach the top and bottom plastic screw covers of each on-site operation panel.
- ✧ Insert the device in the installation opening. Make sure that the fastening screws of the on-site operation panels also protrude exactly into the openings (6-mm diameter (0.24-in diameter)).
- ✧ With the M4 oval head cap screws, bolt down the device at the top and bottom at all 4 bolting points of each module.
- ✧ Check for secure attachment.
- ✧ Fit the top and bottom plastic screw covers again.

3.1.2 Activating the Battery

Removing the Protective Film



NOTE

The battery is covered with a protective film to protect it from mechanical damage and against premature discharge.

The battery need not be removed from the battery compartment for activation.

- ✧ Pull out the battery compartment.
- ✧ Remove the protective film from the battery by simply pulling on the film tab.
- ✧ Push the battery compartment back in again.

3.1.3 Grounding and Connecting Devices

Grounding the Devices

The SIPROTEC 5 devices are protection class I equipment must be connected with the system ground before commissioning.



DANGER

Danger due to device being improperly grounded

Incomplete and careless grounding leads to death, severe injury, and considerable material damage!

- ✧ The device must be situated in the operating area for at least 2 hours before you connect it to the power supply for the first time. This method prevents condensation of water in the device.
 - ✧ If the device has been in storage for more than 2 years, connect it to an auxiliary voltage for 1 to 2 days. This will cause the electrolytic capacitors to form on the printed circuit board assemblies again.
-
- ✧ Ground each module with solid low-impedance system grounding (cross-section $\geq 4.0 \text{ mm}^2$ (0.16 in²), grounding area $\geq \text{M4}$).

Connecting Devices

- ✧ Connect all cables and leads. Use the connection diagrams in the Hardware and Device manuals.
- ✧ Tighten the terminal screws to the prescribed torques.

Grounding an On-Site Operation Panel

- ✧ Join several on-site operation panels to one another with firm contact.
Siemens recommends the use of contact washers on painted metal assembly walls. If the assembly wall is not metallic, place a metal layer, for example a metal sheet, between the assembly wall and the on-site operation panels. Then connect this sheet to the system ground.

3.1.4 Tightening Torques of Fastening Screws

Tightening Torques for Terminal Screws

Type of Line	Current Terminal	Voltage Terminal with Spring-Loaded Terminals	Voltage Terminal with Screw Connection
Litz wire with ring-type lug	2.7 Nm	No ring-type lug	No ring-type lug
Stranded wires with bootlace ferrules or pin-type lugs	2.7 Nm	1.0 Nm	0.6 Nm
Solid conductor, bare (2 mm ²)	2.0 Nm	1.0 Nm	–



NOTE

Make sure that the cables and lines of extra-low voltage circuits are laid sufficiently far away from power network circuits.


Torques for Other Screw Types

Screw Type	Torque
M4 x 20	1.2 Nm
M4 x 8	1.2 Nm
M2.5 x 6	0.39 Nm

Screw Type	Torque
Countersunk screw, M2.5 x 6	0.39 Nm
Countersunk screw, M2.5 x 8	0.39 Nm
Collar screw, M4 x 20	0.7 Nm

3.2 Surface-Mounted Devices with Integrated On-Site Operation Panel

Drilling Patterns and Dimension Specifications (Modular Device)

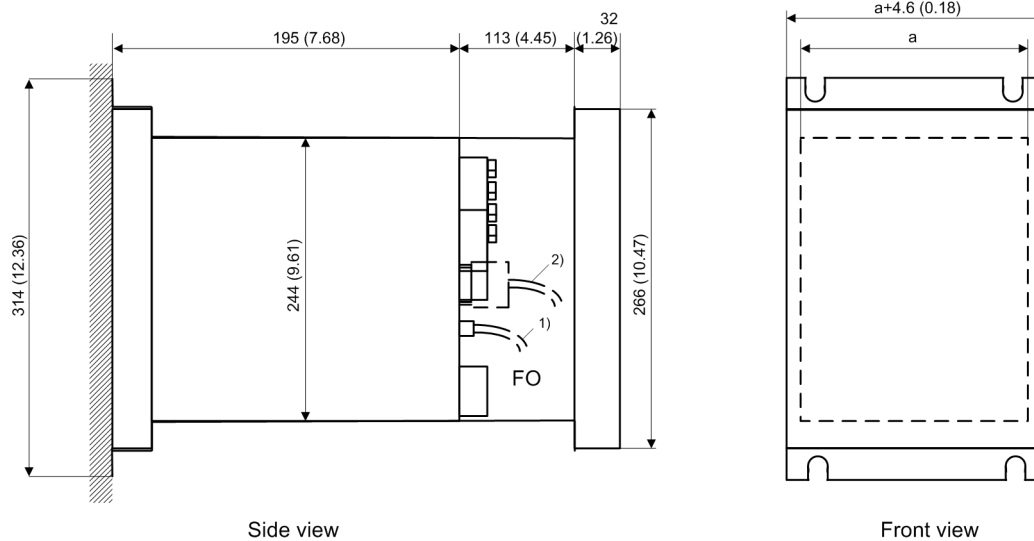

Dimensions in mm. Values in brackets in inches.

Attention!

- 1) For FO cables, a minimum bending radius $R = 50$ mm (1.97 inch) must be considered according to the type.
- 2) For D-sub connector plugs, the axial length of the plug + cable bending radius must be considered.
Minimum bending radius $R = 50$ mm (1.97 inch)


[dwosopin-070211-01.tif, 3, en_US]

Figure 3-14 1/3 Surface-Mounted Device with Integrated On-Site Operation Panel, Dimensions in the Side and Front Views




NOTE

For surface-mounted devices, make sure that the drillings fit for a screw of the size M6.

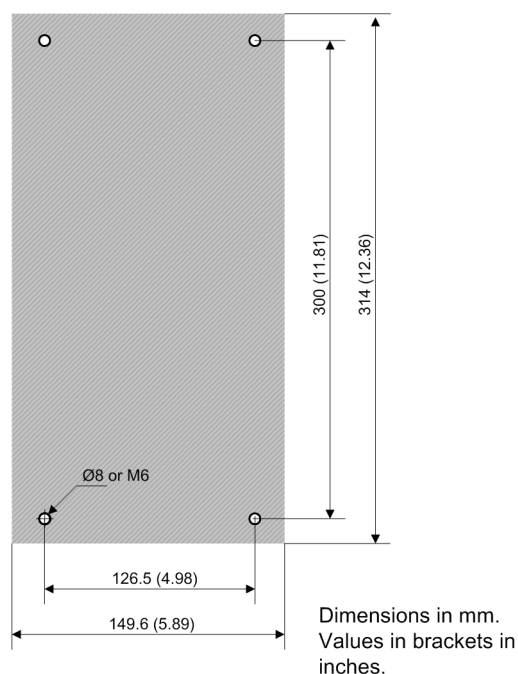


[dwbohrge-1_3.vsd, 2, en_US]

Figure 3-15 Drilling Pattern of a 1/3 Surface-Mounted Device – 1st Device Row

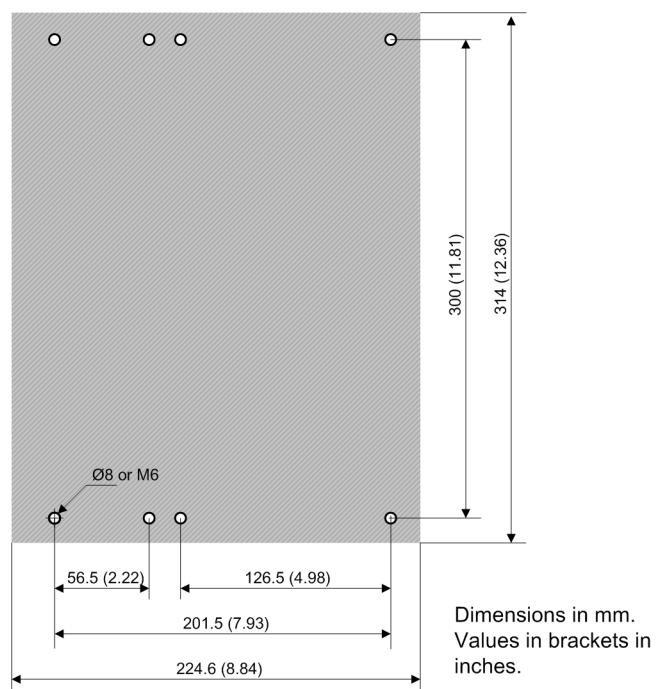


[dwbohrge-1_2.vsd, 2, en_US]

Figure 3-16 Drilling Pattern of a 1/2 Surface-Mounted Device – 1st Device Row

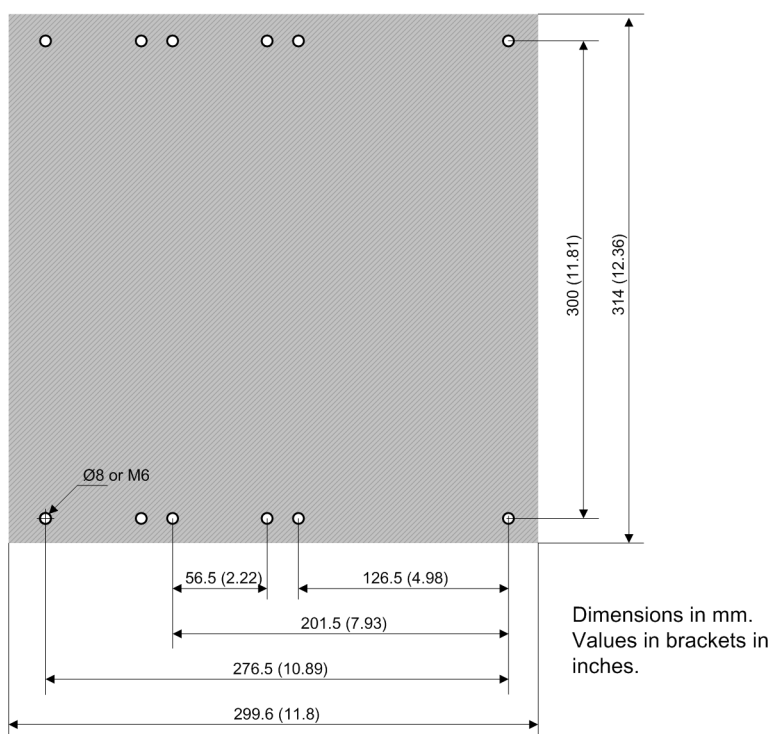


[dwbohrg-2_3.vsd, 2, en_US]

Figure 3-17 Drilling Pattern of a 2/3 Surface-Mounted Device – 1st Device Row

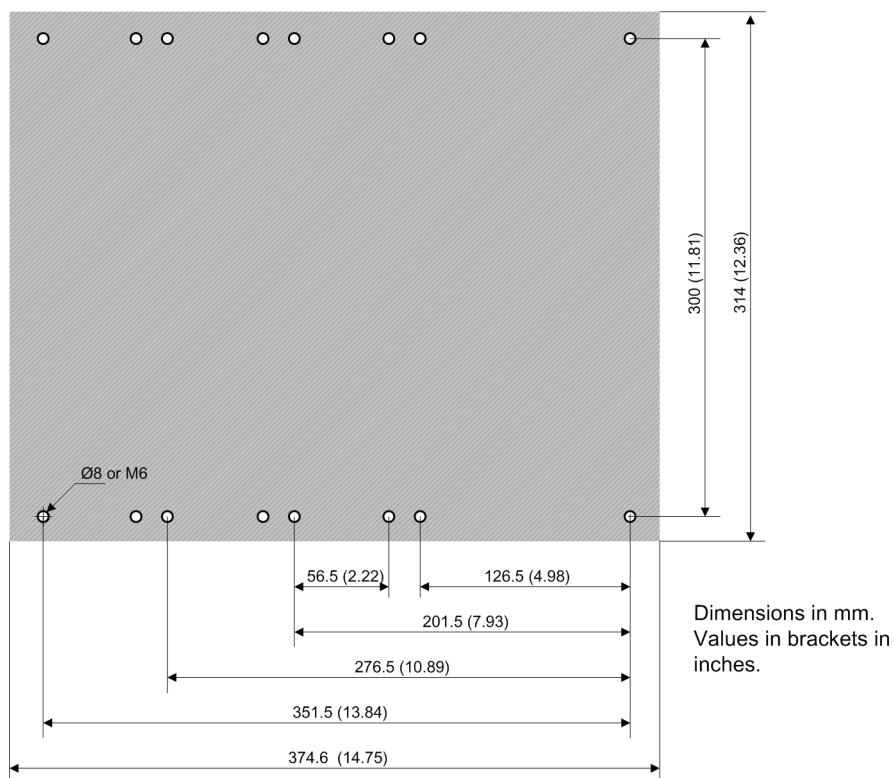


[dwbohrg-5_6.vsd, 2, en_US]

Figure 3-18 Drilling Pattern of a 5/6 Surface-Mounted Device – 1st Device Row

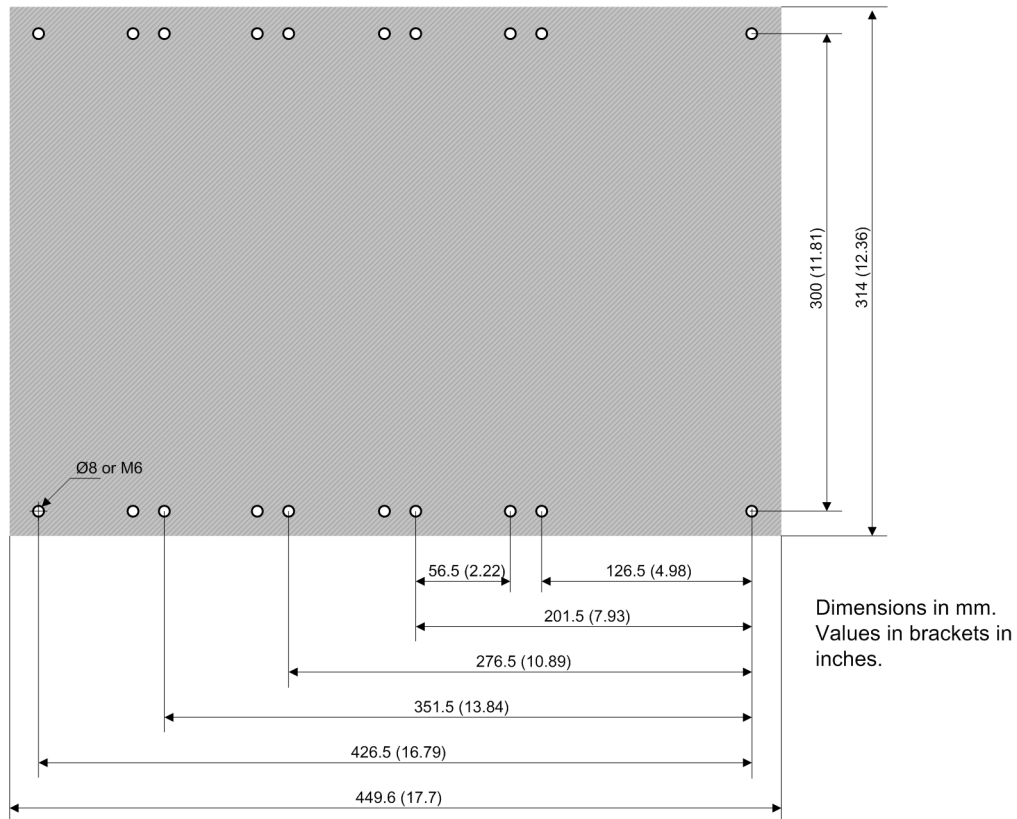


[dwbohrg-070211-01.tif, 3, en_US]

Figure 3-19 Drilling Pattern of a 1/1 Surface-Mounted Device – 1st Device Row

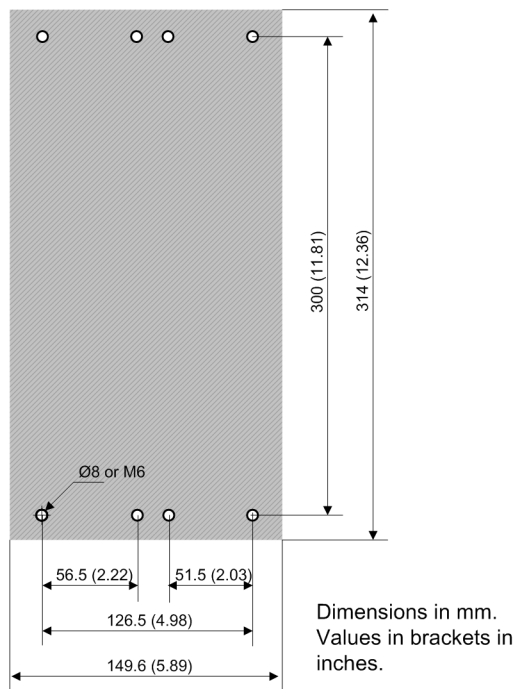


[dw_z2_bohr_1-3.vsd, 2, en_US]

Figure 3-20 Drilling Pattern of a 1/3 Surface-Mounted Device – 2nd Device Row

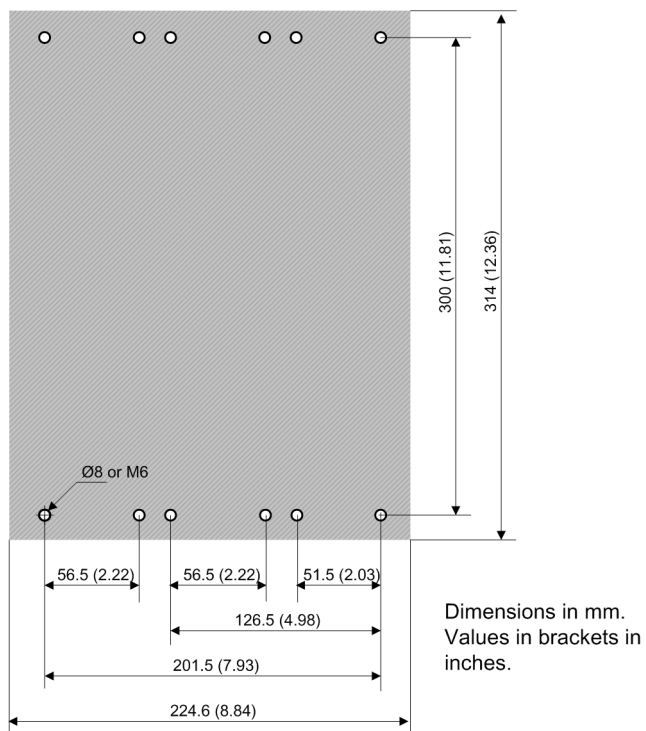


[dw_z2_bohr_1-2.vsd, 2, en_US]

Figure 3-21 Drilling Pattern of a 1/2 Surface-Mounted Device – 2nd Device Row

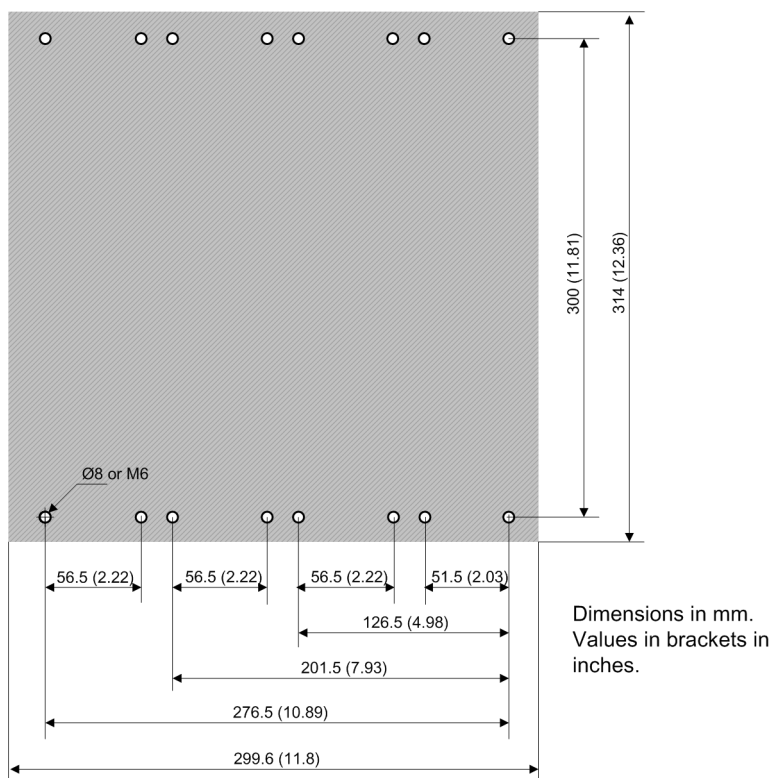


[dw_z2_bohr_2-3.vsd, 2, en_US]

Figure 3-22 Drilling Pattern of a 2/3 Surface-Mounted Device – 2nd Device Row

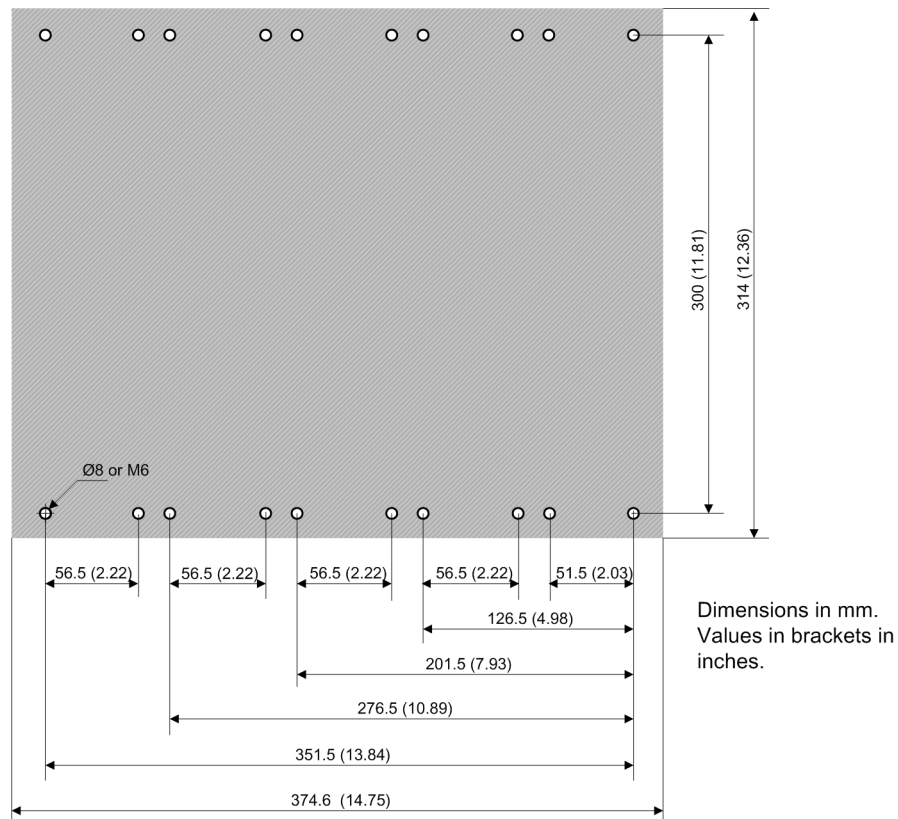

[dw_z2_bohr_5-6.vsd, 2, en_US]


Figure 3-23 Drilling Pattern of a 5/6 Surface-Mounted Device – 2nd Device Row

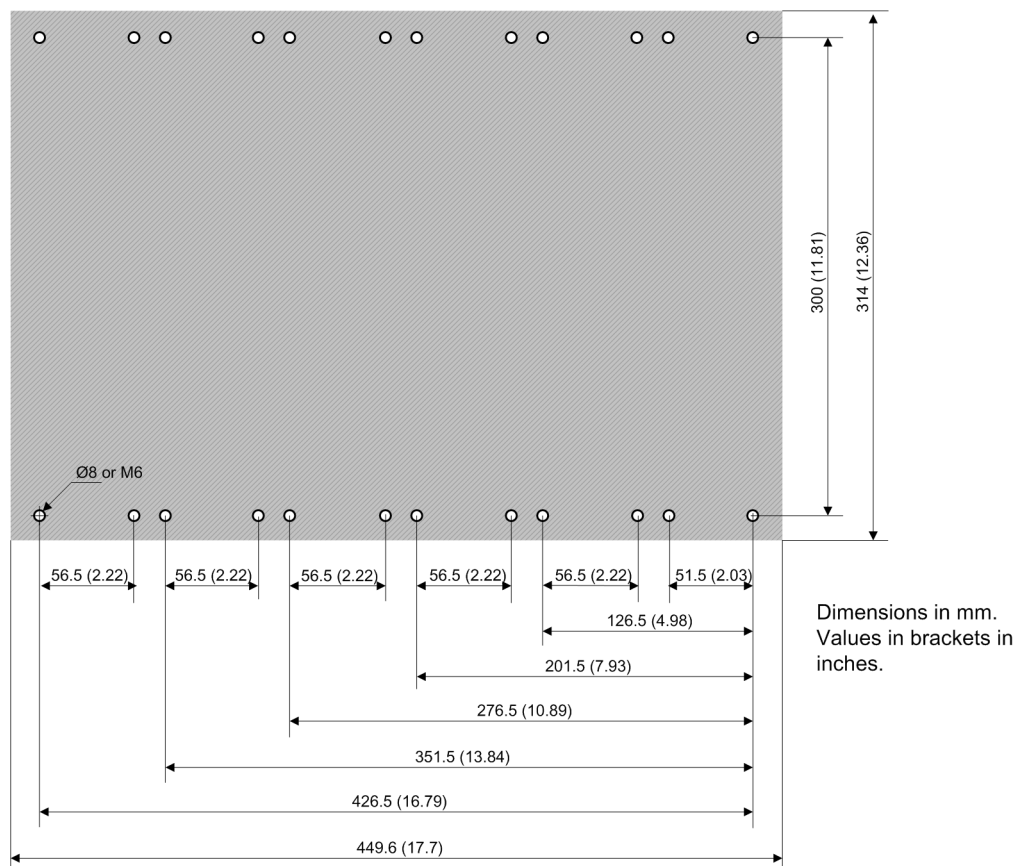

[dw_z2_bohr_1-1.vsd, 2, en_US]

Figure 3-24 Drilling Pattern of a 1/1 Surface-Mounted Device – 2nd Device Row

Dimensions, Non-Modular Surface-Mounted Device

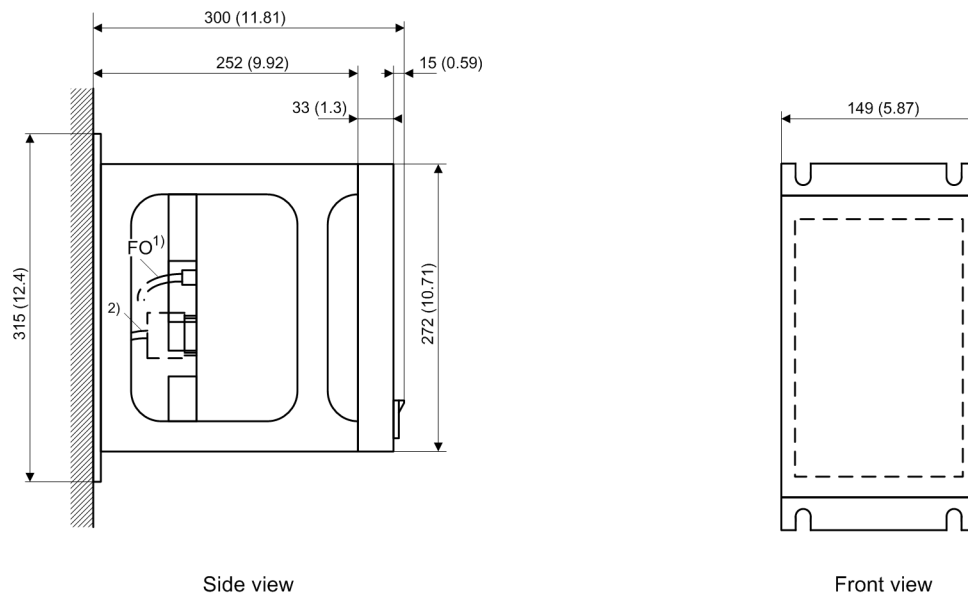

Dimensions in mm. Values
in brackets in inches.

Attention!

- ¹⁾ For FO cables, a minimum bending radius $R = 50$ mm (1.97 inch) must be considered according to the type.
- ²⁾ For D-sub connector plugs, the axial length of the plug + cable bending radius must be considered.
Minimum bending radius $R = 50$ mm (1.97 inch)

[dw_console side view.vsd, 3, en_US]


Figure 3-25 Non-Modular Surface-Mounted Device with Integrated On-Site Operation Panel, Dimensions from the Side and Front Views

Drilling Pattern, Non-Modular Surface-Mounted Device



NOTE

For surface-mounted devices, make sure that the drillings fit for a screw of the size M6.

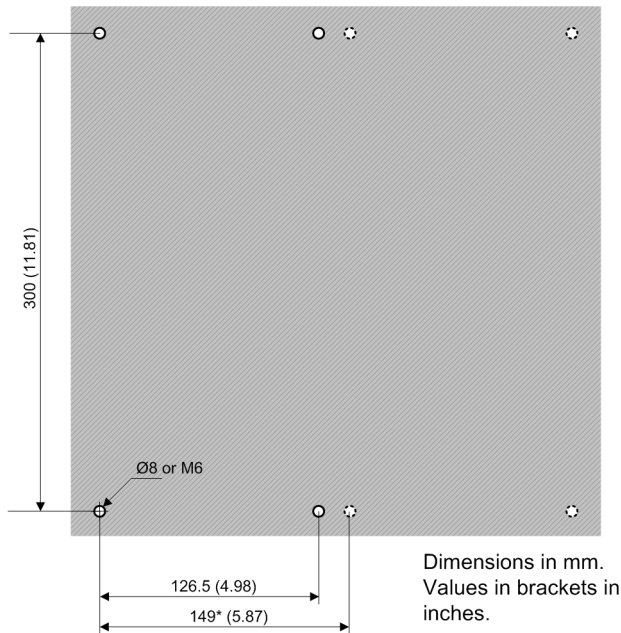

[dw_drilling non modular surface mounting with several consoles, 1, en_US]

Figure 3-26 Drilling Pattern of a Non-Modular Surface-Mounted Device – Several Consoles

* The 149 mm are valid if several mounted consoles are to be mounted next to each other.

3.2.1 Fitting Devices

Preparations



NOTE

You must mount the devices vertically.



NOTE

Siemens recommends detaching the on-site operation panels before fitting the device. Fit the on-site operation panels after completing wiring and checks.



NOTE

Use a PZ2-size Phillips screwdriver.
For each module, you need 4 fastening screws with a shank diameter of 6 mm (0.16 in).



DANGER

Danger due to device being improperly screw-fastened

Incomplete and careless screw fitting results in death, severe injury, or considerable material damage!

✧ Ensure that screw-fastening is complete at all intended bolting points. Tighten the screws to a torque of 1.2 Nm.

✧ Produce the holes as shown in the drilling plan.

Fitting Devices

- ✧ First bolt the bottom fastening screws into the mounting wall.
- ✧ Then lower the bottom mounting bracket of the device onto the bottom fastening screws.
- ✧ Align the device in the oblong holes. Ensure that screw-fastening is complete at all intended bolting points.
- ✧ Then screw the device onto the top mounting bracket with the fastening screws.
- ✧ Then check for secure attachment of the device on the mounting wall.

3.2.2 Activating the Battery

Removing the Protective Film



NOTE

The battery is covered with a protective film to protect it from mechanical damage and against premature discharge.

The battery need not be removed from the battery compartment for activation.

- ✧ Pull out the battery compartment.
- ✧ Remove the protective film from the battery by simply pulling on the film tab.
- ✧ Push the battery compartment back in again.

3.2.3 Grounding and Connecting Devices

Grounding Devices



DANGER

Danger due to device being improperly grounded

Incomplete and careless grounding leads to death, severe injury, and considerable material damage!

- ✧ The device must be situated in the operating area for at least 2 hours before you connect it to the power supply for the first time. This method prevents condensation of water in the device.
 - ✧ If the device has been in storage for more than 2 years, connect it to an auxiliary voltage for 1 to 2 days. This will cause the electrolytic capacitors to form on the printed circuit-board assemblies again.
-
- ✧ Ground each module with solid low-impedance system grounding (cross-section $\geq 4.0 \text{ mm}^2$ ($\geq 0.16 \text{ in}^2$), grounding area $\geq \text{M4}$).

Connecting Devices

- ✧ Connect all cables and leads. Use the connection diagrams in the Hardware and Device manuals.
- ✧ Tighten the terminal screws to the prescribed torques.

3.2.4 Tightening Torques of Fastening Screws

Tightening Torques for Terminal Screws

Type of Line	Current Terminal	Voltage Terminal with Spring-Loaded Terminals	Voltage Terminal with Screw Connection
Litz wire with ring-type lug	2.7 Nm	No ring-type lug	No ring-type lug
Stranded wires with bootlace ferrules or pin-type lugs	2.7 Nm	1.0 Nm	0.6 Nm
Solid conductor, bare (2 mm ²)	2.0 Nm	1.0 Nm	–



NOTE

Make sure that the cables and lines of extra-low voltage circuits are laid sufficiently far away from power network circuits.


Torques for Other Screw Types

Screw Type	Torque
M4 x 20	1.2 Nm
M4 x 8	1.2 Nm
M2.5 x 6	0.39 Nm
Countersunk screw, M2.5 x 6	0.39 Nm
Countersunk screw, M2.5 x 8	0.39 Nm
Collar screw, M4 x 20	0.7 Nm

3.3 Surface-Mounted Devices with Detached On-Site Operation Panel


Drilling Patterns and Dimension Specifications of the On-Site Operation Panels

You can find more information on the drilling patterns for the devices in section [Drilling Patterns and Dimension Specifications \(Modular Device\) , Page 50.](#)

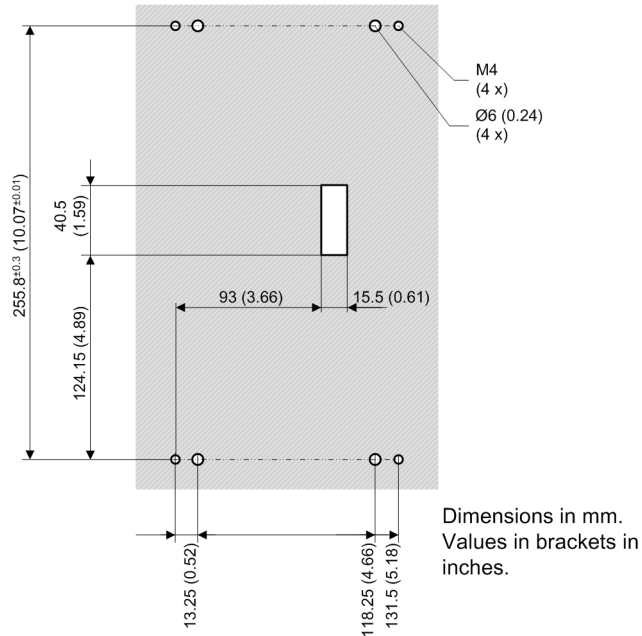


[dw_z1_osop_1-3, 1, en_US]

Figure 3-27 Drilling Pattern of the On-Site Operation Panel of the 1/3 Device

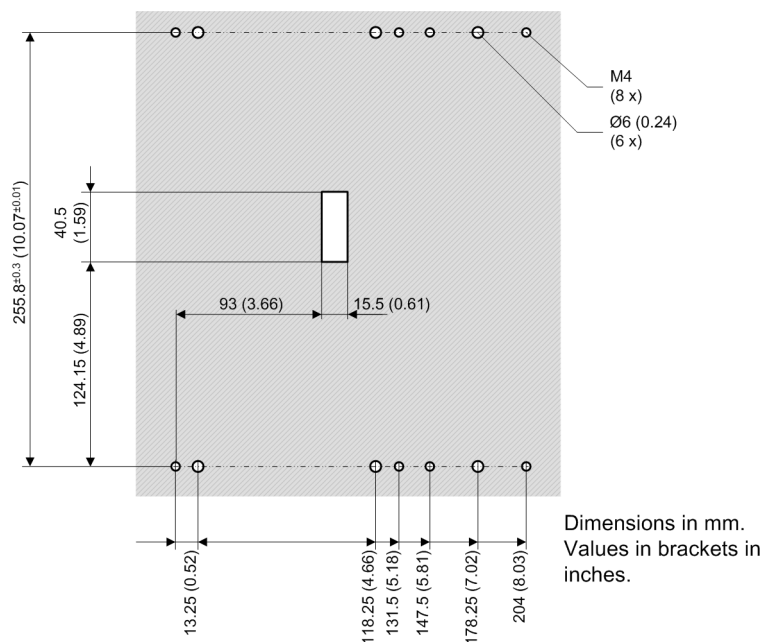


[dw_z1_osop_1-2, 1, en_US]

Figure 3-28 Drilling Pattern of the On-Site Operation Panel of the 1/2 Device

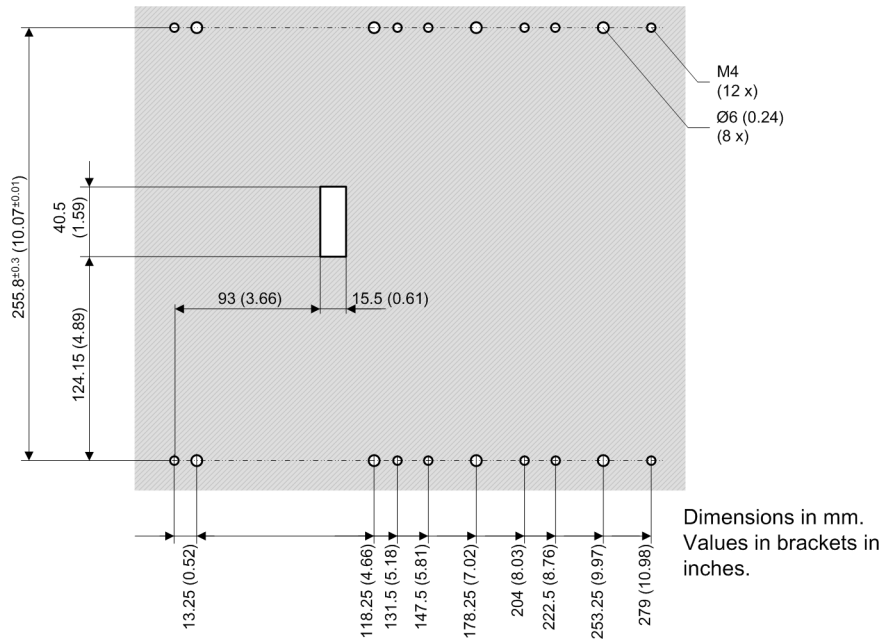


[dw_z1_osop_2-3, 1, en_US]

Figure 3-29 Drilling Pattern of the On-Site Operation Panel of the 2/3 Device

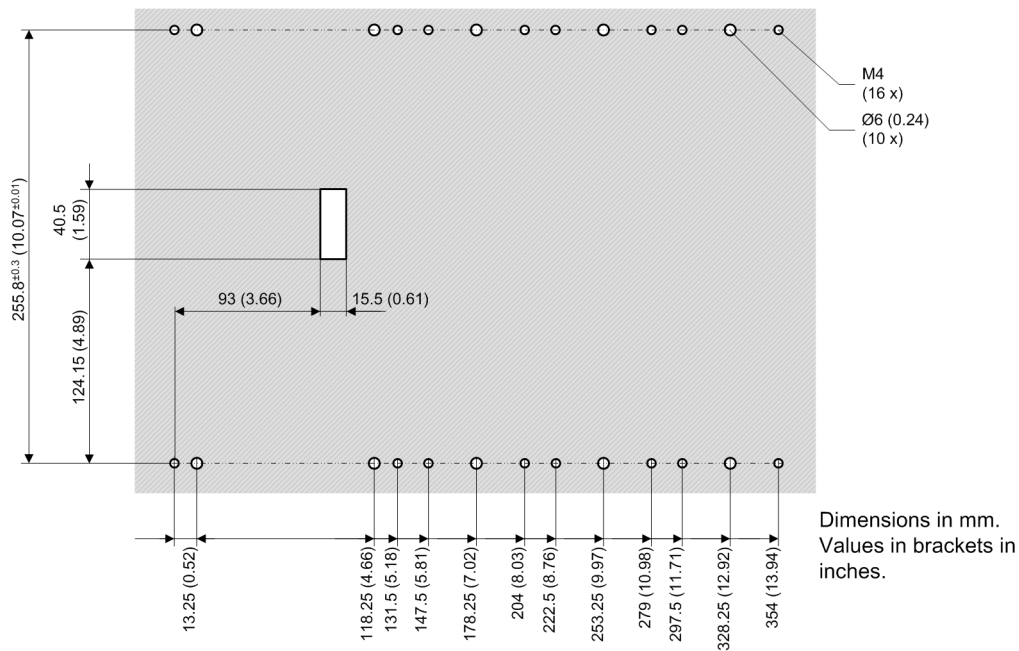


[dw_z1_osop_5-6, 1, en_US]

Figure 3-30 Drilling Pattern of the On-Site Operation Panel of the 5/6 Device

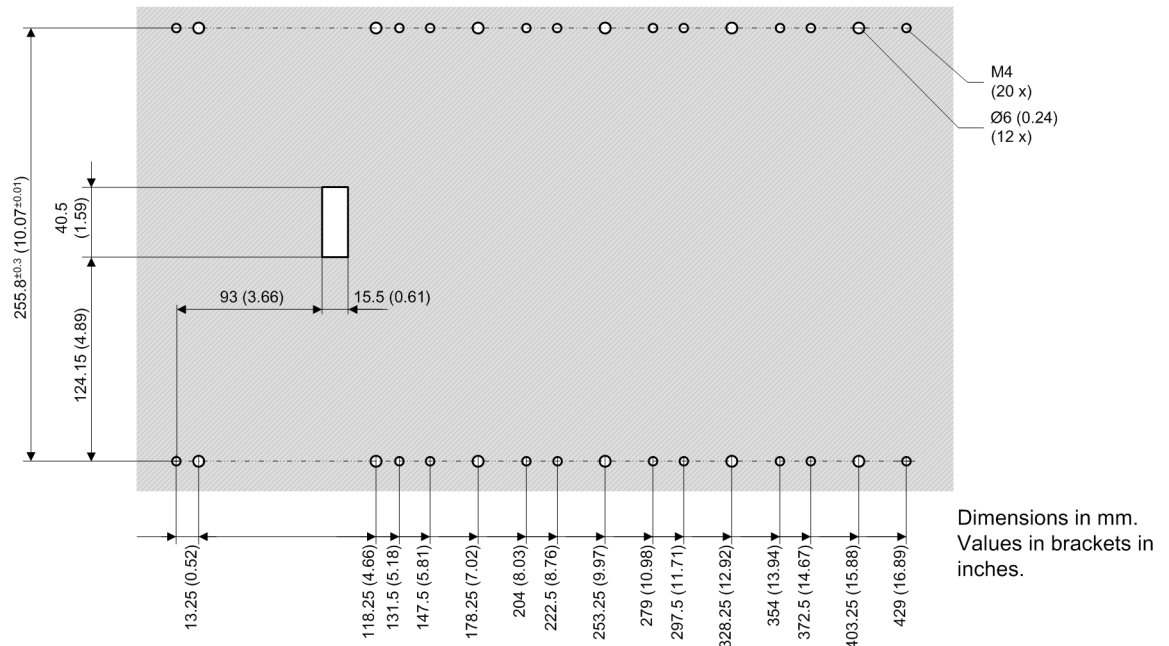

[dw_z1_osop_1-1, 1, en_US]

Figure 3-31 Drilling Pattern of the On-Site Operation Panel of the 1/1 Device

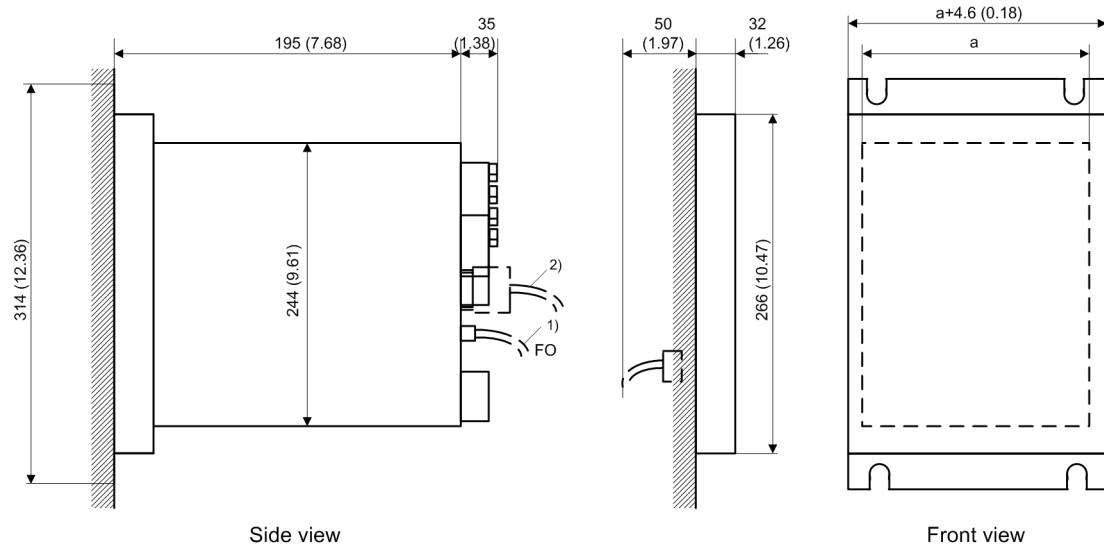**Attention!**

1) For FO cables, a minimum bending radius $R = 50$ mm (1.97 inch) must be considered according to the type.

2) For D-sub connector plugs, the axial length of the plug + cable bending radius must be considered.
Minimum bending radius $R = 50$ mm (1.97 inch)

[dwosopab-070211-01.tif, 3, en_US]

Figure 3-32 Surface-Mounted Device with Detached On-Site Operation Panel, Dimensions in the Side and Front Views


Refer to [Table 3-2](#) for the variable dimension a.

The drilling patterns correspond to the figures [Figure 3-15](#) to [Figure 3-24](#).

The cable length for the detached operation panel is up to 5 m (196.85 in).

**NOTE**

Cables with a length of 5 m (196.85 in) are only specified for PCs and laptop computers with a USB2 connection. These cables are not specified for PCs and laptop computers with a USB3 connection. Cables with a length of 2.5 m (98.43 in) are specified for USB2 and USB3 connections.

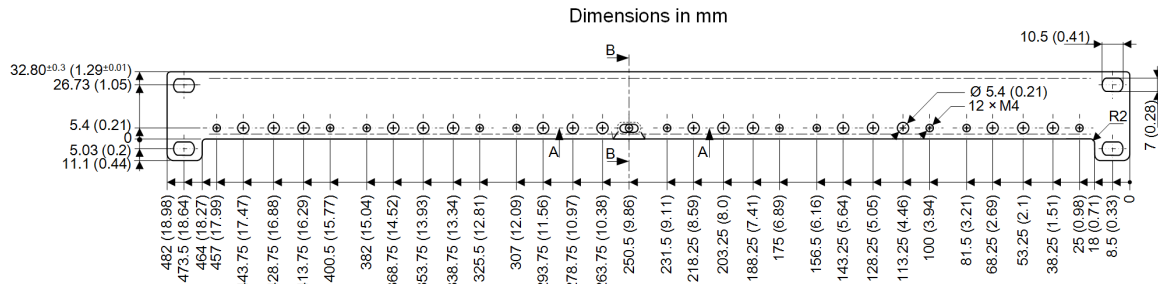

[dw_angel-bracket_without_relief-cutouts, 1, en_US]

Figure 3-33 Angle Rail with Assembly Dimensions

3.3.1 Fitting the Devices

Preparations

**NOTE**

You must mount the devices vertically.

**NOTE**

The distance between the installation location of the device and that of the on-site operation panel must not exceed 5 m.

Join the on-site operation panels to one another with firm contact. Siemens recommends the use of contact washers on painted metal mounting walls. If the mounting wall is not metallic, place a metal layer, for example a sheet metal panel between the mounting wall and the on-site operation panel; then connect this sheet to system ground.

**NOTE**

Use a PZ2-size Phillips screwdriver.

For each base module you need 4 fastening screws with a shank diameter of 6 mm. For each on-site operation panel you need 4 M4 fastening screws, minimum screw length M4x8 plus contact washer thickness.

For each on-site operation panel you also need 2 contact washers, manufacturer Böllhoff.

**DANGER**

Danger due to device being improperly screw-fastened

Incomplete and careless screw fitting results in death, severe injury, or considerable material damage!

- ✧ Ensure that screw-fastening is complete at all intended bolting points. Tighten the screws to a torque of 1.2 Nm.

- ✧ Produce the holes in the mounting wall to fit the device. The drill holes must be so large that they can accept a screw with a shank diameter of 6 mm.
- ✧ Produce the holes in the mounting wall to fit the on-site operation panel.
- ✧ Cut a recess into the mounting wall for the connecting cable. The connecting cable links the on-site operation panels to the device.
- ✧ Place a metallic layer such as a sheet metal panel on the mounting wall if it is not metallic.

Fitting the Device

- ✧ First bolt the bottom fastening screws into the mounting wall.
- ✧ Hook the bottom mounting bracket onto the bottom fastening screws.
- ✧ Align the device in the oblong holes.
- ✧ Screw the device onto the top mounting bracket with the fastening screws.
- ✧ Check for secure attachment of the device on the mounting wall.

Installing On-Site Operation Panels



NOTE

Join several on-site operation panels to one another with firm contact. Siemens recommends the use of contact washers on painted metal mounting walls. If the mounting wall is not metallic, place a metal layer, for example a sheet metal panel, between the mounting wall and the on-site operation panel; then connect this sheet to system ground.

- ✧ Plug the connecting cable into the on-site operation panel of the base module.
- ✧ Guide the connecting cable through the cut-out in the mounting wall.
- ✧ Place the 2 contact washers on the top fastening holes.
- ✧ Bolt down the on-site operation panels connected to one another on the mounting wall.
- ✧ Check for secure attachment of the on-site operation panels on the mounting wall.

3.3.2 Activating the Battery

Removing the Protective Film



NOTE

The battery is covered with a protective film to protect it from mechanical damage and against premature discharge.

The battery need not be removed from the battery compartment for activation.

- ✧ Pull out the battery compartment.
- ✧ Remove the protective film from the battery by simply pulling on the film tab.
- ✧ Push the battery compartment back in again.

3.3.3 Grounding and Connecting Devices

Grounding Devices



DANGER

Danger due to device being improperly grounded

Incomplete and careless grounding leads to death, severe injury, and considerable material damage!

- ✧ The device must be situated in the operating area for at least 2 hours before you connect it to the power supply for the first time. This method prevents condensation of water in the device.
 - ✧ If the device has been in storage for more than 2 years, connect it to an auxiliary voltage for 1 to 2 days. This will cause the electrolytic capacitors to form on the printed circuit board assemblies again.
-
- ✧ Ground each module with solid low-impedance system grounding (cross-section $\geq 4.0 \text{ mm}^2$ ($\geq 0.16 \text{ in}^2$), grounding area $\geq \text{M4}$).
 - ✧ Ground the detached operation panel with a solid low-impedance system grounding (cross-section $\geq 2.5 \text{ mm}^2$ ($\geq 0.1 \text{ in}^2$)).

Connecting Devices

- ✧ Connect all cables and leads. Use the connection diagrams in the Hardware Manual and Device Manual.
- ✧ Tighten the terminal screws to the prescribed torques.

3.3.4 Tightening Torques of Fastening Screws

Tightening Torques for Terminal Screws

Type of Line	Current Terminal	Voltage Terminal with Spring-Loaded Terminals	Voltage Terminal with Screw Connection
Litz wire with ring-type lug	2.7 Nm	No ring-type lug	No ring-type lug
Stranded wires with bootlace ferrules or pin-type lugs	2.7 Nm	1.0 Nm	0.6 Nm
Solid conductor, bare (2 mm^2)	2.0 Nm	1.0 Nm	–



NOTE

Make sure that the cables and lines of extra-low voltage circuits are laid sufficiently far away from power network circuits.

Torques for Other Screw Types

Screw Type	Torque
M4 x 20	1.2 Nm
M4 x 8	1.2 Nm
M2.5 x 6	0.39 Nm
Countersunk screw, M2.5 x 6	0.39 Nm
Countersunk screw, M2.5 x 8	0.39 Nm
Collar screw, M4 x 20	0.7 Nm


4 Handling of Plug-In Modules

4.1	Installation, Removal, Replacement	68
-----	------------------------------------	----

4.1 Installation, Removal, Replacement

4.1.1 Fasteners

The fasteners of the plug-in modules are shown in the following figure regarding the example of an installed module and an empty, covered slot.

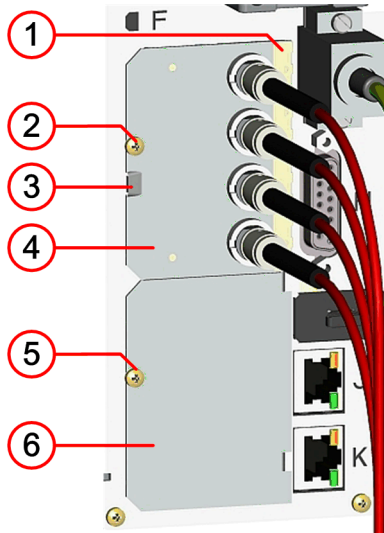

[le_fixing_elements, 1, --, --]

Figure 4-1 Fasteners

- (1) EMC spring contact
- (2) Fastening screw
- (3) Cut-out for prying out the modules
- (4) Plug-in module
- (5) Fastening screw
- (6) Cover plate

4.1.2 Installation



NOTE

Reordered modules are not contained in the original device configuration. Use DIGSI to perform the corresponding extension in the **Hardware and Protocols** Editor.

Preparing Installation



DANGER

Danger due to live voltage when installing the plug-in modules.

Noncompliance with the safety notes will result in death or severe injuries.

- ✧ Install plug-in modules on the electrically deactivated device only.
-



CAUTION

Exercise caution with laser beams of the optical plug-in modules.

Noncompliance with the safety notes can result in medium-severe or slight injuries.

- ✧ Do not look directly into the optical fiber terminals of the active optical plug-in modules, not even with optical devices. The laser beams can damage the eyes.

- ✧ De-energize the device.



NOTE

When using optical communication modules, Laser class 1 is maintained in compliance with EN 60825-1 and EN 60825-2 when using optical fibers $\leq 62.5 \mu\text{m}/125 \mu\text{m}$.

When using the ARC-CD-3FO module, Laser class 1 is maintained in compliance with EN 60825-1 and EN 60825-2 when using 1 mm plastic optical fibers.

- ✧ In the case of a surface-mounted device with integrated on-site operation panel, remove the entire on-site operation panel.
- ✧ Undo the fastening screw and remove the cover plate from the plug-in module position.

Installing the Plug-In Module

- ✧ Push in the plug-in module on the inner guide as far as it will go.
- ✧ Ensure that the EMC contact spring is seated correctly.
- ✧ Bolt down the plug-in module on the assembly frame to a torque of 0.4 Nm.
- ✧ Connect the lines to the terminals.
- ✧ Then check for secure attachment of the plugs.
- ✧ If necessary, fit the on-site operation panel again.

Completing Installation

- ✧ Resume operation of the device.

4.1.3 Removing

Accessories



NOTE

Seal an unused plug-in module position with a cover plate.

- ✧ Order the **module cover plate** set of parts to cover the unused plug-in module position.

Preparing Removal



DANGER

Risk of live voltage when removing the plug-in modules.

Noncompliance with the safety notes will result death or severe injuries.

- ✧ Remove plug-in modules on the electrically deactivated device only.
-



CAUTION

Exercise caution with laser beams of the optical plug-in modules.

Noncompliance with the safety notes can result in medium-severe or slight injuries.

- ✧ Do not look directly into the optical fiber terminals of the active optical plug-in modules, not even with optical devices. The laser beams can damage the eyes.
-

- ✧ De-energize the device.
-



NOTE

Laser class 1 is adhered to in compliance with EN 60825-1 and EN 60825-2, in the case of $\leq 62.5 \mu\text{m}/125 \mu\text{m}$ optical fibers.

- ✧ In the case of a surface mounting device with integrated on-site operation panel, remove the on-site operation panel before the base module.
-

Removing the Plug-In Module

- ✧ Remove all connecting lines.
- ✧ Undo the fastening screw with which the plug-in module is fixed on the device.
- ✧ Insert a screwdriver (DIN 4 x 0.8) in the cut-out underneath the oblong hole.
- ✧ Carefully pull out the plug-in module.

Fastening the Cover Plate

- ✧ Fasten the cover plate with the fixing screw to a torque of 0.4 Nm. The fixing screw is included in the set of parts.

Completing Removal

- ✧ In the case of a surface mounting device with integrated local operation panel, fit the on-site operation panel of the base module again.
- ✧ Resume operation of the device.

4.1.4 Replacement

Preparing for Replacement



DANGER

Danger due to live voltage when replacing the plug-in modules.

Noncompliance with the safety notes will result in death or severe injuries.

- ✧ Install plug-in modules on the electrically deactivated device only.



CAUTION

Exercise caution with laser beams of the optical plug-in modules.

Noncompliance with the safety notes can result in medium-severe or slight injuries.

- ✧ Do not look directly into the optical fiber terminals of the active optical plug-in modules, not even with optical devices. The laser beams can damage the eyes.
- ✧ De-energize the device.



NOTE

Laser class 1 is adhered to in compliance with EN 60825-1 and EN 60825-2, in the case of $\leq 62.5 \mu\text{m}/125 \mu\text{m}$ optical fibers.

When using the ARC-CD-3FO module, Laser class 1 is maintained in compliance with EN 60825-1 and EN 60825-2 when using 1-mm plastic optical fibers.

- ✧ In the case of a surface-mounted device with integrated on-site operation panel, remove the on-site operation panel before the base module.
- ✧ Remove all communication lines.
- ✧ Undo the fastening screw with which the plug-in module is fixed on the device.
- ✧ Insert a screwdriver (DIN 4 x 0.8) in the cut-out underneath the elongated hole in the assembly frame and disengage the plug-in module.
- ✧ Carefully pull out the plug-in module.

Fastening the Plug-In Module

- ✧ Push in the new plug-in module on the inner guide of the plug-in module position until it moves no further.
- ✧ Bolt down the plug-in module on the assembly frame to a torque of 0.4 Nm.
- ✧ Connect the lines to the terminals.
- ✧ Then check for secure attachment of the connectors.
- ✧ If necessary, fit the on-site operation panel again.

Completing Replacement

- ✧ Place the device in service again and perform a firmware update of the communication modules.



NOTE

If you have not cabled the optical fiber plug-in modules, then seal the terminals with protective covers. This prevents soiling of the terminals.

5 Using On-Site Operation Panel


5.1	General	74
5.2	Overview of Operator Elements and Display Elements	75
5.3	Displays for Indication and Control	83
5.4	Structure of the Menu	85
5.5	Menu Tree	86
5.6	Notification Windows and Dialogs	88
5.7	Displaying Device Mode	90
5.8	Display of Routings and Status	92

5.1 General

All SIPROTEC 5 devices can be operated via the DIGSI 5 interface of your PC and via the on-site operation panel. This is available optionally as an integrated and detached on-site operation panel. The on-site operation panel is characterized by a flat, compact design.

Variants

The on-site operation panel is composed of different modules depending on the hardware configuration of the device. Operation is via the membrane keypad and the key switches. LEDs and displays in 2 different sizes are available as elements of the display.

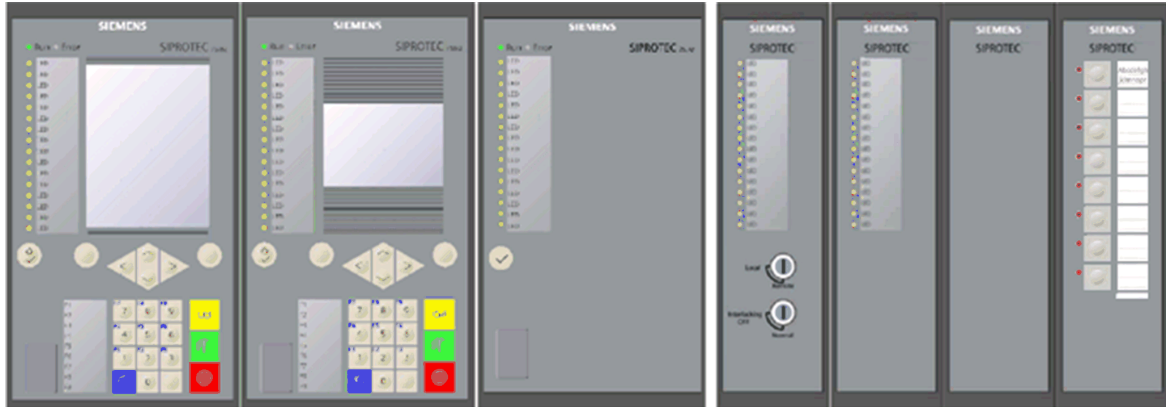

[dwosopva-040211-01.tif, 2, en_US]

Figure 5-1 Variants


Operating Concept

The operating concept allows you to do the following on-site operator control actions:

- Navigation in the menu tree
- Modification of settings
- Resetting saved information
- Showing default and control displays, measured values and logs
- Executing switching operations
- Initiating configured actions via function keys
- Executing test and diagnostic functions
- Status display with LED

5.2 Overview of Operator Elements and Display Elements

On-Site Operation Panel of the Base and 1/3 Module

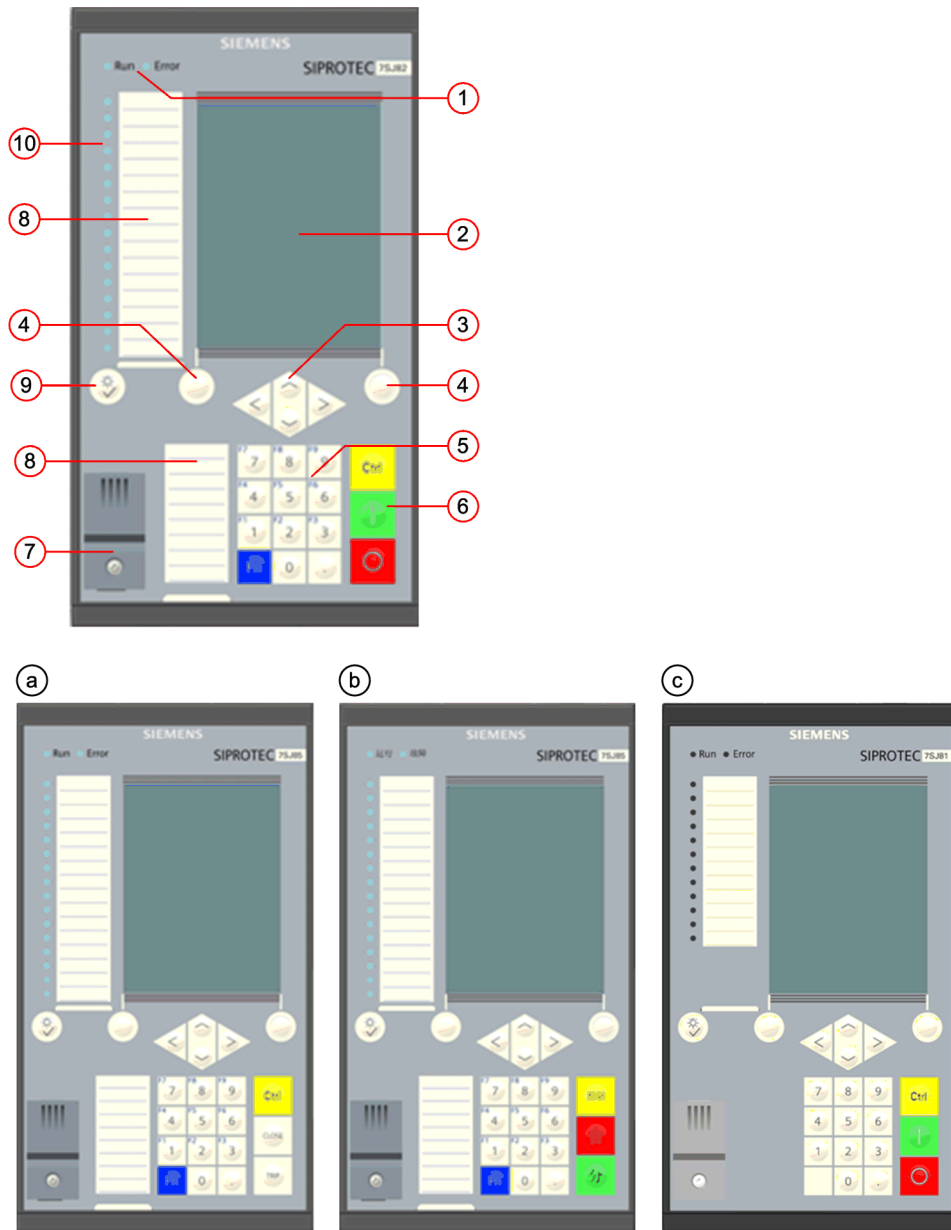

[le_base_module, 3, --]

Figure 5-2 Base 1/3 Module in Standard Design, US Design (a), China Design (b), and for 7xx81 (c)


- (1) Operating state display
- (2) Display in 2 design versions
- (3) Keypad with navigation keys
- (4) Softkey
- (5) Keypad with numerical keys and shiftable function keys
- (6) Keypad of control keys
- (7) USB port cover
- (8) Labeling strips



- (9) Reset and LED test key
 (10) 16 2-colored LEDs


The following table gives you a detailed explanation of the function of the operator and display elements.



Table 5-1 Overview of Operator Elements and Display Elements

Operator Element/Display Element	Function
	Display Small display Resolution: 192 x 128 pixels Display: Alphanumeric characters Large graphical display Resolution: 240 x 320 pixels Display: Alphanumeric characters as well as graphical display of default and control displays
	Display of operability Green LED (Run) The device is switched on. The presence of the external auxiliary voltage is indicated to you. Red LED (Error) The device is not ready to run or a failure is present. The life contact is open. After successful start of the device, the LED goes out, indicating to you that the device is ready for operation.

Operator Element/Display Element	Function
	Navigation keys By pressing or holding down the navigation keys, you can navigate in the menus, lists and the graphical images (default display, control display). Menus and lists (press key): • Top – Display entry above • Bottom – Display entry below • Right – Display level below • Left – Display level above Menus and lists (hold key): • Top – Move forward by one display length • Bottom – Backward by a display length • Right – Display level below • Left – Back to the default display Control displays (press/hold key): Control displays are available only on the large display. Navigation between pages and switching objects is done according to the sequences defined in the DIGSI 5 display Editor. • Top – To the previous switching object • Bottom – To the next switching object • Right – To the next page • Left – To the previous page Default displays (press/hold key): Navigation between the default displays (pages) is done according to the sequences defined in the DIGSI 5 display Editor. • Right – To the next page

Operator Element/Display Element	Function
	• Left – To the previous page (sequence as laid down in DIGSI 5)
	Navigational aid The footer of the display shows you the authorized navigation directions depending on current display level.
	Selection dialogs: In selection dialogs, you are offered selection options one below the other. Example parameter Mode (<i>off/on/test</i>). • Top – Select top entry Automatic line break from the first to the last entry • Bottom – Select bottom entry Automatic line break from the last to the first entry
	Numerical input dialog: In a numeric command prompt (for example, confirmation ID), the cursor appears right-aligned. • Left – Backspace key which puts the cursor back by one position. You must reenter all skipped places by using the numeric keys.
	Contrast setting: The contrast is adjusted using the navigation keys only. • Left and right simultaneously – Jump to the Contrast menu • Right – More contrast • Left – Less contrast • Top and bottom simultaneously – Restoring factory setting
	Softkeys The softkeys are located on the left and right below the display. They are used to confirm command prompts in the display. Context-sensitive actions can always be triggered with the softkeys. 

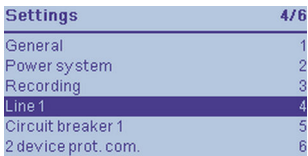
Operator Element/Display Element	Function
	Numerical keys and convertible function keys This keypad is used for the input of numeric values (with or without decimal point). You can activate actions of function keys using these keys. The keys <1> to <9> are double assigned for number entry and the functionality of function keys. To activate the function keys, press the <Fn> key (<F1> to <F9> in blue font). Numerical keys These keys are used to input values and navigate in menus. According to the numbering on the right display edge, you can jump directly into submenus or carry out settings.  Function Keys <F1> to <F9> You can perform configured actions with DIGSI 5 using the function keys. For standard actions (for example, reading of the operational log on site), this means a simplification. The following configurations for the function keys are possible: • Jump to a specific menu • Jump to a specific log • Activation of a binary input indication (for example, start fault record, test binary inputs) • An adjustable function key mode is offered by the Toggle (edge-triggered activation and termination) and Pulse (with activation time) modes and the on and off mode. Note on the Toggle function key mode: The default setting of the value of information in startup is off, each key press switches between the states on and off. When routing to switching objects (information type SPC or DPC), the current switch position is not taken into account. This means that a toggle command is not executed if the switching object is already in this switch position. • <F9> cannot be configured and is always assigned to switching between languages Activating function keys: There are several methods available to you to activate function keys • <Fn> + NUM LOCK key (simultaneously) Example: <F1> = <Fn> key + <1> key • <Fn> key alone → jump to the function key menu, selection of function key via navigation keys and confirmation with OK or directly by numeric input

Operator Element/Display Element	Function
	Function keys menu The configured assignment of function keys is visible in the function key menu. The assignment of function keys <F1> to <F8> is defined in DIGSI 5. They have different defaults depending on the application template. A default assignment exists for: • <F9> Language change: Jump to the selection menu for languages <F9> cannot be configured via DIGSI 5
	Control key for activating standard control display If no control display is available (not configured or device with small display), you are taken directly to the standard default display. If it has not already been selected, and depending on device configuration, pressing the <CTRL> key jumps directly to: • Large Display → Default display • Large display/at least one control display → Standardcontrol display • Small Display → Default display
	Control key for switching on a selected switching object Select the switching object either in the Control menu or in the control display (only in devices with large display).
	Control key for switching off a selected switching object Select the switching object either in the Control menu or in the control display (only in devices with large display).
	USB ports There are 2 USB ports with a plastic cover available to you: • Top USB port (host) Connection for a DIGSI PC • Bottom USB port Reserved for the future applications
	16 parameterizable LEDs • Dual-colored configurable (red and green)
	Key for resetting saved displays and contacts With this key, you can reset stored information that is configured on the LEDs, on the display or on output contacts. The initial state is then restored. When the key is pressed, all LEDs are activated simultaneously, allowing you to test the LEDs.

**NOTE**

Note that terminating the contacts of saved output indications can lead to reactions in the device environment.

On-Site Operation Panel of the Base Modules

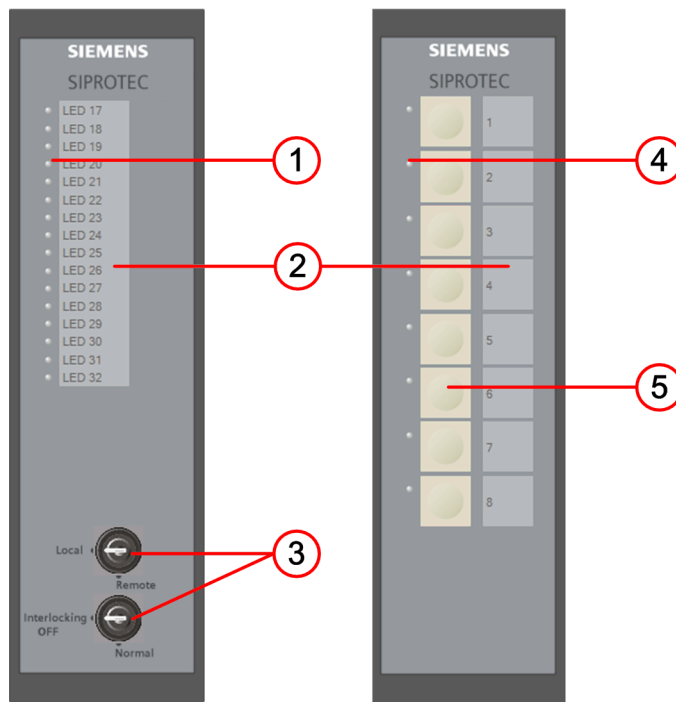


[dwerwmod-040211-01.tif, 2, --, --]

Figure 5-3 Expansion Module

- (1) 16 monochrome LEDs
- (2) Labeling strips
- (3) 2 key switches
- (4) 8 monochrome LEDs
- (5) 8 push-buttons

The following table gives you a detailed explanation of the function of the operator and display elements.

Operator Element/Display Element	Meaning
	16 parameterizable LEDs Monochrome (red)
	8 parameterizable LEDs - Monochrome (red) Keypad - Keypad with programmable function keys to perform actions quickly. Next to the keypad, there are labeling strips for user-defined labels.

Besides the base module, you can fit an expansion module with key switches. The following table explains the meanings of the switch positions.

Operator Element/Display Element	Meaning
	Key switch for on-site switching authority Local position Switching commands for configured equipment are possible only on site with the control keys or in the control menu. You cannot execute switching commands remotely (or from DIGSI). Remote position Switching commands for configured equipment are possible on site as well as remotely. In devices with an expansion module with key switches the corresponding options are static in the control menu.
	Key switch for on-site switching mode OFF position Unlocked switching of configured equipment allowed Normal position Switching of configured equipment only with the designed interlocking conditions In devices with an expansion module with key switches the corresponding options are static in the control menu.

5.3 Displays for Indication and Control

Displays

Displays for indication and control offer you the possibility of quickly obtaining an overview of important operating modes. You can configure a total of up to 10 displays in DIGSI 5 using the display editor. The following contents are available here:

- Dynamically updated measured values
- Status of indications
- Switch positions of switching objects
- Texts
- Graphical elements



NOTE

The displays and controls are displays created in DIGSI 5.

Default Displays

In the idle state, that is, provided there is no fault, the display with DIGSI 5 can show configurable operating information (for example, operational measured values). If preconfigured in DIGSI 5, display images can be suppressed by spontaneous displays in the event of a fault.

A device ready for operation will show you the following display image after booting. This presupposes you have not parameterized a display image with DIGSI 5. The standard display image (default display) is parameterized and defined in DIGSI 5. If a parameterized and defined display image exists, it is displayed after booting.



[scligrdi-080413-01.tif, 1, en_US]


Figure 5-4 Standard Display Diagram

You reach the standard display diagram at any time (exception: in case of fault) by holding down the left navigation key.

If several display images are available, you can select them in order of parameterized sequence by pressing the right and the left navigation keys.

Control Displays

In devices with large graphic display, entire control displays can also be graphically depicted. The control displays can graphically and dynamically update the switch position of switching objects. In addition, control displays offer you the possibility of selecting individual switching objects and activating them according to switching authority and switching mode.

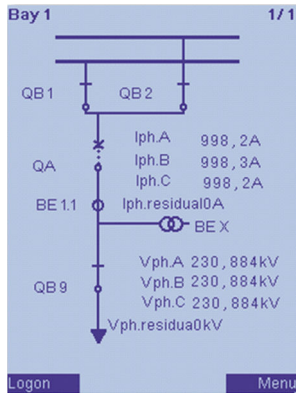

[scabzstb-100211-01.tif, 1, en_US]

Figure 5-5 Control Display

A ready-to-run device with large graphic display shows you the control display defined as the standard after booting. By pressing and holding down the left navigation key, you get to the control display defined as standard. By pressing the control key, you get to the control mode of the currently displayed control display.

**NOTE**

The switching device in control mode is selected by pressing the following navigation keys:


- **Top**
- **Bottom**

You can leave control mode via the softkey **Exit**. If no keys are pressed for 15 minutes, the default display is automatically activated and control mode is reset.

If there are multiple displays, you can use the left and right navigation buttons to toggle between the displays. If the device was previously in control mode by pressing the CTRL key, this mode is maintained so that you can also activate a 2nd and another control display. Control mode is reset after a switching procedure or after a period of 15 minutes without a switching operation.

For this see the description of the navigation keys in [Table 5-1](#).

5.4 Structure of the Menu

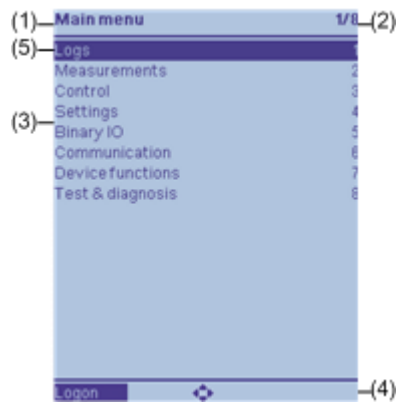

[scmnuebr-030914-01, 2, en_US]

Figure 5-6 Example Main Menu

- (1) Title bar with name of menu
- (2) Position display and total number of available menu items
- (3) List of menu items with numbering on the right edge (shortcut)
- (4) Base bar with the display of permissible navigation directions and assignment of softkeys
- (5) The current position in the menu is marked with brighter font on a dark background.

5.5 Menu Tree

The menu tree consists of the main menu and several levels of submenus. To navigate in the menu use the keys on the operation panel of the base module.

Main Menu

Main menu	1/8	The main menu structure is firmly set and is not changeable. The submenus depend on the hardware configuration and the configuration of functions.
Logs	1	
Measurements	2	
Control	3	
Settings	4	
Binary IO	5	
Communication	6	
Device functions	7	
Test & diagnosis	8	

Logs Menu

Logs	1/6	In the Logs menu, the available logs recording events in the operating state of the device are offered. You will find information about reading and deleting logs in chapter 8.4.1 General .
Operational log	1	
Fault log	2	
Ground fault log	3	
Setting-history log	4	
User log 1	5	
User log 2	6	

Measurements Menu

Measurements	1/4	In the Measurements menu, you can display various measured values. Assignment to existing function groups (for example, line 1) is done in the corresponding submenus.
Line 1	3	
Circuit breaker 1	4	
Analog units	5	
2 device prot. com.	6	

Control Menu



NOTE

The **Switching mode** and **Switching authority** submenus are not offered if the device has key switches to the on-site control.

Control	1/4	The Control menu offers all mechanisms for on-site control. Access to individual equipment (for example, circuit breakers) and the settings with respect to interlocking mechanisms, switching authority and switching mode is via submenus. You will find information about controlling equipment and resetting saved binary outputs and LEDs in chapter 8.4.1 General .
Equipment	1	
Interlocking	3	
Switching authority	4	
Switching mode	5	

Settings Menu

The **Settings** menu is used for changing and adapting protection settings in the device. The menu follows a usability (for example, request for acceptance after leaving certain menu levels).



NOTE

All visible settings are assigned to a certain adjustable settings group. You can view the number of settings groups and set the activation of one of the settings groups in the **General** submenu.

Settings	1/7	The settings are grouped in corresponding submenus according to their assignment to existing function groups (for example, line 1). You will find information about viewing and changing settings in chapter 8.4.1 General.
General	1	
Power system	2	
Recording	3	
Line 1	4	
Circuit breaker 1	5	
Analog units	6	
2 device prot. com.	7	

Binary I/O Menu

Binary I/O	1/3	Selecting the Binary I/O menu provides you with the option to see the routing to the binary inputs, binary outputs and signals displayed. You can find more information in chapter 5.8 Display of Routings and Status.
Binary inputs	1	
Binary outputs	2	
LEDs	3	

Communication Menu

The **Communication** menu is used for changing and adapting communication settings for the mainboard and the communication modules in the device. The menu follows a usability (for example, request for acceptance after leaving certain menu levels).



NOTE

Enter settings for communication modules only through DIGSI 5.

Communication	2/2	The Communication menu notifies you about the status of configured communication modules (module type, slot, port and IP address). Furthermore, you can, for example, also change the IP address of your device.
J:Onboard Ethernet	1	
E:USART-AE-2FO	2	

Device Functions Menu

Device functions	5/6	Via the Device functions menu, you can set the operating modes of the device or of individual functions (for example, test), initiate resetting of stored LEDs and binary outputs, change passwords and make regional settings (date and time, display formats).
Operation modes	1	
Reset functions	2	
Security	3	
Date & Time	4	
Localization	5	
Line 1	7	


Test & Diagnosis Menu

Test & diagnosis	1/6	The Test & Diagnosis menu offers you support during commissioning and testing. If you wish to test systems and equipment on site, you can read all necessary information from the corresponding submenus and start actions such as device reset. You can find more information on this in chapter 10.5 Test and Diagnostics.
Device information	1	
HW/SW information	2	
Logs	3	
Actions	4	
Commissioning aid	5	
IP-Configuration	6	

5.6 Notification Windows and Dialogs

Notification Windows

The notification windows appear briefly in the base bar to give you important information during on-site operation and close automatically. For example, they contain the following information:



[scmitfen-080413-01.tif, 1, en_US]

Figure 5-7 Examples of Notification Windows

Dialogs

Dialogs are interactive notification windows in the base bar. In the dialogs, you are prompted to actively carry out actions. A dialog consists of the following elements:

- Dialog designation
- 2 softkeys (bottom left and right)
- Text information with interactive text box or list boxes

You confirm the context-dependent command prompts offered here by pressing the softkeys below the prompts.



[scdialpa-080413-01.tif, 1, en_US]

Figure 5-8 Dialog for Entering the Confirmation ID



[scdiawrt-080413-01.tif, 1, en_US]

Figure 5-9 Dialog for Entering a Value

If a command prompt is shown in the dialog, then you can activate the functions in the following list by pressing the softkeys below each function.

Softkey	Function	Softkey	Function
Left		Right	
Delete	Delete log	Enter	Confirm value
ESC	Cancel current action	Ok	Confirm action
Logout	Log out	Login	Log in
Start/Test	Start an action	Menu	Main menu
Switch	Switch equipment	Change	Change value



NOTE

If you do not confirm the dialog with a softkey, the action you wish to achieve is canceled after a previously set time. The prior state is restored.

5.7 Displaying Device Mode

Not Initialized Device (As-Delivered Condition)

SIPROTEC 5 devices are not initialized in the as-delivered condition. If a non-initialized device is connected to the auxiliary voltage and started, then the following information is shown on the display:

- Device variant
- Firmware version
- Serial number
- Prompt **Initialize device**



NOTE

You may only initialize the device via DIGSI 5 and only then via the USB connection of your SIPROTEC 5 device.

See chapter [9 Commissioning](#) for more information on initializing and commissioning.

Initialized Device

The device can be in the following modes:

- Commissioning mode
- Simulation mode
- Process mode
- Fallback mode

In normal operation (process mode), the device is presented as described in chapter [5.4 Structure of the Menu](#)



NOTE

The device can change mode during commissioning, testing or in the event of a device failure. The mode deviating from normal operation is shown respectively in the title bar of the device display. The name of the mode is shown flashing in the top line of the device display (except in fallback and process mode):

- Commissioning mode
- Simulation mode

Take note of the information about these modes in chapter [9 Commissioning](#) and chapter [10 Maintenance, On-the-Spot Assistance and Test](#).

Commissioning Mode

The commissioning mode of the SIPROTEC 5 device allows you to check the existing wiring without affecting or blocking the protection functions or other functions of the device. You can select the commissioning mode manually.

You can find more information in Chapter [9.2.2 Testing Current and Voltage Inputs](#).

In commissioning mode, you can also check the communication with system-control technology. You can generate test signals with the communication test in DIGSI by setting signals to be transmitted systematically in the transmitter and checking their receipt.

You can find more information in chapter [9.4.3 Testing Interfaces in the Compound System](#).

Simulation Mode

In the simulation mode of the device, you can check the correct setting of protection functions and the routing of signals. You can perform simple checks without wiring or using DIGSI. To do so, connect the device

to DIGSI and generate test sequences. You can perform the tests on the device without external test equipment. The DIGSI test sequences simulate the change of values at the inputs to the device.

You can also feed in the test signals using a digital test equipment. Digital test equipment offers you multiple test programs and test sequences.

Process Mode


The process mode is the normal operation of the device.

5.8 Display of Routings and Status

You can route logic information from the SIPROTEC 5 device to binary inputs, binary outputs and LEDs. With the menu item **Binary IO** of the device you can display the routing of the logical signals and their status.

In order to display the routings in the SIPROTEC 5 device, proceed as follows:

- In order to access the **Binary IO** from the main menu, use the navigation keys of the on-site operation panel:
Main menu → **Binary IO**
- Use the navigation keys of the on-site operation panel to navigate within the displayed list and select one of the 3 following menu entries:
 - Binary inputs
 - Binary outputs
 - LEDs

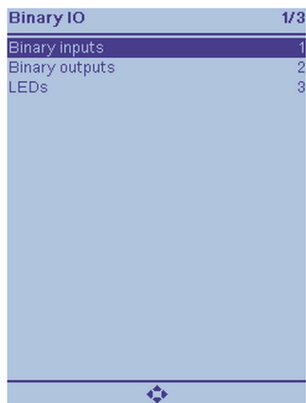

[scbinip4-260814-01, 1, en_US]

Figure 5-10 Binary IO Menu Item

The following examples show how to proceed when reading the on-site operation panel and how to set the DIGSI for the binary input in the information routing.

- Select the menu item **Binary inputs**.
All available binary inputs of the SIPROTEC 5 device will be displayed. Furthermore, following the equal sign, the current status of the binary input is displayed (see [Figure 5-11](#)).

The following table shows the meaning of the status of the individual menu entries **Binary inputs**, **Binary outputs** and **LEDs**.

Menu Item	Status	Description
Binary input	X	Input is active
	–	Input is not active
Binary output	X	Output is active (contact is closed)
	–	Output is not active (contact is open)
LED	X	LED is switched on
	–	LED is switched off

The status of the respective binary inputs, binary outputs or the LEDs is updated automatically by the actual state in the device.

Binary inputs		1/15
Binary input1.1	=	X
Binary input1.2	=	-
Binary input1.3	=	X
Binary input1.4	=	-
Binary input2.1	=	X
Binary input2.2	=	-
Binary input2.3	=	X
Binary input3.1	=	-
Binary input3.2	=	X
Binary input3.3	=	-
Binary input3.4	=	X
Binary input3.5	=	-
Binary input3.6	=	X
Binary input3.7	=	-
Binary input3.8	=	X

[scbinip5-260814-01, 1, en_US]

Figure 5-11 List of Binary Inputs

- Use the navigation keys to select the binary input, for example Binary input1.1.

All signals routed to Binary input1.1 are displayed as a list (see [Figure 5-13](#)).

Example of a Signal

- Go to the information routing in DIGSI 5 and select the properties **H** or **L** for the input *>Ext. trip initiation* off.

This status will also be displayed on the on-site operation panel of the SIPROTEC 5 device. [Figure 5-12](#) and [Figure 5-13](#) shows you the routing of the signal *>Ext. trip initiation*, for stage 1.

Signals	Number	Type	1.1	1.2	1.3	1.4	2.1	2.2	2.3	3.1
(All)	(All)	...	...	...	...	...	...	...	...	...
External trip 1pole 1	21.291		*							
Stage 1	21.291.931		*							
>Block function	21.291.931....	SPS								
>External trip phs ...	21.291.931....	SPS	L							
>External trip phs A	21.291.931....	SPS								
>External trip phs B	21.291.931....	SPS								
>External trip phs C	21.291.931....	SPS								
>External trip ACT	21.291.931....	ACT								
Inactive	21.291.931....	SPS								
Behavior	21.291.931....	ENS								
Health	21.291.931....	ENS								
Pickup	21.291.931....	ACD								
Operate delay exp..	21.291.931....	ACT								
Operate	21.291.931....	ACT								
50/51 OC-3ph 1p 1	21.221									
50N/51N OC-gnd-A1	21.211									
50 high-speed 1pol 1	21.981									
67N GFP gnd.sys.1	21.1111									
59 Overvolt.-3ph 1	21.51		*							
Group indicat.	21.51.4501									
Pickup	21.51.4501....	ACD								
Operate	21.51.4501....	ACT								
Stage 1	21.51.181		*							
>Block stage	21.51.181.81	SPS	H							

Not routed
 H (active with voltage)
L (active without voltage)
 Delete Del
 Rename F2
 Cross-reference information Shift+F11
 Expand all columns
 Expand all rows
 Delete routings Ctrl+Del
 Collapse all columns
 Collapse all rows
 Add new signal

[screnma1-260814-01, 1, en_US]

Figure 5-12 Entry in the Information Routing

Figure 5-13 shows that **[L] active without voltage** for the signal **>Ext. trip initiation** was parameterized. In the **Line** function group, the **Overvoltage protection** (ANSI 59) is also operated. In addition, the Binary input1.1 can also block this protection. The blocking function will become active with **[H] active with voltage**.

Binary input1.1	1/2
Line 1: External trip 1	
Stage 1: >External trip.	
[L] active without voltage	
Line 1: 59 Overvolt.-3ph 1	
Stage 1: >Block stage.	
[H] active with voltage	

[scbinpt1-260814-01, 1, en_US]

Figure 5-13 Status of Binary input1.1

Example of a Circuit Breaker

A circuit breaker can have the status **open** or **closed**. [Figure 5-14](#) displays the various properties of the circuit breaker in the information routing of DIGSI 5.

Circuit breaker 1			*	*		
▶ Trip logic	201.5341					
▼ Circuit break.	201.4261		*	*		
▶ >Ready	201.4261.500	SPS		H		
▶ >Acquisition blocking	201.4261.501	SPS				
▶ >Reset switch statist.	201.4261.502	SPS				
▶ External health	201.4261.503	ENS				
▶ Health	201.4261.53	ENS				
▶ Position	201.4261.58	DPC	CH			
▶ Trip/open cmd.	201.4261.300	SPS				
▶ Close command	201.4261.301	SPS				
▶ Command active	201.4261.302	SPS				
▶ Definitive trip	201.4261.303	SPS				
▶ Alarm suppression	201.4261.304	SPS				
▶ Op.ct.	201.4261.306	INS				
▶ Σ I Brk.	201.4261.307	BCR				
▶ Σ I A Brk.	201.4261.308	BCR				
▶ Σ I B Brk.	201.4261.309	BCR				
▶ Σ I C Brk.	201.4261.310	BCR				
▶ Break.-current phs A	201.4261.311	MV				
▶ Break.-current phs B	201.4261.312	MV				
▶ Break.-current phs C	201.4261.313	MV				
▶ Break. voltage phs A	201.4261.314	MV				
▶ Break. voltage phs B	201.4261.315	MV				

Not routed

CH (closed (active with voltage))

CL (closed (active without voltage))

OH (open (active with voltage))

OL (open (active without voltage))

✕ Delete Del

Rename F2

Cross-reference information Shift+F11

Expand all columns

Expand all rows

Delete routings Ctrl+Del

Collapse all columns

Collapse all rows

Add new signal

[scranma2-260814-01, 1, en US]

Figure 5-14 Properties of the Circuit Breaker

The following figure shows an example of the routing of the circuit-breaker switch position. Here, the Binary input1.1 shows the closed circuit-breaker switch position 1. **[GH]** indicates that the voltage on Binary input1.1 is active and signals a closed circuit breaker.

Binary input1.1	1/1
Circuit breaker 1: Circuit break.:Position. [CH]closed (active with voltage)	

[scbinipt2-260814-01, 1, en_US]

Figure 5-15 Circuit-Breaker Status on the On-Site Operation Panel

Example of a Transformer Tap Changer

You can also use a binary input to display the tap position of the transformer tap changer. In this case, you must set the **X (routed)** property in the DIGSI 5 Information routing (see figure below). **X (routed)** means that the binary input was routed.

▼ Tap changer 1	161		*	*	*	*						
▼ Tap changer	161.5461		*	*	*	*						
>Acquisition blocking	161.5461.500	SPS										
>Enable	161.5461.501	SPS										
▶ Health	161.5461.53	ENS										
▶ End higher pos.reach...	161.5461.301	SPS										
▶ End lower pos.reached	161.5461.302	SPS										
▶ Position	161.5461.308	BSC	X									
▶ Higher command	161.5461.305	SPS										
▶ Lower command	161.5461.306	SPS										
▶ Command active	161.5461.307	SPS										
▶ Motor sup. time expir...	161.5461.309	SPS										
▶ Trigger motor prot. sw.	161.5461.310	SPS										
▶ Position failure	161.5461.311	SPS										
▶ Op.ct.	161.5461.312	INS										
▶ Reset failure	161.5461.319	SPC										
▶ Switching auth. station	161.5461.317	SPC										

Not routed

X (routed)

✕ Delete Del

Rename F2

Cross-reference information Shift+F11

Expand all columns

Expand all rows

Delete routings Ctrl+Del

Collapse all columns

[screnma3-260814-01, 1, en_US]

Figure 5-16 Example for Transformer Tap Changer 1

The figure below shows that Binary input1.1 displays the tap position of the transformer tap changer 1.

Binary input1.1	1/1
Tap changer 1:	
Tap changer:Position.	[X]routed

[scbinipt3-260814-01, 1, en_US]

Figure 5-17 Position of the Transformer Tap Changer 1

6 Using DIGSI 5

6.1	General	98
6.2	Operator Actions in the Offline and Online Area	100
6.3	Initializing a Device	102
6.4	Transferring Device Data from the PC to the Device	103
6.5	Changing Data on the Online Device	105
6.6	Retrieving Fault Records and Log Contents	106

6.1 General


DIGSI 5 is the engineering and operating tool for all SIPROTEC 5 devices. With DIGSI 5, you create system topologies, configure hardware and communication networks and perform many other tasks.

You carry out all engineering tasks offline from your PC without needing a SIPROTEC 5 device. You transfer all data online to the device later – for example, directly via a communication network or the USB interface. For communication between DIGSI 5 and the SIPROTEC 5 device, secure TCP-IP connections are used.

Operation of DIGSI in version 5 is even more user-friendly. Project tree, editors, libraries and property window are integrated smoothly into a common interface. You can adjust this interface to your operation.

Project, Project View and Project Navigation

After starting DIGSI 5; you are shown the project view. It is initially empty and fills up with content as soon as you create a new project or open an existing one.

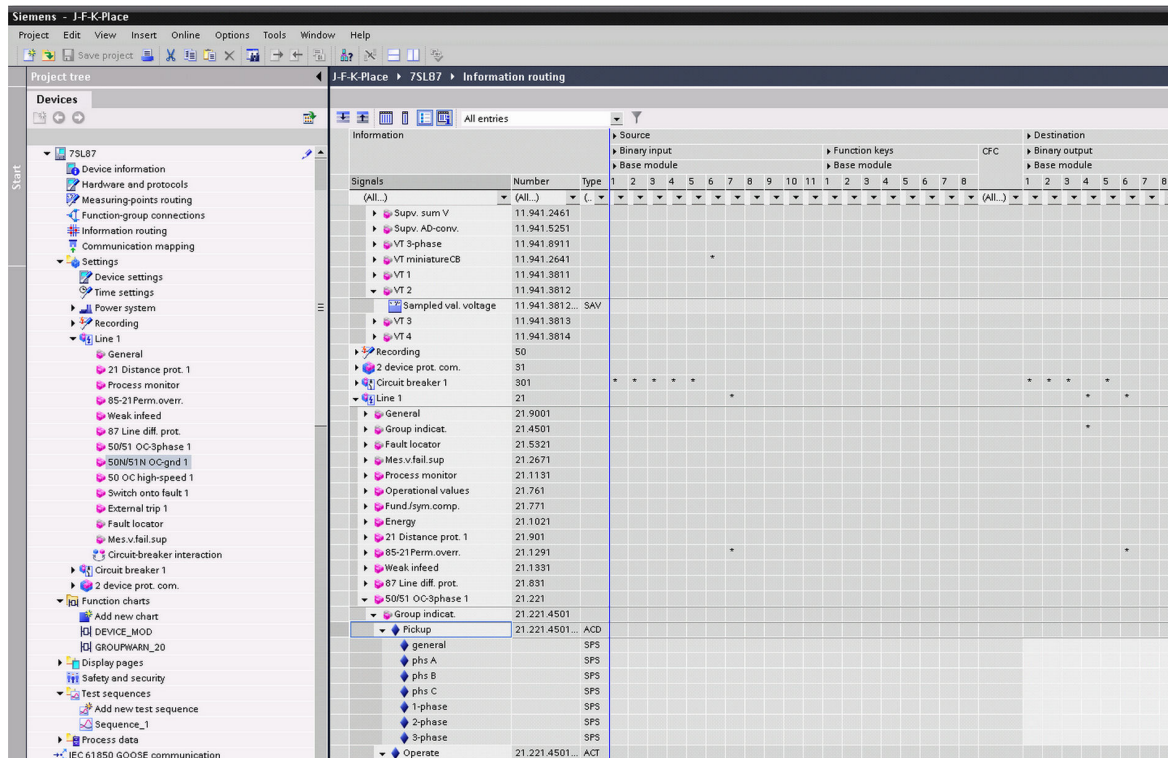

[scproans-110413-01.tif, 1, en_US]

Figure 6-1 Example of a Project View

DIGSI 5 manages all components of a system and all associated data depending on the project. The following values are summarized under one project name (extract):

- Topology
- Devices
- Setting values
- Communication settings
- Process data

That means you must open a project file and thus have all data available. Vice versa you save all changes of any type with only one mouse click.

On the interface you see a project with symbols that are integrated into a hierarchical project structure. These symbols represent:

- Individual devices
- Editors
- Setting sheets
- Tables
- Actions
- Folder

You have access to all data and tools via the individual symbols. A double-click is enough and the symbols will show setting values of protection functions, start actions such as loading of parameter values or open one of the editors.

DIGSI 5 is available in 3 variants. Please refer to the order catalog and the DIGSI 5 online help for the exact functional scope. DIGSI 5 Premium offers, among others, the following possibilities:

- Managing all SIPROTEC 5 devices of a system in a project
- Defining the primary topology in a Single-Line Editor
- Simple setting of protection settings and control of setting values via zone diagrams
- Creation and testing of logic symbols in CFC plans
- Creation of device displays for the different device display variants
- Control of devices and management of process data
- Communication with one or more devices via direct communication connections
- Testing of parameterization of a protection device using the DIGSI 5 Test Suite

6.2 Operator Actions in the Offline and Online Area

You can execute operator actions in the offline configurations or online on the device.



NOTE

To avoid unintentional changes and switching operations during operation, some operator actions are protected by a confirmation ID.

Protect access to your protection devices using a secure connection password. This will prevent undesirable changes by third parties.

Offline Area (Project View)

The offline configurations indicated offline in a project include all data to be edited of a protection device on the engineering PC. There is no connection to a physically existing device. You can execute the following actions in the offline area:

- Creating a topology as a single-line diagram
- Adding SIPROTEC devices to the topology
- Configuring hardware of a SIPROTEC device
- Defining functional scope of a SIPROTEC device
- Entering individual function settings and displaying characteristic curves graphically
- Routing information
- Editing display diagrams
- Designing logic functions such as interlocking mechanisms
- Configuring the communication network and setting communication parameters
- Displaying save measured values and indications
- Displaying saved fault records and evaluating them with SIGRA
- Exporting and printing data

Devices Available Online (Online Mode)

In online mode there is a connection between a PC and a device. In this mode you can carry out the following actions:

- Transferring setting values from the PC to the SIPROTEC device
- Transferring setting values from the SIPROTEC device to the PC and saving in files
- Transferring indications, measured values and fault records from the SIPROTEC device to the PC and saving in files
- Setting limiting values
- Executing test functions
- Controlling equipment, placing markers and canceling blocks
- Executing initial start or restart of the SIPROTEC device
- Setting date and time
- Changing confirmation IDs and passwords
- Adding devices to projects
- Complete processing of devices

**NOTE**

If you change setting values or routings in online devices, you must activate them in the device. This ensures consistent acceptance of data.

6.3 Initializing a Device



NOTE

Initialization is possible, for example, via the USB interface or port J of the device.



NOTE

The physical connection between PC and SIPROTEC 5 device may be done only 1 to 1. If your PC has several free USB interfaces, you can connect only one single SIPROTEC 5 device. Otherwise, no connection to the devices is established. If you set up a hub between PC and the SIPROTEC 5 devices, no connection to the devices is established either.

Connect the top USB port on the front panel of the on-site operation panel of the base module of SIPROTEC 5 devices to the engineering PC using a suitable USB cable. If you have connected the protection device to your PC, you can initialize the device with the help of DIGSI 5.

- Select the relevant offline configuration in a DIGSI 5 project by selecting the device name.
- Open the context menu by right-clicking.
- Select **Initialize Device**.
- The offline configuration is thereby transferred to the device and the offline configuration in the DIGSI 5 project connected via the serial number of the device.

Check whether there is a connection between your DIGSI 5 project and your device. If you wish to compare the serial number in the editor and the device information with the label of the device, proceed as follows:

- ✧ Double-click in the project tree the **Device information** tab under the device. You will find the serial number in the **General** section.

6.4 Transferring Device Data from the PC to the Device



NOTE

If the protection devices are connected to the engineering PC, the transfer of device data to one or more devices is possible. For this purpose, you must initialize the devices once with DIGSI 5.

If you would like to transfer device data from the PC to the device, then connect the device to the PC. You can use the following terminals for this purpose:


- USB port on the on-site operation panel of the base module
- Any Ethernet interfaces of the device
- ✧ Check whether there is a connection between your DIGSI 5 project and your device.
- ✧ Compare the serial number in the editor and the device information to the label of the device.
- ✧ To do this, double-click in the project tree the **Device information** menu item under the device. You will find the serial number in the **General** section.

Establishing a Connection Via USB

- ✧ Connect the top USB port on the front panel of the on-site operation panel of the base module of SIPROTEC 5 devices to the engineering PC using a suitable USB cable.
- ✧ In the project tree of your DIGSI 5 project, double-click the **Load configuration to the device** menu item in the corresponding offline configuration of the device.
- ✧ Enter the confirmation ID for the user.

DIGSI 5 recognizes automatically that the device is connected via USB and the loading of configuration from the DIGSI 5 project to the device is initiated.

Establishing a Connection Via Ethernet

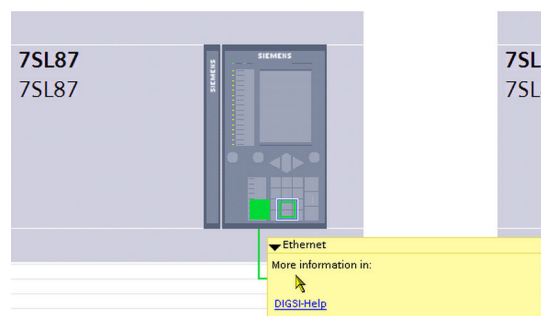

[scipadrs-080413-01.tif, 1, en_US]

Figure 6-2 Setting the IP address


- ✧ Connect, for example, the Ethernet port J on the rear of the SIPROTEC 5 base module to the engineering PC using a suitable Ethernet cable.
- ✧ In the project tree of your DIGSI 5 project, double-click the **Devices and networks** menu item.
- ✧ In the network view, you will find all devices of your project with the offline configurations. Select the device with which you would like to connect and click the green-edged field of the displayed device (see [Figure 6-2](#)).
- ✧ Enter the IP address, subnet mask and optionally the IP address of a router (standard gateway).
- ✧ In the project tree of your DIGSI 5 project, double-click the **Load configuration in devices** menu item. Execute this in the corresponding offline configuration of the device.

DIGSI 5 recognizes automatically that the device is connected via Ethernet. The loading of the configuration from the DIGSI 5 project to the device is then initiated.

**NOTE**

If you wish to use another Ethernet interface port other than port J, in **Device Information** select the interface with which DIGSI 5 should communicate with your SIPROTEC 5 device.

Alternatively, you can select the following path for the setting of the Ethernet address.

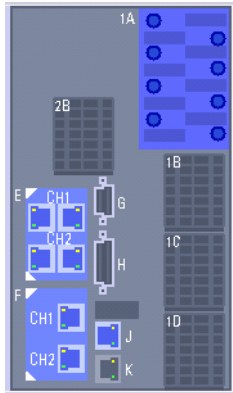

[scipruetec-030311-01.tif, 1, en_US]

Figure 6-3 Rear panel of a SIPROTEC 5 device

- ✧ Connect, for example, the Ethernet port J on the rear of the SIPROTEC 5 base module to the engineering PC using a suitable Ethernet cable.
- ✧ In the project tree of your DIGSI 5 project, double-click the **Devices and networks** menu item.
- ✧ You will find all devices of your project with the offline configurations in the **Device view** tab. Select the device with which you would like to connect and click the Ethernet port of the displayed device (see [Figure 6-3](#)).
- ✧ Enter the IP address, subnet mask and optionally the IP address of a router (standard gateway).
- ✧ In the project tree of your DIGSI 5 project, double-click the **Load configuration in devices** menu item. Execute this in the corresponding offline configuration of the device.

DIGSI 5 recognizes automatically that the device is connected via Ethernet. The loading of the configuration from the DIGSI 5 project to the device is then initiated.

**NOTE**

If you wish to use another Ethernet interface port other than port J, in **Device information** select the interface with which DIGSI 5 should communicate with your SIPROTEC 5 device.

6.5 Changing Data on the Online Device

Always execute changes in the project tree of the selected device and load the changes to the device. Proceed as follows:

- ✧ In your project, click the node of the selected device.
- ✧ Execute the desired changes, for example, in the settings.
- ✧ Select the device again and right-click the device.
- ✧ In the menu, select the item **Load configuration to device**.

DIGSI transfers the changed configuration data to the device. After a successful transfer, the device restarts.

6.6 Retrieving Fault Records and Log Contents

Proceed in online mode as described in chapter [6.4 Transferring Device Data from the PC to the Device](#). Load the parameterization and read process data from the device.

- ✧ Link the matching offline configuration in your project to your online device.
- ✧ To do this, drag the online device in the project tree onto the matching offline configuration via Drag & Drop.

You will recognize the connection by the change in name of the online device, which has now assumed the name of the offline configuration with the remark **assigned** in brackets.

- ✧ Open the display of the logs by double-clicking in the tree the **Indications** node.
- ✧ To open the log content, click in the toolbar of the **Operational log** or **Fault log** on **Read log entries**.
- ✧ To display the fault records available in the device, open the node of the logs and click the **Read records** button.

When reading fault records, fault indications are automatically retrieved as well and become available to you. The log content as well as fault records are thus saved simultaneously as well in the linked offline configuration. You can also archive all entries as files which you can further edit in Microsoft Excel for example.

7 Operation Using a Browser-Based User Interface

7.1	General	108
7.2	Operation	109
7.3	Buttons	115
7.4	Examples	132

7.1 General

Apart from the use of an engineering tool such as DIGSI 5 or SICAM TOOLBOX II for configuration and maintenance, SIPROTEC 5 devices provide a Web front end that can be used with a standard Web browser. The **browser-based user interface** is a comprehensive commissioning and monitoring tool that provides an easy-to-understand display of the most important measured data. You can operate the device remotely or locally using the **browser-based user interface** and a Web browser.

The **browser-based user interface** can be used via a communication network:

- During commissioning
 - Checking and adjusting the values of a specific setting
 - Comparing the values of 2 or more devices
 - Checking a setting value against a user-defined setting to verify whether the setting value differs from the default value specified by Siemens
- During an inspection
 - Querying a value in order to adjust a test case, for example to preset the tripping current
 - Viewing all types of measured values, for example functional measured values and derived values such as the minimum/maximum and mean values
 - Displaying the deviation of the expected measured-value quality.
- While operating the device

The **browser-based user interface** is especially optimized for the protection system and provides comprehensive support during testing and commissioning from the PC or laptop computer.

All relevant device information and setting options are displayed graphically on the screen.

7.2 Operation

If you are familiar with the structure of the settings in DIGSI 5 and on-site operation, you can navigate through the same structure (for example function groups, function blocks, and the diagram on the on-site operation panel) using the **browser-based user interface**.

The PC that you wish to use to operate the SIPROTEC 5 device must be connected to the device via a network cable. The PC and the SIPROTEC 5 device must be switched on.

Before you operate the device using a Web browser, you first have to check the security settings. With the security settings, you restrict the access rights for Web access (Port J and Ethernet communication module). You can define the security settings in DIGSI in the project tree under **Security → Network access security**. You can assign the following access rights:

- No access:
This interface does not allow access to the device.
- Read-only access:
This interface only allows read access to the device.
- Read/write access (default setting):
This interface allows read and write access to the device.

To operate the device via the **browser-based user interface**, proceed as follows:

- Connect the SIPROTEC 5 device (for example Port J) to your PC using a network cable.



NOTE

If the device has an Ethernet communication module, you can also use the ports E, F, N, or P, or you can access the device via the USB interface.



NOTE

To access the device via the USB interface, use the following IP address: 192.168.2.1.

In order to access the device via the integrated Port J, define the following setting of the access under **Network access security** in DIGSI:

Web access	
1331.20431.101	Integrated Port J: read and write access
1331.20431.102	Module Port E: no access

[sc_webaccess, 2, en_US]

Figure 7-1 Security Setting in DIGSI



NOTE

Note the IP address and the port number of the interface used for communication between the PC and the **browser-based user interface**. Make sure that the 12-digit IP address for the Web browser has been correctly set using the format *****.***.***.***** via DIGSI.

- Launch the Web browser on your PC.
- Enter the IP address of the device in the address line of the Web browser, followed by the port number 4443, for example **https://172.16.60.60:4443**, and confirm the entry using the ENTER key.



NOTE

You may operate the SIPROTEC 5 device using DIGSI 5 and using the **browser-based user interface** in parallel.



NOTE

Some Web browsers may have problems connecting to the specified IP address of the device; in this case, delete the associated certificate in the Web browser.

Depending on the security configuration of the SIPROTEC 5 device, the following log-in dialogs are available:

- Variant 1:
If you allocated a connection password in DIGSI 5 under **Operations safety and access control**, the login dialog starts with the non-editable user name **Siprotec 5**. You must enter the connection password configured in DIGSI as the password.
- Variant 2:
If you have configured the role-based access control (RBAC) in DIGSI 5 under **Operations safety and access control**, the login dialog starts with the request of the user name and password that you configured on the RADIUS server.
- Variant 3:
If you have configured neither the role-based access control nor the connection password, the login dialog starts with the non-editable user name **Siprotec 5**. The text box for the password must remain empty.

Once the Web browser is successfully connected to the device, the following login dialog (for Variant 2) will appear, for example:

[scwebmonitor, 1, en_US]

Figure 7-2 Login Dialog for the Browser-Based User Interface

- Enter the user name in the text box **User name**.
- Click into the text box **Password** and enter the password.
- Select a language.



NOTE

If role-based access control (RBAC) is active, access is possible only after a successful user name and password authentication check.

You can find more information on this in the **Security Manual**.



NOTE

The language selection depends on the language set for the user interface of the device.


- Click the button with the checkmark.



[scwebmonitor_enter, 1, --, --]

Figure 7-3 Confirmation Button

After a successful login, the following buttons are available:

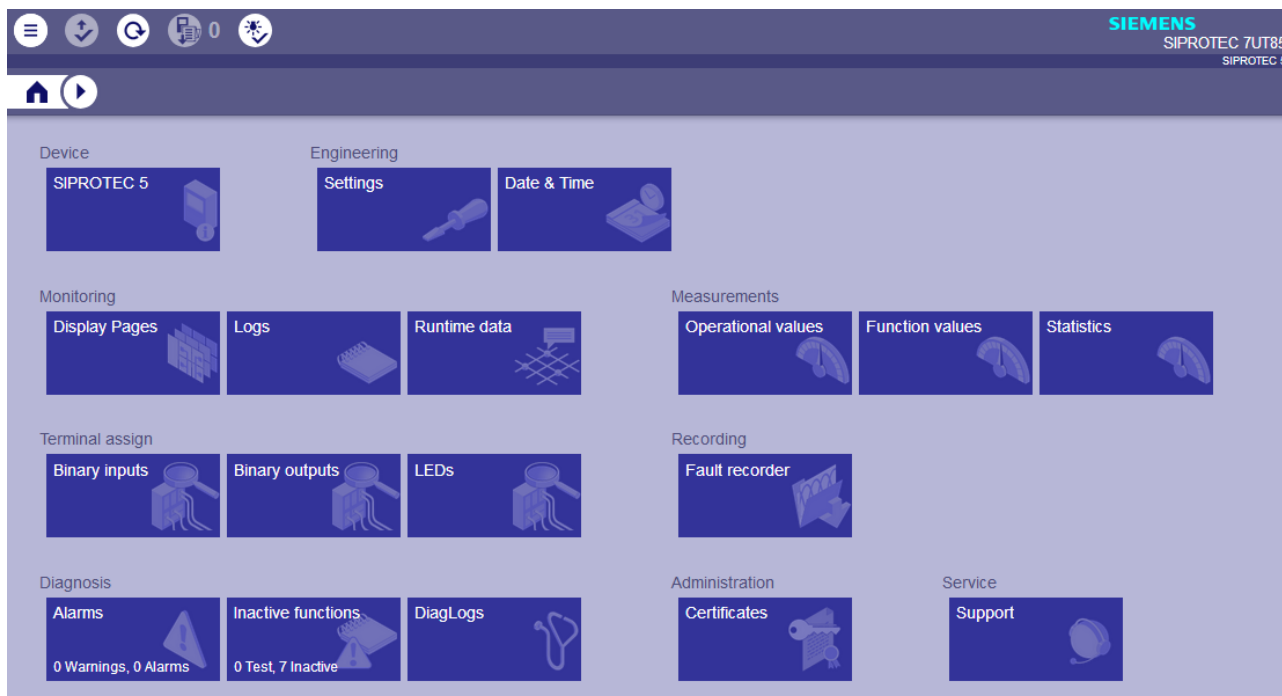

[scwebmonitor1, 5, en_US]

Figure 7-4 Buttons for the Browser-Based User Interface

You can view the corresponding sections, or you can edit them by clicking the individual buttons.


Timeout



NOTE

If you do not perform any action on the **browser-based user interface** within a defined time range, the Web browser disconnects from the device.

The following messages appear:

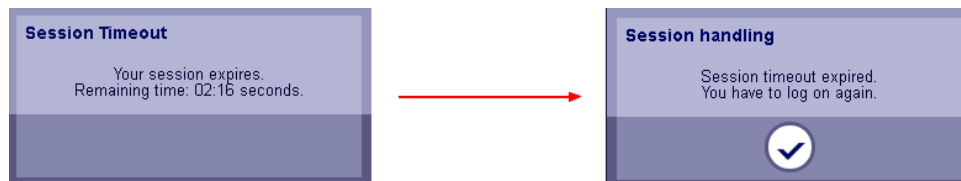

[scwebmonitor14, 1, en_US]

Figure 7-5 Time-Out

After a certain time has elapsed, you must log on to the device again using the Web browser (see [Figure 7-5](#)).

Confirmation ID

You can activate the confirmation ID for editing device settings in DIGSI 5 under **Operational safety and access control**. This is queried once, before the first changes are made to the device settings in the **browser-based user interface**.

Confirmation IDs and connection password

Enter confirmation ID

Active	Scope of operation	Action	Description
☒	Settings / operation	Change...	Allows change of settings and access to process data.
☐	Fct.Key/PB operation	Change...	Allows operating via function keys and push-buttons only with confirmation ID (of Settings/Operation).
☒	Switching (process)	Change...	Allows switching operations.
☒	Switching (unlocked)	Change...	Allows switching operations. Interlocking conditions get ignored or get considered.
☒	Switching authority	Change...	Definition of the authority for switching operations. LOCAL always has higher priority than REMOTE.

[saccesscontr, 1, en_US]

Figure 7-6 Activation of the Confirmation ID

If you have secured the changing of settings by a confirmation ID, the following dialog appears when a setting is changed:

Authorization required

 You need to enter your confirmation ID to change these settings.

Confirmation ID

[scconfid, 1, --,--]


Figure 7-7 Query for the Confirmation ID

After entering the confirmation ID, the changed setting is adopted.

Other Buttons

Table 7-1 Overview of Buttons


Button	Meaning
	Use this button to log off (logout).
	Use this button to adopt the changed parameter and save in the device.
	Use this button to refresh the displayed page.
	If you change device settings, read fault records, and perform other write-access operations via the Web browser, you can check the result using this button. You can leave the displayed list by clicking this button again.
 Filter  	Use these buttons to filter the displayed list or to delete the entire list.
	Use this button to control an LED reset.

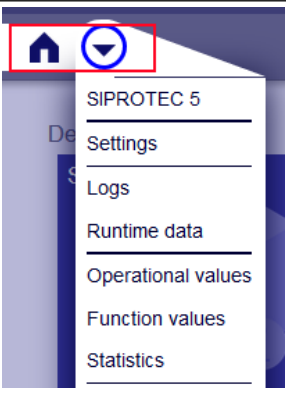Button	Meaning
	Use this button to access the home screen and the list box.
	Use this button to start generating a fault record.
	Use this button to start an export (for example, for operational indications).
	Use this button to pause data transmission.
Primary 	Use these buttons to switch the measured values and statistical values to primary, secondary, or percentage values.
Secondary 	
Percentage 	

Structure of the User Interface

You can navigate via the displayed buttons or via the list box, as required.

Using the buttons or the list box, you can change the settings of the connected device, check them, or retrieve and export information.

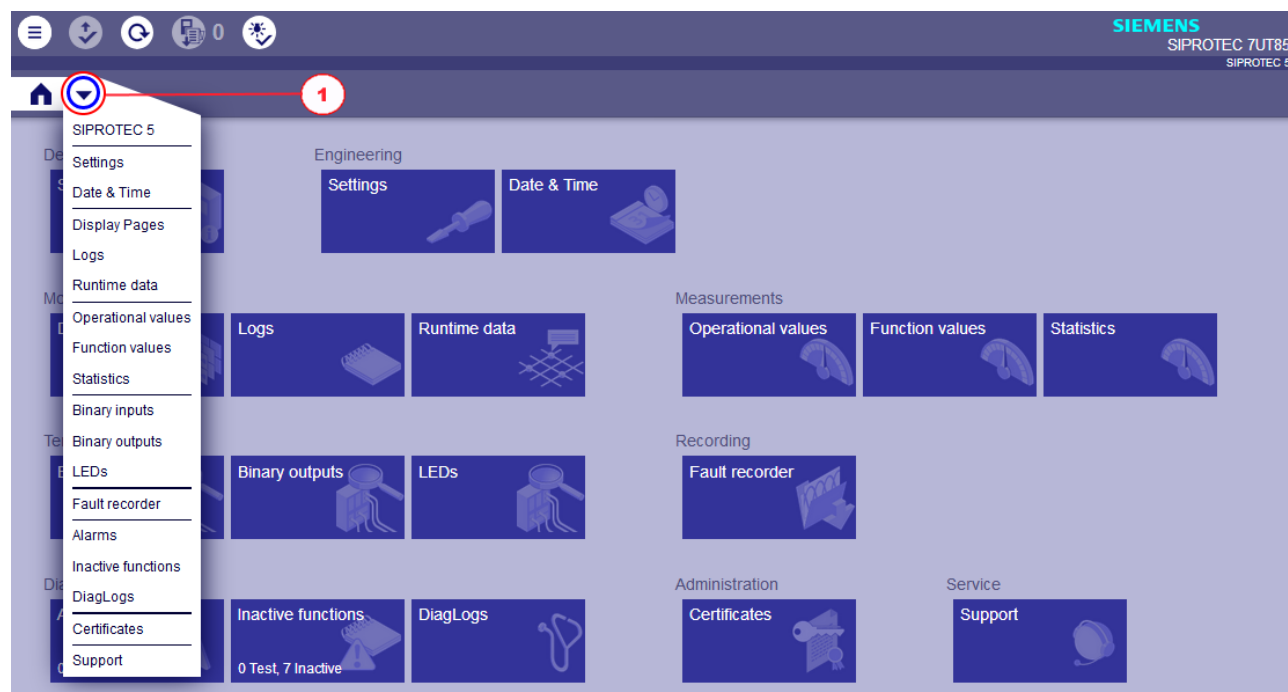

[scnaviwebmon, 4, en_US]

Figure 7-8 Overview of Buttons

(1) Open the list box

7.3 Buttons

7.3.1 General

The buttons and submenus of the **browser-based user interface** are described using the example of a **transformer protection device**.



NOTE

Depending on the device variant, different buttons and submenus are available for the **browser-based user interface**.

7.3.2 Device



[scwebmonitorGK, 1, en_US]

Figure 7-9 SIPROTEC 5 Button


Device information such as the product code, the firmware version of the device, or the current operating mode of the device are displayed using the **SIPROTEC 5** button.



[scwebmonitor2, 2, en_US]

Figure 7-10 Device Information

7.3.3 Engineering

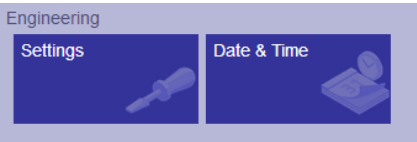

[scwebmonitorEK, 2, en_US]

Figure 7-11 Engineering Buttons

2 buttons are available:

- **Settings:**

An overview of the function groups is displayed using the **Settings** button.

The settings of a function group are displayed and can be edited and saved on the device by clicking the appropriate button. You can find a detailed description, with examples in chapter [7.4.1 General](#).



[scwebmonitor19, 3, en_US]

Figure 7-12 Displaying and Editing Settings

- **Date & time:**
You can adjust date & time using the **Date & time** button.


Enter manually ☐

Your computer		Device	
Date	2020-05-19	Date	2020-05-19
Time	08:06:47	Time	08:06:42
Time zone	+02:00	Time zone	+02:00
		Daylight saving	no
		State	valid

[scwebmondati, 1, en_US]

Figure 7-13 Setting Date and Time

7.3.4 Monitoring

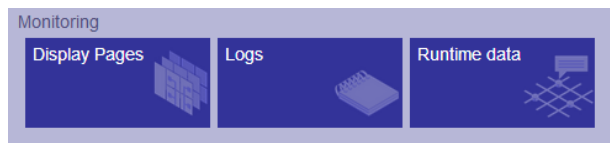


[scwebmonitorUK, 2, en_US]

Figure 7-14 Monitoring Buttons

3 buttons are available:

- **Display pages:**
The current single-line diagram of the device is displayed using the **Display pages** button. You can select the pages individually, as on the SIPROTEC 5 device. The displayed values are constantly updated and cannot be changed.

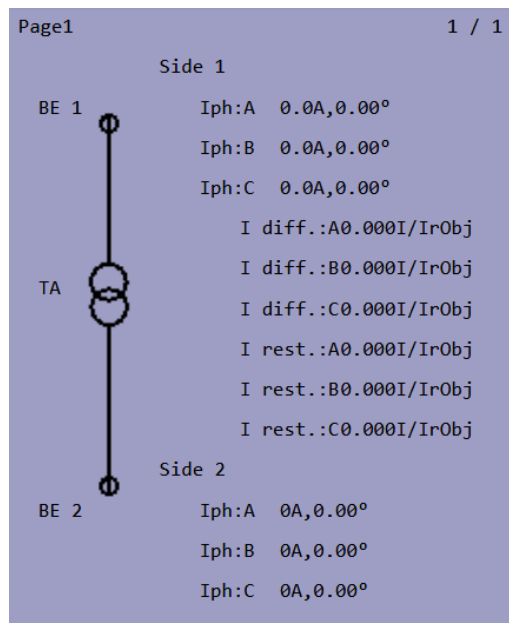


[scwebmonsilidi, 1, en_US]

Figure 7-15 Diagram

- **Logs:**

The logs are displayed using the **Logs** button. You can display the content by clicking the desired log and can download it in CSV format. You can find a detailed description with examples in chapter [7.4.1 General](#). Depending on the device, the following logs are available:

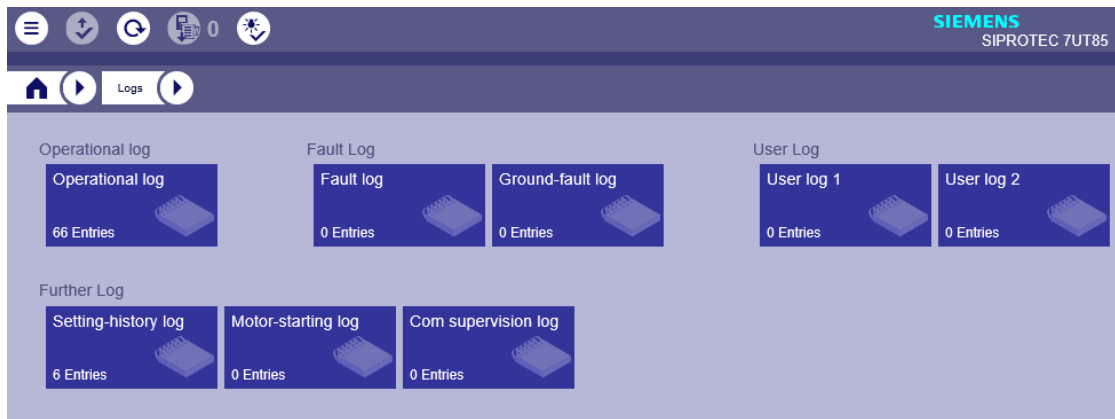


[scwebmonitor3, 2, en_US]

Figure 7-16 Menu of the Logs

- **Runtime data:**


The state of all signals is displayed using the **Runtime data** button. Depending on the device, the following runtime data can be viewed:

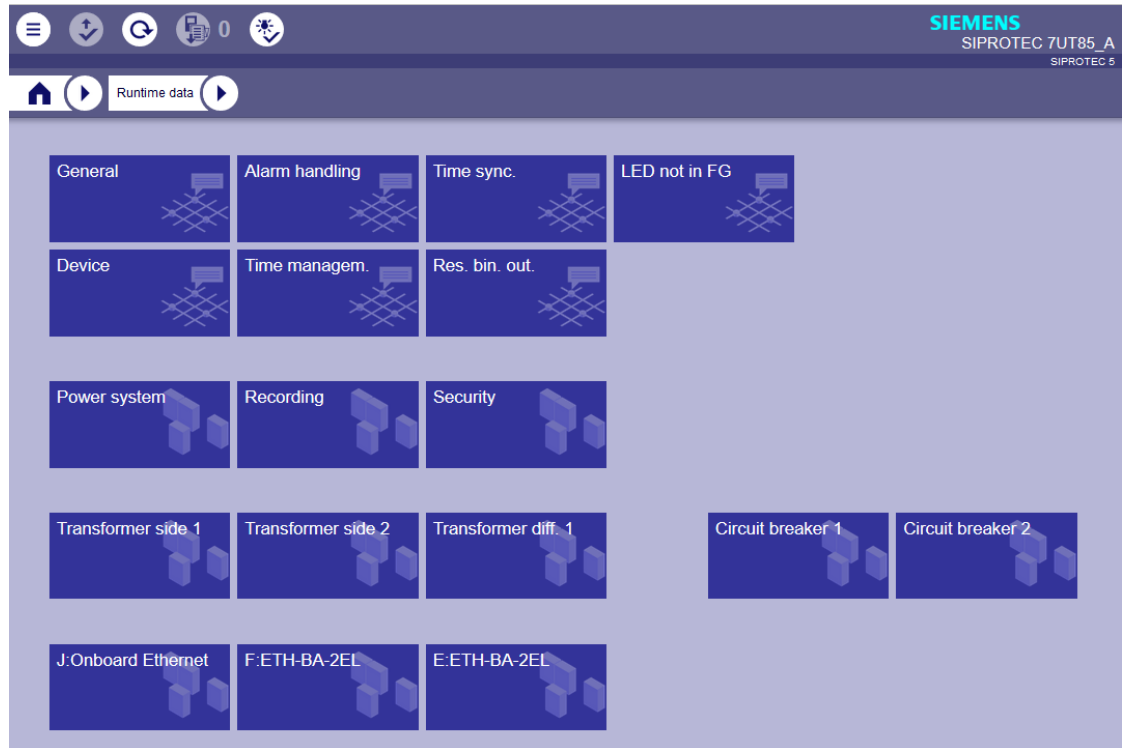

[scwebmonitorRD, 1, en_US]

Figure 7-17 Runtime-Data Menu


The following figure shows an example of the state and quality of inputs and outputs under the **General** button:

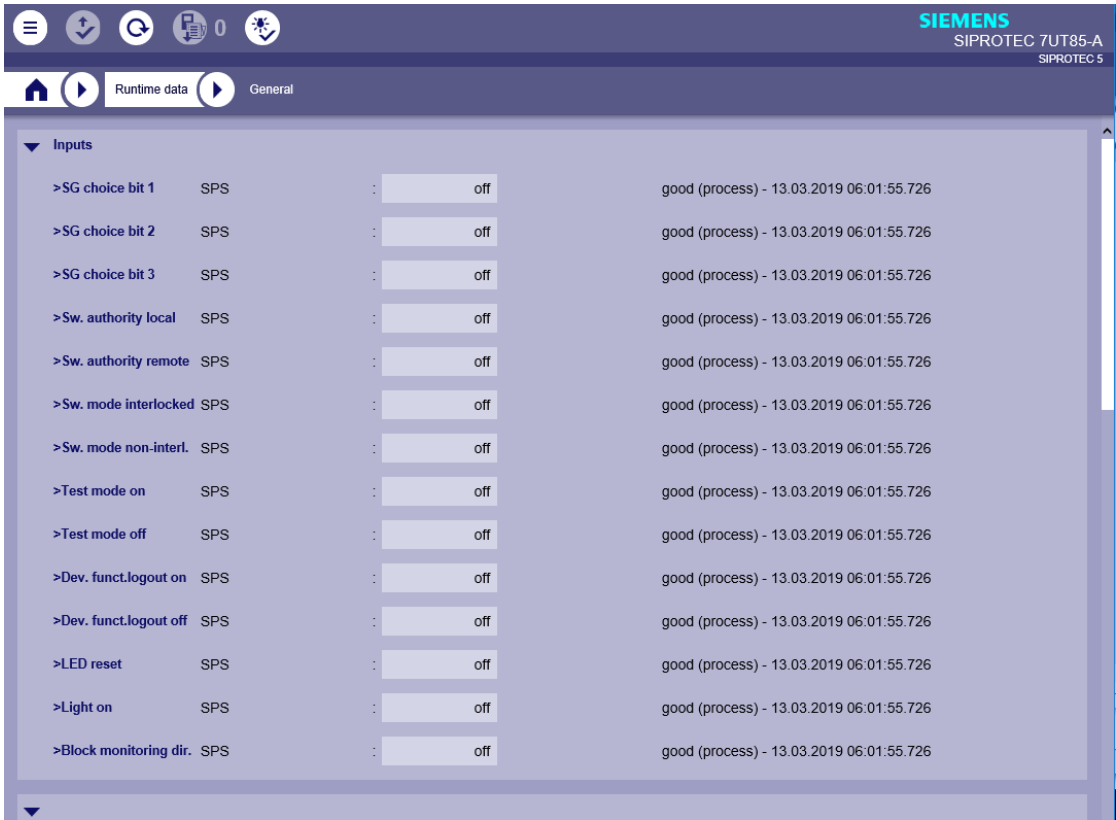

[sclaufzeitzustqual, 1, en_US]

Figure 7-18 State and Quality of Inputs and Outputs

7.3.5 Measured Values

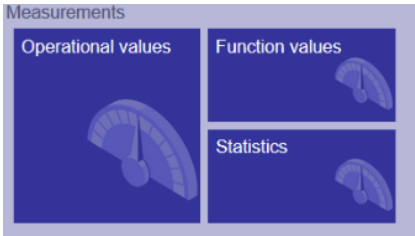


[scwebmonitorMK, 1, en_US]

Figure 7-19 Measurements Buttons

3 buttons are available:

- **Operational values:**

An overview of the function groups can be displayed via the **Operational values** button. The measured values can be displayed by clicking the desired function group. You can find a detailed description with examples in chapter [7.4.1 General](#).

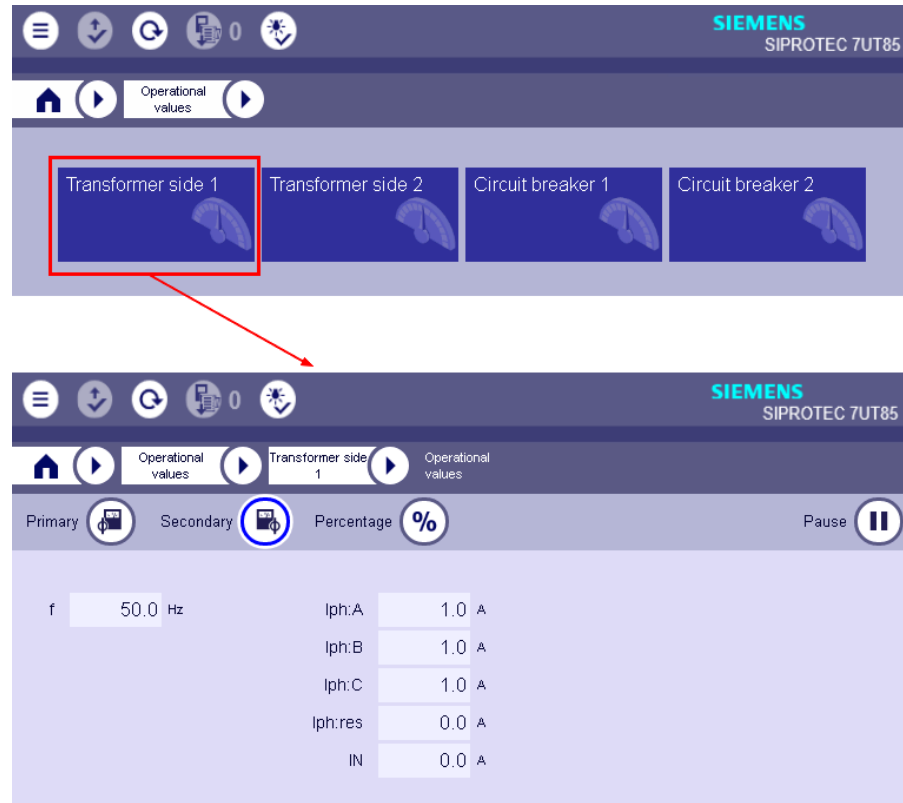


[scwebmonitor15, 2, en_US]

Figure 7-20 Example of Operational Measured Values

- **Function values:**

An overview of the function groups is displayed via the **Function values** button.
The functional measured values can be displayed by clicking the desired function group (see [Figure 7-21](#)).

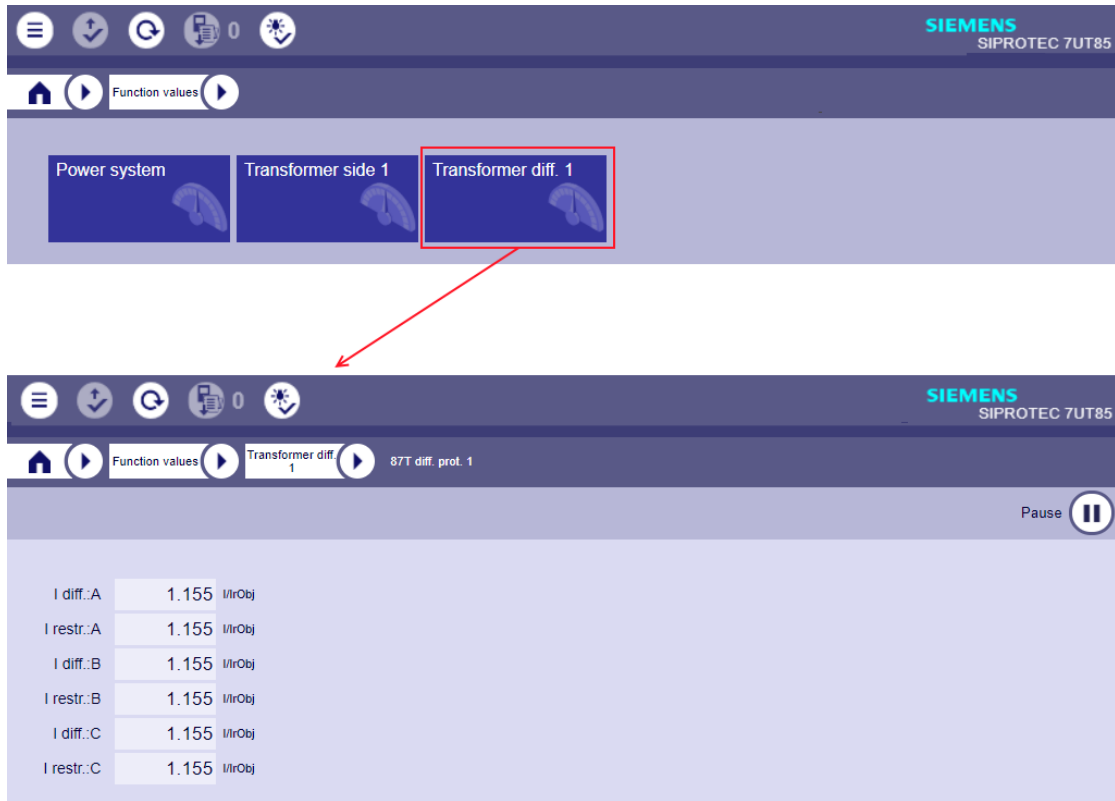

[scwebmonitor16, 2, en_US]

Figure 7-21 Example of Functional Measured Values

- **Statistics:**


An overview of the function groups providing statistical values is displayed via the **Statistics** button. The statistical values, for example device operating hours, can be displayed by clicking the desired function group (see the following figure).



[scwebmonitor18, 2, en_US]

Figure 7-22 Statistics

7.3.6 Terminal Assignment

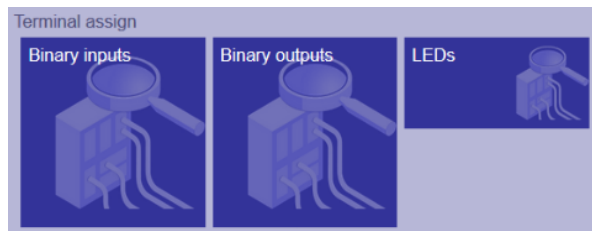

[scwebmonitorKK, 1, en_US]

Figure 7-23 Terminal Assignment Buttons

3 buttons are available:

- **Binary inputs:**

An overview of the connected binary inputs is displayed via the **Binary inputs** button. You can display the assignment of the binary inputs for this module by clicking a button in the left section (for example, base module). You can find a detailed description with examples in chapter [7.4.1 General](#).




Type	No.	Terminal	Routing	Value
Binary input#	1.1	D11-D9		-
			Circuit breaker 1: Ci...	intermedi...
Binary input#	1.2	D12-D10		-
			Circuit breaker 1: Ci...	intermedi...
Binary input#	1.3	D11-D13		-
			Circuit breaker 1: Ci...	off
Binary input#	1.4	D12-D14		-
Binary input#	2.1	B11-B12		-
			Circuit breaker 2: Ci...	intermedi...
Binary input#	2.2	B11-B14		-
			Circuit breaker 2: Ci...	intermedi...
Binary input#	2.3	B11-B13		-

[scwebmonitor10BI, 1, en_US]

Figure 7-24 Assignment of Binary Inputs

- **Binary outputs:**

An overview of the connected binary outputs is displayed via the **Binary outputs** button. You can display the assignment of the binary outputs for this module by clicking a button in the left section (for example, base module).

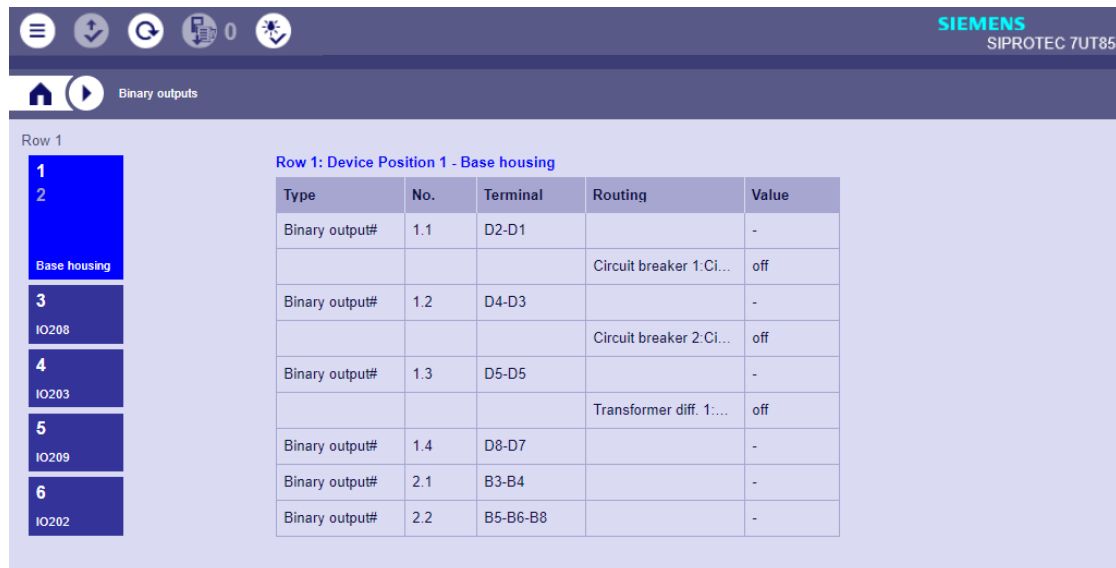


Type	No.	Terminal	Routing	Value
Binary output#	1.1	D2-D1		-
			Circuit breaker 1: Ci...	off
Binary output#	1.2	D4-D3		-
			Circuit breaker 2: Ci...	off
Binary output#	1.3	D5-D5		-
			Transformer diff. 1:...	off
Binary output#	1.4	D8-D7		-
Binary output#	2.1	B3-B4		-
Binary output#	2.2	B5-B6-B8		-

[scwebmonitor10BO, 1, en_US]

Figure 7-25 Assignment of Binary Outputs

- **LEDs:**
An overview of the connected LEDs is displayed via the **LEDs** button. You can display the assignment of the LEDs for this module by clicking a button in the left section (for example, base module).

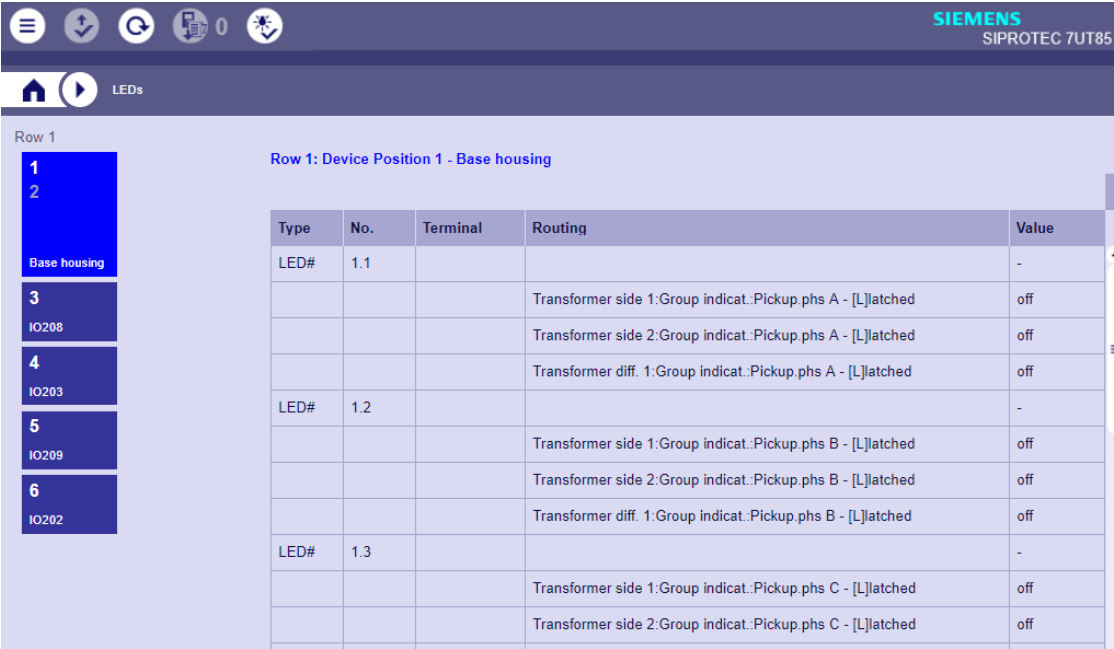

Type	No.	Terminal	Routing	Value
LED#	1.1			-
			Transformer side 1:Group indicat.:Pickup.phs A - [L]latched	off
			Transformer side 2:Group indicat.:Pickup.phs A - [L]latched	off
			Transformer diff. 1:Group indicat.:Pickup.phs A - [L]latched	off
LED#	1.2			-
			Transformer side 1:Group indicat.:Pickup.phs B - [L]latched	off
			Transformer side 2:Group indicat.:Pickup.phs B - [L]latched	off
			Transformer diff. 1:Group indicat.:Pickup.phs B - [L]latched	off
LED#	1.3			-
			Transformer side 1:Group indicat.:Pickup.phs C - [L]latched	off
			Transformer side 2:Group indicat.:Pickup.phs C - [L]latched	off


[scwebmonitor10LED, 1, en_US]
Figure 7-26 Assignment of LEDs:

7.3.7 Recording




[scwebmonitor55, 1, en_US]
Figure 7-27 Fault-Recorder Button

The fault records of the standard recorder can be called up via the **Fault recorder** button. Additional datasets are available for the 7KE85 fault recorder (Figure 7-28). You can find a detailed description with examples in chapter 7.4.1 General.

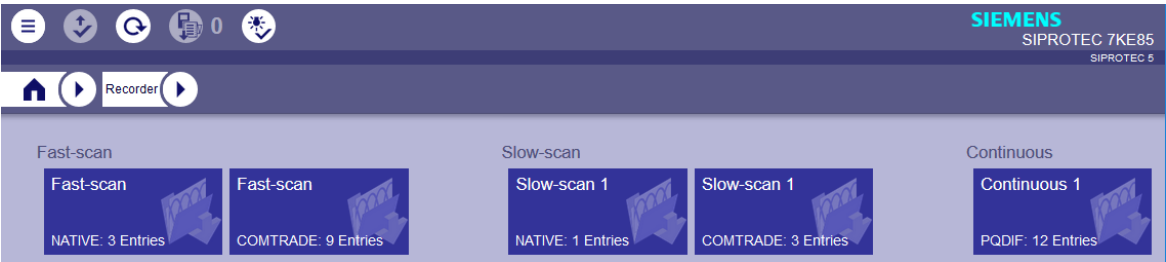

[sc_faultrec-ke, 1, en_US]
Figure 7-28 Additional Buttons on the 7KE85

If necessary, you can export the datasets in COMTRADE format, and the extended datasets as native, COMTRADE and PQDIF formats.

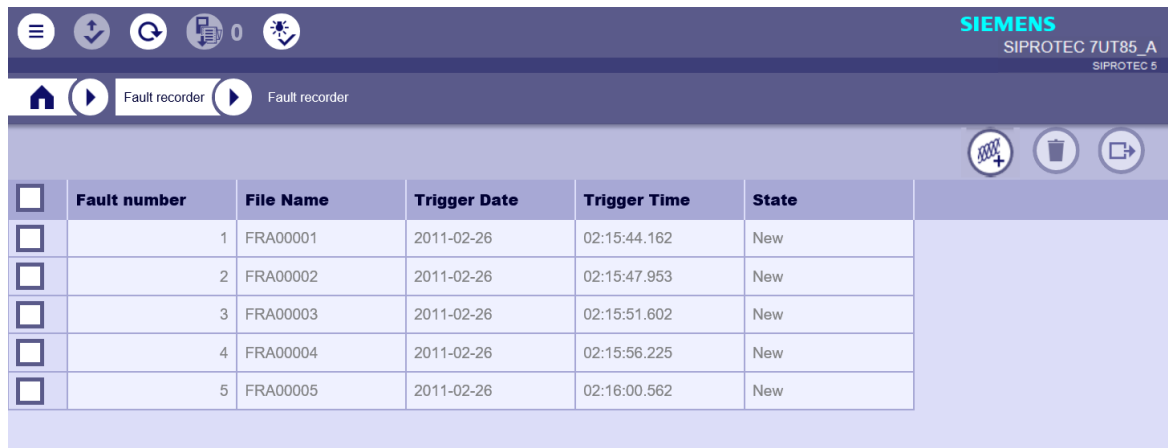


The screenshot shows the 'Fault recorder' interface. At the top, there is a navigation bar with a home icon, a play button, and the text 'Fault recorder'. Below this is a table with the following columns: Fault number, File Name, Trigger Date, Trigger Time, and State. The table contains five rows of data, all with a 'New' state. To the right of the table, there are three icons: a plus sign, a trash can, and a document with an arrow.

	Fault number	File Name	Trigger Date	Trigger Time	State
☐	1	FRA00001	2011-02-26	02:15:44.162	New
☐	2	FRA00002	2011-02-26	02:15:47.953	New
☐	3	FRA00003	2011-02-26	02:15:51.602	New
☐	4	FRA00004	2011-02-26	02:15:56.225	New
☐	5	FRA00005	2011-02-26	02:16:00.562	New

[scstandardRecLi, 1, en_US]

Figure 7-29 Example of a Fault-Record List

7.3.8 Diagnosis

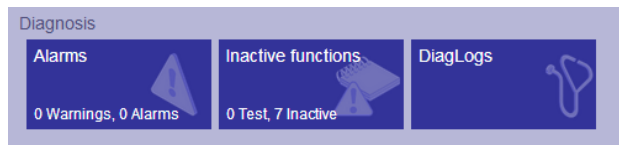


[scwebmonitorDI, 2, en_US]

Figure 7-30 Diagnosis Buttons

3 buttons are available:

- **Alarms:**

The possible device warnings and alarms are displayed in one table via the **Alarms** button:

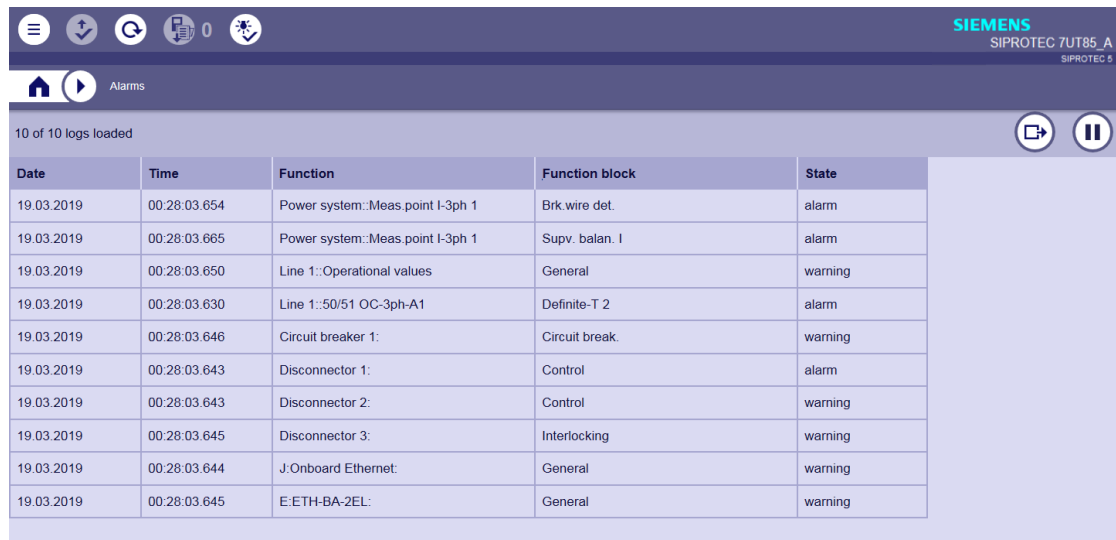

The screenshot shows the 'Alarms' interface. At the top, there is a navigation bar with a home icon, a play button, and the text 'Alarms'. Below this is a table with the following columns: Date, Time, Function, Function block, and State. The table contains ten rows of data, all with a 'warning' or 'alarm' state. To the right of the table, there are two icons: a document with an arrow and a pause button.

Date	Time	Function	Function block	State
19.03.2019	00:28:03.654	Power system::Meas.point I-3ph 1	Brk.wire det.	alarm
19.03.2019	00:28:03.665	Power system::Meas.point I-3ph 1	Supv. balan. I	alarm
19.03.2019	00:28:03.650	Line 1::Operational values	General	warning
19.03.2019	00:28:03.630	Line 1::50/51 OC-3ph-A1	Definite-T 2	alarm
19.03.2019	00:28:03.646	Circuit breaker 1:	Circuit break.	warning
19.03.2019	00:28:03.643	Disconnecter 1:	Control	alarm
19.03.2019	00:28:03.643	Disconnecter 2:	Control	warning
19.03.2019	00:28:03.645	Disconnecter 3:	Interlocking	warning
19.03.2019	00:28:03.644	J:Onboard Ethernet:	General	warning
19.03.2019	00:28:03.645	E:ETH-BA-2EL:	General	warning

[scAlarmAndWarningList, 1, en_US]

Figure 7-31 Alarm List

- **Inactive functions:**

The functions that are inactive or switched to test, depending on the device, are displayed via the **Inactive functions** button:




Date	Time	Function	Function block	State
19.03.2019	00:28:03.660		General	Protection inactive
19.03.2019	00:28:03.654	Power system::Meas.point I-3ph 1	Brk.wire det.	Inactive
19.03.2019	00:28:03.665	Power system::Meas.point I-3ph 1	Supv. balan. I	Inactive
19.03.2019	00:28:03.665	Power system::Meas.point I-3ph 1	Supv. ph.seq.I	Inactive
19.03.2019	00:28:03.665	Power system::Meas.point I-3ph 1	Supv. sum I	Inactive
19.03.2019	00:28:03.665	Power system::Meas.point V-3ph 1	Supv. balan. V	Inactive
19.03.2019	00:28:03.665	Power system::Meas.point V-3ph 1	Supv. ph.seq.V	Inactive
19.03.2019	00:28:03.665	Power system::Meas.point V-3ph 1	Supv. sum V	Inactive
19.03.2019	00:28:03.633	Line 1::External trip 1	Stage 1	Inactive
19.03.2019	00:28:03.634	Line 1::59 Overvolt.-3ph 1	Definite-T 1	Inactive
19.03.2019	00:28:03.634	Line 1::59 Overvolt.-3ph 1	Definite-T 2	Inactive
19.03.2019	00:28:03.630	Line 1::50/51 OC-3ph-A1	Definite-T 1	Inactive
19.03.2019	00:28:03.630	Line 1::50/51 OC-3ph-A1	Definite-T 2	Inactive
19.03.2019	00:28:03.630	Line 1::50/51 OC-3ph-A1	Inverse-T 1	Inactive
19.03.2019	00:28:03.630	Line 1::21 Distance prot. 1	General	Inactive
19.03.2019	00:28:03.627	Line 1::21 Distance prot. 1	Z 1	Inactive
19.03.2019	00:28:03.627	Line 1::21 Distance prot. 1	Z 2	Inactive
19.03.2019	00:28:03.627	Line 1::21 Distance prot. 1	Z 3	Inactive
19.03.2019	00:28:03.627	Line 1::21 Distance prot. 1	Z 4	Inactive
19.03.2019	00:28:03.640	Circuit breaker 1::79 Auto. reclosing	General	Inactive

[sclnactiveFunctionsList, 1, en_US]

Figure 7-32 List of Inactive Functions

- **DiagLogs:**

The device-diagnosis log can be read using the **DiagLogs** button:

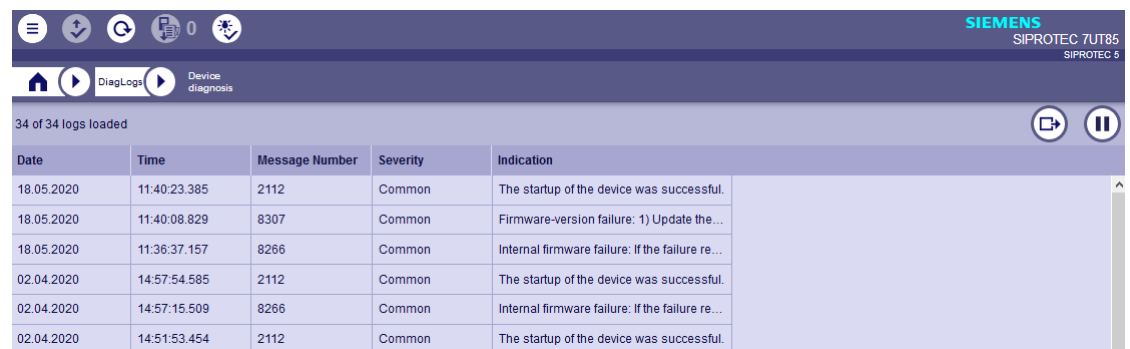

Date	Time	Message Number	Severity	Indication
18.05.2020	11:40:23.385	2112	Common	The startup of the device was successful.
18.05.2020	11:40:08.829	8307	Common	Firmware-version failure: 1) Update the...
18.05.2020	11:36:37.157	8266	Common	Internal firmware failure: If the failure re...
02.04.2020	14:57:54.585	2112	Common	The startup of the device was successful.
02.04.2020	14:57:15.509	8266	Common	Internal firmware failure: If the failure re...
02.04.2020	14:51:53.454	2112	Common	The startup of the device was successful.

[scdevdialog, 2, en_US]

Figure 7-33 Device-Diagnosis Log

7.3.9 Administration



[scwebmonitorVW, 2, en_US]


Figure 7-34 Certificate Buttons



NOTE

You can find more information on this in chapter 6 of the Security manual (C53000-H5040-C081).

If you want to configure a certificate, you can switch to the certificate management using the **Certificates** button.

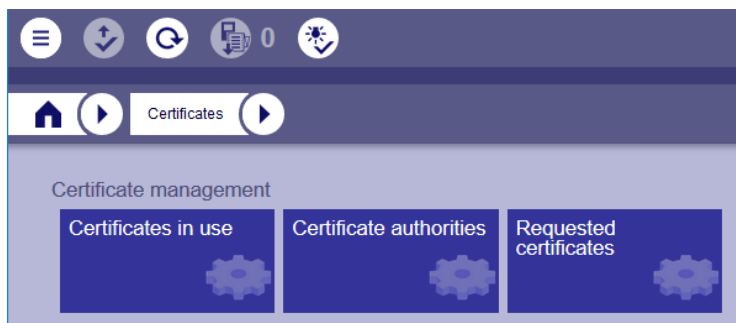

[scwebmonitorZV, 1, en_US]

Figure 7-35 Certificate Management Buttons

3 buttons are available:

- **Certificates in use:**

You can check which communication area a certificate is being used for using the **Certificates in Use** button. In this case, you also have the option of loading another certificate to the device or deleting an existing one.




[scwebmonitorZE, 1, en_US]

Figure 7-36 Selecting a Certificate

- (1) Loading a certificate to the device
- (2) Current certificate data, for example DIGSI: Integrated port J
- (3) Deleting the certificate

- **Certificate Authorities**

You can display the imported certificates that you have loaded into the device using the **Certificate authorities** button.

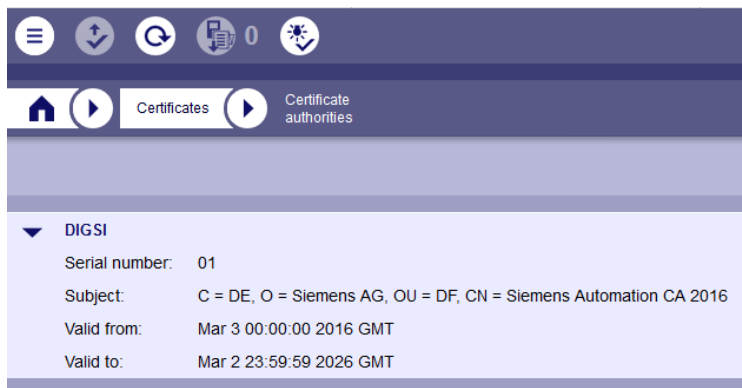

[scwebmonitorZ5, 1, en_US]

Figure 7-37 Certificate Authorities

- **Requested Certificates**

Using the **Requested Certificates** button, you can display the certificate currently being used in the device, for example, DIGSI: Integrated port J, and then export it.




[scwebmonitorZA, 1, en_US]

Figure 7-38 Requested Certificates

- (1) Current certificate, for example, DIGSI: Integrated port J
- (2) Exporting the certificate


7.3.10 Service



[scwebmonitorSV, 1, en_US]

Figure 7-39 Support Button

If the device has a technical problem, you can use the **Support** button to generate a dataset. This dataset contains only data from the internal device error buffers and no configuration data. If necessary, you can provide the dataset to the Customer Support Center.

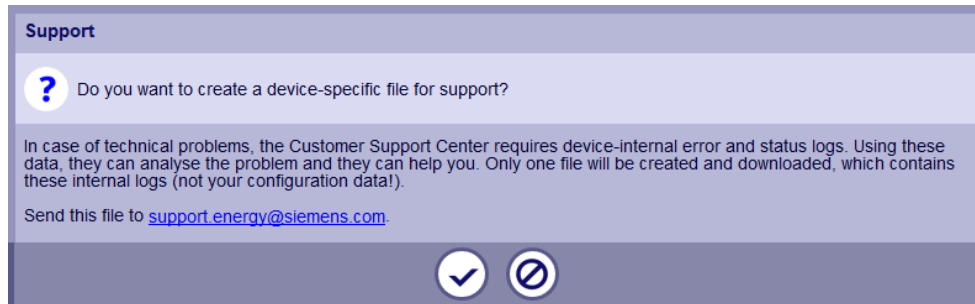

[scsupportservice, 1, en_US]

Figure 7-40 Support Data

7.4 Examples

7.4.1 General

To illustrate working with the **browser-based user interface**, the procedure is shown using the following 2 examples:


- Reading and exporting operational indications from the device
- Changing the settings of a function group and saving them in the device

There must be a communication connection between the PC and the device. You can find more information about device login in chapter [7.2 Operation](#).

7.4.2 Example 1: Reading out Operational Indications

The operational log of the device shall be read out and subsequently exported via the **browser-based user interface**.


- ✧ Log on to the device via a Web browser.
- ✧ Select the **Logs** button from the **Monitoring** menu.

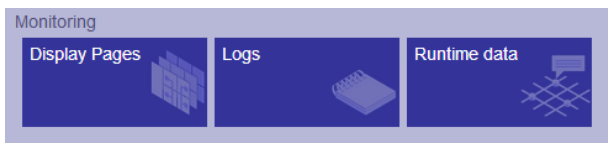

[scwebmonitorUK, 2, en_US]

Figure 7-41 Logs Button

- ✧ Select the **Operational log** item in the list box or the **Operational log** button.

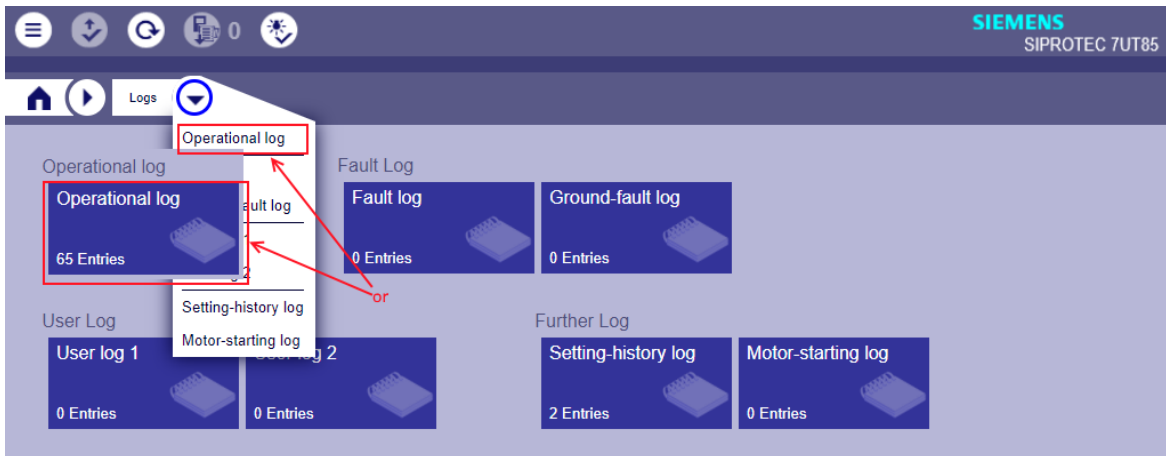

[scwebmonitor11, 2, en_US]

Figure 7-42 Reading the Operational Log

The operational indications of the device are shown in a table.



Date	Time	Functions structure	Name	Value
09.04.2018	09:38:09.978	E:ETH-BA-2EL:Channel 1	Line Mode:Redund. Channel Live	on
09.04.2018	09:38:09.947	E:ETH-BA-2EL:Channel 1	Line Mode:Channel Live	on
09.04.2018	09:38:07.765	Circuit breaker 1	Control:Cmd. with feedback	SPN intermediate
09.04.2018	09:38:07.765	Circuit breaker 2	Control:Cmd. with feedback	SPN intermediate
09.04.2018	09:38:07.765	Circuit breaker 2	Circuit break.:Position	SPN intermediate
09.04.2018	09:38:07.765	Circuit breaker 1	Circuit break.:Position	SPN intermediate
09.04.2018	09:38:07.760	Recording	Grnd.-flt log:Fault number	0
09.04.2018	09:38:07.760	Recording:Fault recorder	Control:Clear memory	false
09.04.2018	09:38:07.760	Recording:Fault recorder	Control:Reset memory	false
09.04.2018	09:38:07.760	Recording:Fault recorder	Control:Start record	false
09.04.2018	09:38:07.760	General:Protection inactive		on
09.04.2018	09:38:07.760	Device:Device startup		off
09.04.2018	09:38:07.760	General:Active settings group		1

[scwebmonitor4, 2, en_US]

Figure 7-43 Operational Indications


✧ To export the content of the operational log, select the following button:



[scwmbutton12_solo, 1, --]

Figure 7-44 Dataset Export


✧ Confirm the write operation by clicking the tick.

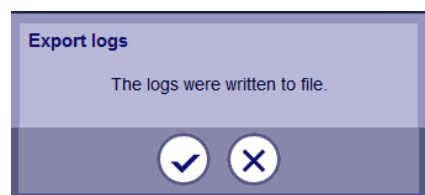

[scexport3, 1, en_US]

Figure 7-45 Confirmation Dialog

✧ Start to export the operational-log content by clicking the **Start download** link.

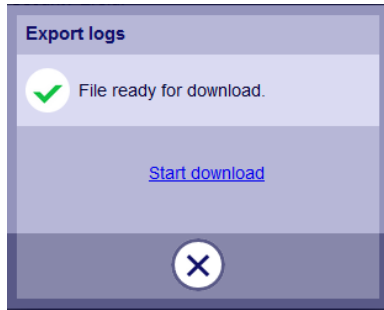

[scexport1, 1, en_US]


Figure 7-46 Export of the Operational-Log Content

- ✧ In the following dialog, select whether you wish to open or save the exported data.
- Once you have saved it, the content of the operational log is available outside the device.

7.4.3 Example 2: Changing Settings

In this example, the **vector group number** in the function group **Transformer page** is changed using the **browser-based user interface**.

- ✧ Log on to the device via a Web browser.
- ✧ In the **Engineering** menu, select the **Settings** button.

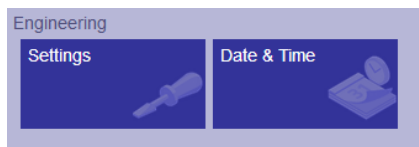

[scwebmonitorEK, 2, en_US]


Figure 7-47 Settings Button

- ✧ Click the buttons **Transformer side 1** → **General** → **Side data** one after the other.



NOTE


You can also select the individual menu items via the list box.

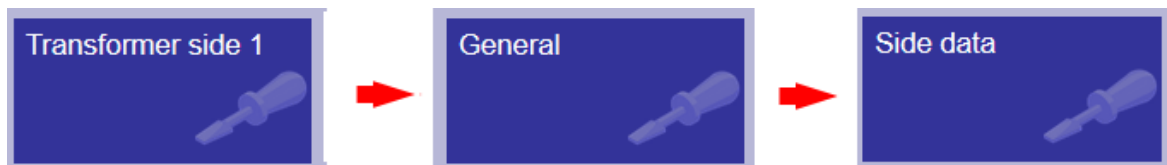

[sctransf4_kompl, 1, en_US]

Figure 7-48 Function-Group Buttons

- ✧ In the selection dialog, select the new vector-group number.

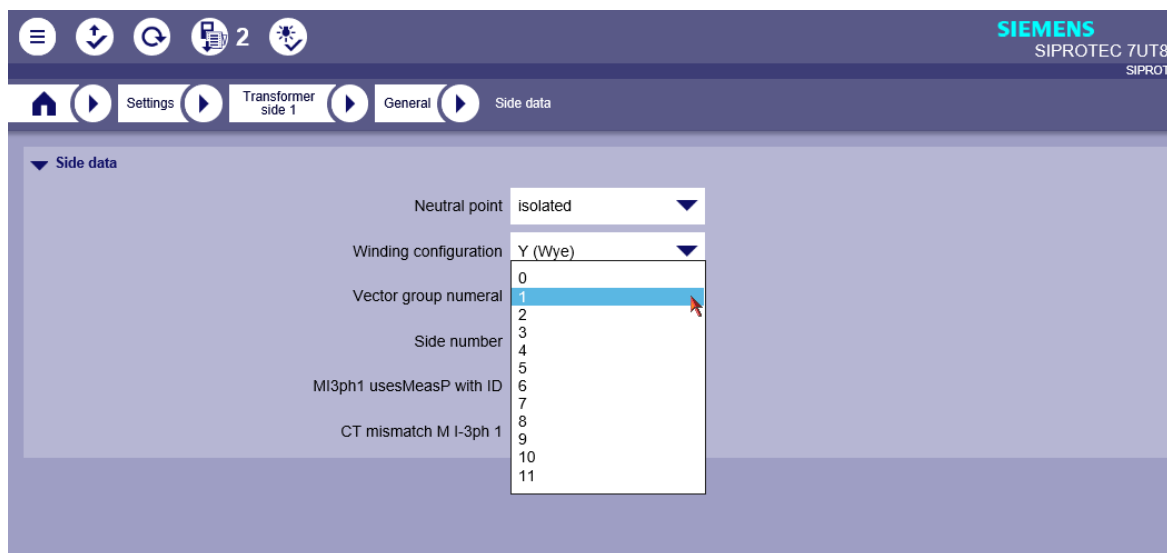


[scseitenda, 1, en_US]

Figure 7-49 Changing the Vector-Group Number

If you have activated the entry of a confirmation ID, proceed as follows:

- ✧ Enter the confirmation ID in the dialog.

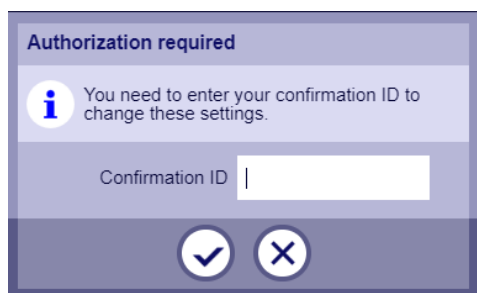

[scconfid, 1, --_--]

Figure 7-50 Confirmation ID Dialog

- ✧ Confirm the entry by clicking the tick.
- ✧ Then, transmit the change to the device by clicking the tick in the upper menu area.



[scapplychange, 1, --_--]

Figure 7-51 Apply Changes

The change is applied and saved in the device.

8 Operation in the Operating State

8.1	Overview	138
8.2	Safety Notes and Access Rights	139
8.3	Operation Options	140
8.4	Indications	146
8.5	Logs	158
8.6	Edit Measured and Metered Values	176
8.7	Fault Recording	183
8.8	Change Device Settings	189
8.9	Control System on Site	202

8.1 Overview

This chapter describes the handling of a SIPROTEC 5 device in the operating state. It contains the following information:

- Reading information from the device
- Affecting the functions of the device in the operating state
- Controlling your system via the device

More detailed information about the function of the device is not needed. You must with be familiar with the principles of operation according to chapter [5 Using On-Site Operation Panel](#) and chapter [6 Using DIGSI 5](#).

Take note that the examples shown are general examples and in terms of wording and detail can vary on the given device depending on variant and configured functional scope. Please refer to the respective device manual for the process data that your device can process.

8.2 Safety Notes and Access Rights

8.2.1 Safety Notes

Authorized Operational Crew



DANGER

Danger due to inadmissible or improper operator control actions

Noncompliance with the safety notes will result in death or severe injuries.

- ✧ Only personnel who are skilled electricians with precise knowledge of the system may operate devices during operation.

-
- ✧ Please carry out all operator control actions in the indicated sequence.
-



NOTE

Operator control actions are password-protected (see chapter [11 Security Settings in the Device](#)). This ensures that only operational crew members with access rights can use the device during operation.

8.3 Operation Options

8.3.1 General

The device is operated via a DIGSI 5 PC or directly on the on-site operation panel. You have the following operating options during operation:

- Readout of indications
- Readout, backup, and deletion of logs and records
- Setting and resetting event counters
- Changing device settings such as date, time, display contrast (only on site on the device) and interface language
- Changing passwords (only with DIGSI 5)
- Changing function parameters and switching of settings groups
- Switching operating modes (for example, test mode)
- Controlling equipment



NOTE

DIGSI 5 Communication

Operation using a DIGSI 5 PC requires a functioning communication connection from the DIGSI 5 PC to the device. For this purpose, you can use the USB interface of the on-site operation panel, the integrated or other Ethernet interfaces.



NOTE

Protection from Operating Errors and Unauthorized Access

- Changes to device settings and the deletion of process data can be saved by entering confirmation IDs. If no action takes place within certain times (device: 3 minutes, DIGSI 5: 10 minutes), an open confirmation query is automatically terminated. Every action carried out within these times restarts the time. After a confirmation query has ended you must confirm changes in device settings again by entering confirmation IDs.
- Before modified settings or the activation of control commands is accepted, there will be additional requests to enter the confirmation ID. You acknowledge these requests directly on the on-site operation panel by pressing the softkey buttons. You confirm the interactive dialog in DIGSI 5 by mouse click.

8.3.2 Online Operation Using DIGSI 5

During online operation, you establish a direct connection to the device to be operated. You use this method for:

- Commissioning
- Test and diagnostics
- Changing settings in the operating state

Online operation with DIGSI 5 is beneficial in these operating modes because you do not first have to create a device in a project. As soon as you have created the corresponding device in a project, however, only operate the device from there. Your settings are then saved on your PC and are available for offline configuration and parameterization tasks.


Procedure

- ✧ First identify all devices reachable via the PC communication interfaces. You can identify your device via the DIGSI 5 project tree.
- ✧ Establish a connection to a selected device.
- ✧ If needed, you can assign a selected device to an existing project.

Device Identification via the DIGSI 5 Project Tree

- ✧ Select the utilized PC interface from **Online access** (a).
- ✧ Click the **Update accessible devices** button (b).

The accessible devices are displayed (c).

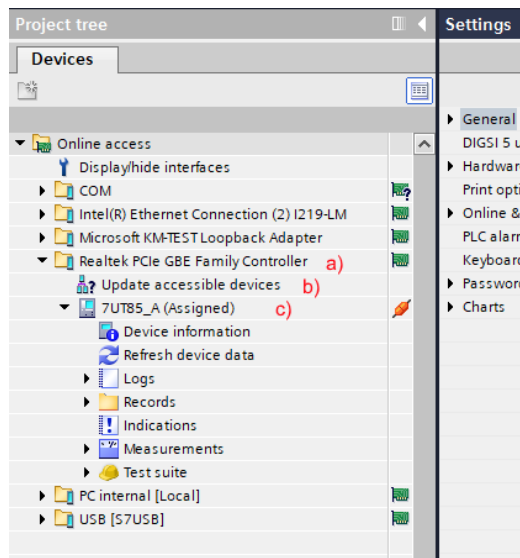


[scgerinf-090718, 1, en_US]

Figure 8-1 Device Identification via the DIGSI 5 Project Tree

Establishing a Connection to Selected Devices

After device identification, the accessible devices are displayed in the project tree under the respective communication interfaces of the PC.

You can now establish a connection to the devices.

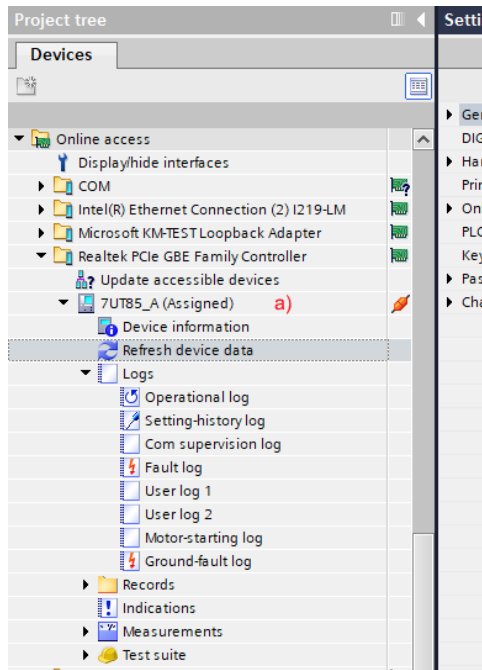

[scwalger-090718, 1, en_US]

Figure 8-2 Device Identification via the DIGSI 5 Project Tree

✧ Under **Online access** → **Interface**, open the desired **device** (a).

The basic information is displayed below the device.

You can find the following tabs in the menu item **Device Information**:

- Device information
- Resource consumption
- Log for device diagnosis and security
- Time Information
- Diagnostic information

✧ Click **Refresh device data** to read the parameter set and the process data of the device. The device data is loaded and the view completed.

You can fully operate and set the connected devices under **Online access** in the DIGSI 5 project tree.

Adding a Selected Device to a Project

You can accept devices identified online into an existing project. The devices are also available for possible offline operation. You can take over the devices in 2 different ways:


✧ Use **Drag & Drop** to assign the online device to the corresponding device created in a project.



NOTE

Make sure that the created device corresponds to the device identified online. Otherwise, it is not taken over into the project.

✧ If you have not done so yet, add the online device to the opened project (see following figure) via the context menu (right mouse click).

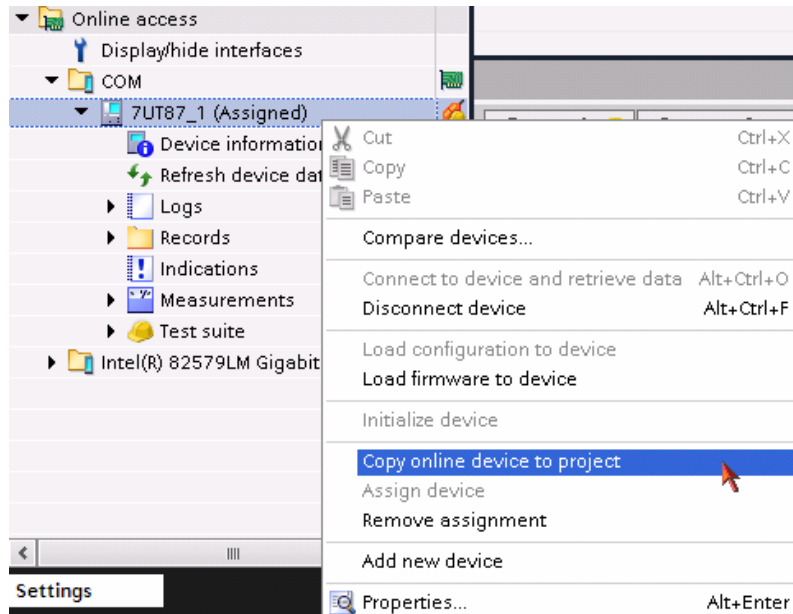

[scprohin-080916-01, 1, en_US]

Figure 8-3 Adding a Selected Device Configuration to a Project

8.3.3 Offline Operation Using DIGSI 5

Offline operation offers you the ability to carry out complete configurations and extensive parameterization of a device. Once you have finished all settings, you can load the configuration from the DIGSI 5 PC to the device. If the loading operation was successful, the device restarts automatically.

Typical Applications of Offline Configuration

- ✧ Creating a configuration by selecting a suitable application template and subsequently adjusting the settings to the individual conditions
- ✧ Reusing a standardized configuration in multiple devices
- ✧ Extensive changes in configurations and setting parameters



NOTE

For a device to be editable offline, you must first have created it in a project. After successful loading of the configuration, the device restarts automatically.

Procedure

- ✧ From the project tree, select the project containing the device to be operated.
- ✧ Select the respective device within the project.
- ✧ Open the device in the project tree.
- ✧ You can now carry out configurations and settings in offline mode.

All the corresponding submenus are listed in the project tree under the device name.

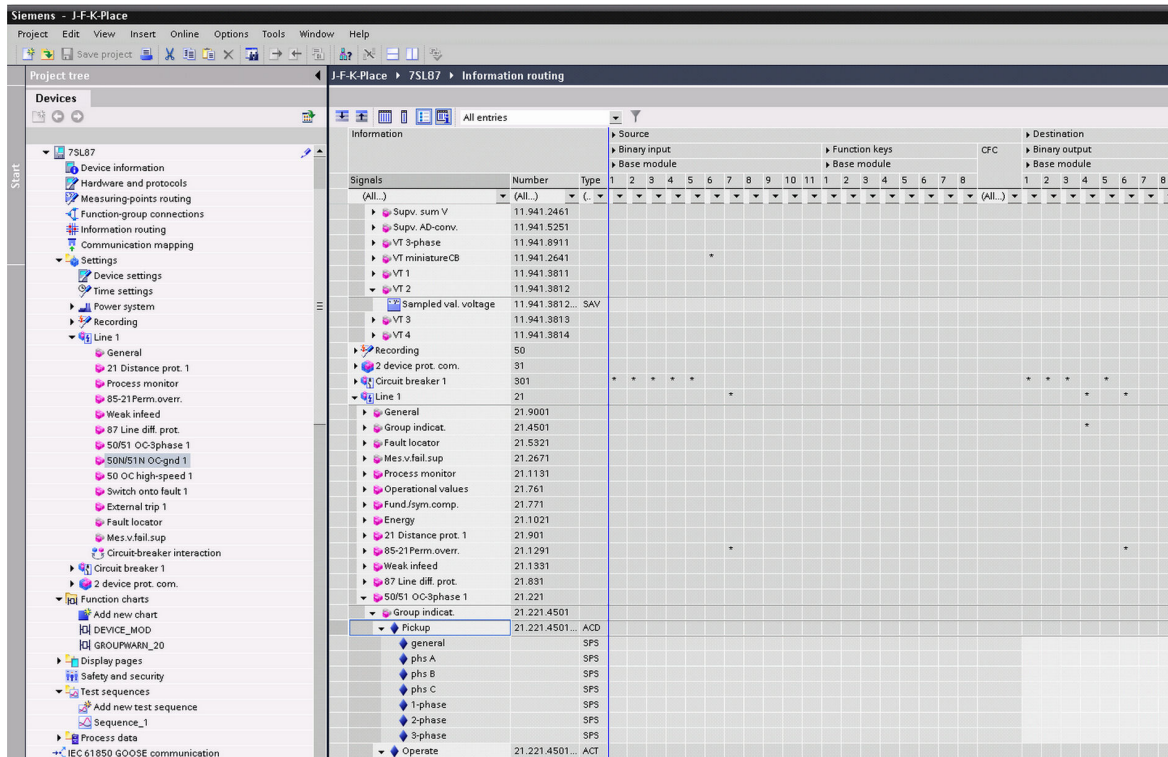


Figure 8-4 Offline Operation of the Device

- ✧ To establish a connection to the device, right-click the device and from the context menu that appears select **Assign device** (*Figure 8-5 a*).
- ✧ Select **Load Configuration to Device** (*Figure 8-5* by right-clicking from the context menu that appears b) and enter the confirmation ID.

The configuration is transferred and the device restarts automatically after successful transmission.

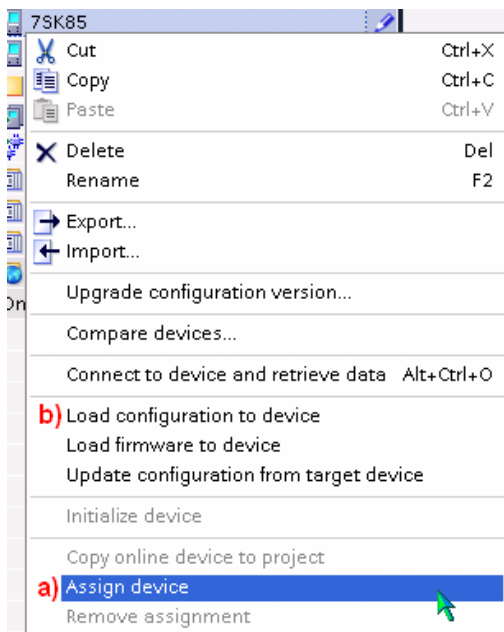


Figure 8-5 Connecting to the Device and Loading the Configuration in Offline Mode

8.3.4 Using the On-Site Operation Panel

You can operate the device directly on the on-site operation panel even without a DIGSI 5 PC. A numerical keypad, navigation and function keys are available to you for this purpose. You have the option between a small or large display.

LEDs allow the display of binary output signals. Key switches offer you optional additional safety for switching operations. You will find detailed descriptions of components of the on-site operation panel and of navigation in the device menu tree in chapter [5 Using On-Site Operation Panel](#).

8.4 Indications

8.4.1 General

During operation, indications deliver information about operational states. These include:

- Measured data
- Power-system data
- Device supervisions
- Device functions
- Function procedures during testing and commissioning of the device

In addition, indications give an overview of important fault events after a failure in the system. All indications are furnished with a time stamp at the time of their occurrence.

Indications are saved in logs inside the device and are available for later analyses. The following number of indications are saved at least in the respective buffer (depending on the scope of the indications):

- Ground-fault log 100 indications
- Fault log 1000 indications
- User-defined log 200 indications
- Operational log 2000 indications
- Motor-starting log 200 indications

If the maximum capacity of the user-defined log or of the operational log is exhausted, the oldest entries disappear before the newest entries. If the maximum capacity of the fault log or of the ground-fault log is reached, the number of the last fault is output via the signal **Fault log is full**. You can route this signal in the information routing. If indications in the information routing of DIGSI 5 are routed to a log, then they are also saved. During a supply-voltage failure, recorded data are securely held by means of battery buffering or storage in the flash memory. You can read and analyze the log from the device with DIGSI 5. The device display and navigation using keys allow you to read and analyze the logs on site.

Indications can be output spontaneously via the communication interfaces of the device and through external request via general interrogation. In DIGSI 5, indications can be tracked spontaneously during online mode in a special indication window. Indications can be made accessible to higher-level control systems through mapping on various communication protocols.



NOTE

All indications are assigned to certain device functions. The text of each indication contains the corresponding function designation. You will find explanations of the meaning of indications in the corresponding device functions. However, you can also define indications yourself and group them into your own function blocks. These can be set by binary inputs or CFC logic.

Reading Indications


To read the indications of your SIPROTEC 5 device you can use the on-site operation panel of the device or a PC on which you have installed DIGSI 5. The subsequent section describes the general procedure.

8.4.2 Reading Indications on the On-Site Operation Panel

Procedure

The menus of the logs begin with a header and 2 numbers at the top right corner of the display. The number after the slash signifies the number of indications that are available. The number before the slash indicates

how many indications have just been selected or shown. The end of the indication list is closed with the entry ***END***.

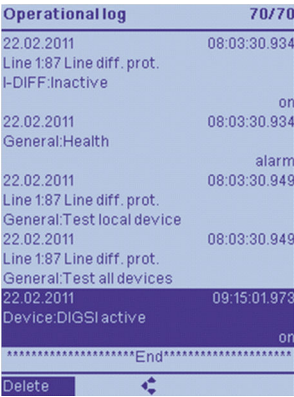

[scoprlg-090413-01.tif, 1, en_US]

Figure 8-6 On-Site Display of an Indication List (Example: Operational Indications)

Menu Path	Log
Main menu → Indications →	Operational log Fault log Ground-fault log Setting changes User indications 1 User indications 2 Motor-starting indications Communication-supervision log
Main Menu → Test & Diagnosis → Log →	Device diagnosis Security indications Communication indications

To reach the desired log from the main menu, use the navigation keys of the on-site operation panel.

- ✧ Navigate inside the log using the navigation keys (top/bottom). You will find the most current indication at the top of the list. The selected indication is shown with a dark background.

Which indications can be shown in the selected log depends on the assignments in the DIGSI 5 information routing matrix or is predefined. Every indication contains date, time and its state as additional information. You will find information about this in chapter [8.5.1 General](#).

In some logs you are given the option of deleting the entire indication list by softkey in the footer of the display. To learn more about this, read chapter [8.5.12 Saving and Deleting the Logs](#).



NOTE
No password entry is necessary to read indications from the device.

8.4.3 Reading Indications from the PC with DIGSI 5

Procedure


Menu Path (Project)	Log
Project → Device → Process data → Log →	Operational log Setting changes Communication-supervision log Fault log User indications 1 User indications 2 Motor-starting log Ground-fault log
Online access → Device → Device information → Logs tab →	Device-diagnosis log Security indications
Online access → Device → Test suite → Communica- tion module →	Communication indications

To read the indications with DIGSI 5 your PC must be connected via the **USB user interface** of the on-site operation panel or via an **Ethernet interface** of the device. You can establish a direct connection to your PC via the Ethernet interfaces. It is also possible to access all connected SIPROTEC 5 devices via a data network from your DIGSI 5 PC.

- ✧ You reach the desired logs of the SIPROTEC 5 device using the project-tree window. If you have not created the device within a project, you can also do this via the **Online access** menu item.

After selecting the desired log, you are shown the last state of the log loaded from the device. To update, it is necessary to synchronize with the log in the device.

- ✧ Synchronize the log. For this purpose, click the appropriate button in the headline of the log (see the ground-fault indications example in [Figure 8-7 a\)](#)).

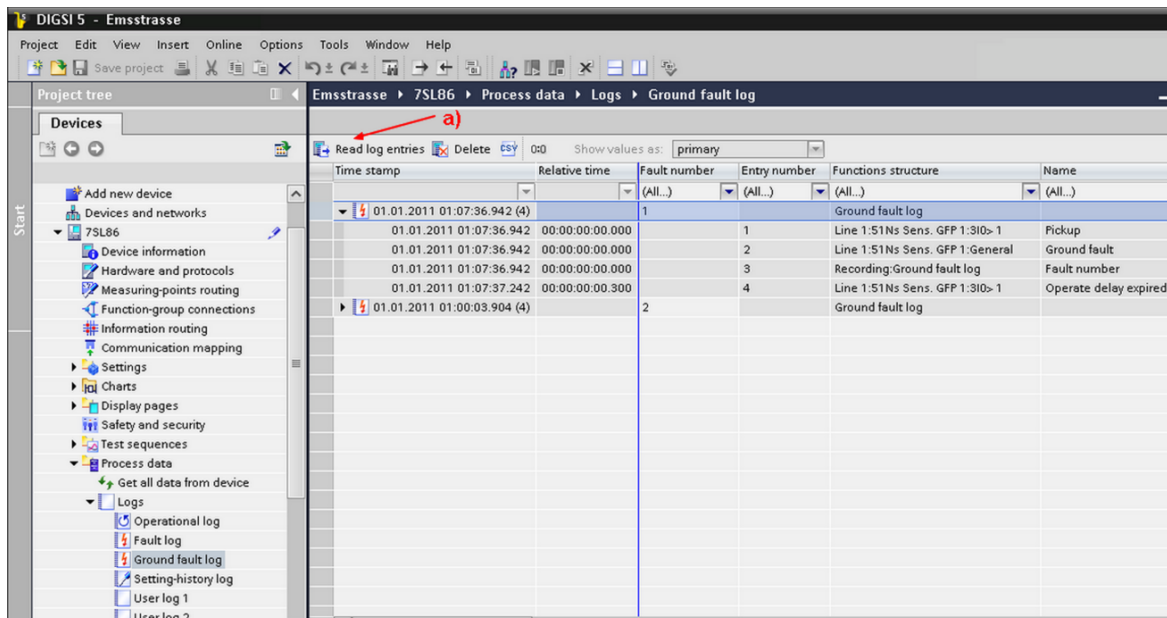

[scgrflmd-191012-01, 1, en_US]

Figure 8-7 DIGSI 5 Display of an Indication List (Example of Ground-Fault Log)

You will find additional information about deleting and saving logs in chapter [8.5.12 Saving and Deleting the Logs](#).

Which indications can be shown in the selected log depends on the assignments in the DIGSI 5 information routing matrix or is predefined. You will find information about this in chapter [8.5.1 General](#).

Setting Relative Time Reference

- ✧ Reference the display of log entries, if needed, to the real time of a specific entry. In this way, you determine a relative time for all other indications. The real-time stamps of events remain unaffected.

8.4.4 Displaying Indications

Displayed indications are supplemented in DIGSI 5 and on the on-site operation panel with the following information:

Table 8-1 Overview of Additional Information

Indications in	DIGSI 5 Information	Device Display Information
Log for operational indications and log for user-defined indications	Time stamp (date and time), Relative time, Entry number, Function structure, Name, Value, Quality, Cause, Number	Time stamp (date and time), Function structure, Name, Value
Log for fault indications	Time stamp (date and time), Relative time, Fault number, Entry number, Function structure, Name, Value, Quality, Cause, Number	Time stamp (date and time), Fault number, Value
Log for motor-starting indications	Time stamp (date and time), Motor-starting time, Starting current, Starting voltage, Starting duration	Time stamp (date and time), Function structure, Name, Value
Log for ground-fault indications	Time stamp (date and time), Relative time, Fault number, Entry number, Function structure, Name, Value, Indication number, Quality, Cause, Number	Time stamp (date and time), Fault number, Value

Indications in	DIGSI 5 Information	Device Display Information
Log for parameter changes	Time stamp (date and time), Relative time, Entry number, Function structure, Name, Value, Quality, Cause, Number	Time stamp (date and time), Function structure, Name, Value
Spontaneous indication window (DIGSI 5)	Time stamp (date and time), Relative time, Indication, Value, Quality, Additional Information	Time stamp (date and time), Fault number, Value
Log for safety indications ¹	Time stamp (date and time), Indication number, Indication	Time stamp (date and time), Indication
Log for device-diagnostic indications ¹	Time stamp (date and time), Indication number, Indication	Time stamp (date and time), Indication
Log for communication indications ¹	Time stamp (date and time), Indication number, Indication	Time stamp (date and time), Indication
Log for communication supervision (GOOSE)	Time stamp (date and time), Relative time, Entry number, Function structure, Name, Value, Quality, Cause, Number	Time stamp (date and time), Function structure, Name, Value

Overview of Displayed Quality Attributes

If values are shown on the device display or in DIGSI, the following quality attributes are different for measured values and metered values.

Table 8-2 Measured Values

IEC 61850				Device Display/ DIGSI	Description
Detail Quality	Validity				
	Good	Invalid	Questionable		
–	X			Value	The measured value is valid.
Failure		X		Fault	The device is defective. Contact Support.

¹ Only online access

IEC 61850				Device Display/ DIGSI	Description
Detail Quality	Validity				
	Good	Invalid	Questionable		
Inaccurate			X	---	The measured value was not calculated (for example, the angle between current and voltage if 1 of the 2 variables is missing).
Bad Reference			X	≈ Value	The measured value can be inaccurate (for example, outside the frequency-tracking range).
Out of Range			X	> Value	The measured value exceeds the measuring range.

Table 8-3 Metered Values

IEC 61850			Device Display/ DIGSI	Description
Validity				
Good	Invalid	Questionable		
X			Value	The metered value is invalid.
	X		---	The metered value was not calculated.
		X	≈ Value	The metered value has no reference.

Indication Columns

The following table shows the meaning of the individual columns in the log:

Indication Column	Meaning
Time stamp	Time stamp of the indication in device time using the local time zone of the device or the query time for the motor log
Relative time	Relative time to a reference entry
Error number	Number of the error that occurred in the device. This number increments continuously.
Entry number	Entry identification of buffer entries. This identification displays the sequence of buffer entries.
Indication number	Number of the indication that occurred in the device. This number increments continuously and is necessary for an analysis by Siemens.
Indication	Indication text
Function structure	Path of the signal with the signal name
Name	Signal name
Value	Current state of the command. Also pay attention to the value quality to check whether the value is up to date.
Quality	The quality of the value shows the source of the value and whether the value is up to date.
Cause	Additional information such as the cause and validity
Number	DIGSI address of the signal
Motor startup time	Time of motor starting
Starting current	Current needed by the motor to start up
Starting voltage	Voltage needed by the motor to start up
Start duration	Time needed by the motor to start up

8.4.5 Spontaneous Indication Display in DIGSI 5

With DIGSI 5 you have the possibility of displaying all currently transmitted indications of the selected device in a special indication window.

Procedure

- Call up the spontaneous indications of your selected device in the navigation window under Online access.
- Click **Indications** in the path:
Online access → Interface → Device → **Indications**
- The raising indications appear immediately without you having to wait for a cyclical update or initiate the manual update.

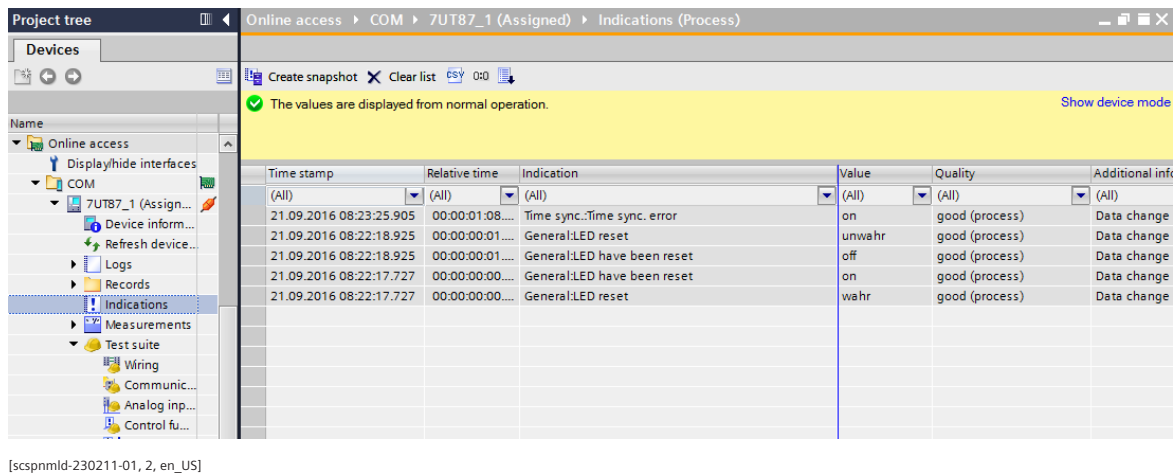



Figure 8-8 Displaying Spontaneous Device Indications in DIGSI 5

8.4.6 Spontaneous Fault Display on the On-Site Operation Panel

After a fault, the most important data of the last fault can be displayed automatically on the device display without further operational measures. In SIPROTEC 5 devices, protected objects and even circuit breakers can be freely created and configured depending on the application (even several instances). In DIGSI 5, several spontaneous fault displays can be configured, depending on the application, with each individual one being assigned a particular circuit breaker. These displays remain stored in the device until they are manually confirmed or released by LED reset.

Configuration of a Spontaneous Fault Display with DIGSI 5

- To reach the **Fault-display configuration** of your SIPROTEC 5 device, use the project-tree window.
Project → Device → Display pages → **Fault-display configuration**
- In the main window, all configured circuit breakers are displayed. A list of a maximum of 6 configurable display lines is offered for each circuit breaker. The activation of a spontaneous fault display occurs for each circuit breaker by selection via checkmark in the column **Display**.
- With the parameter (**_:139**) **Fault-display** (under Device → Parameter → Device settings) you determine whether spontaneous fault displays should be shown for each pickup or only pickups with the trip command.

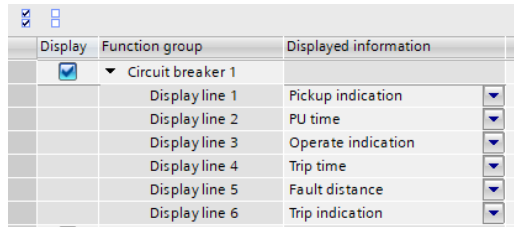

[sckonstf-230211-01, 2, en_US]

Figure 8-9 Configuration of the Spontaneous Fault Display on the Device


For every display line the following display options can be selected:

Table 8-4 Overview of Display Options

Displayed Information	Explanation
Pickup indication	Display of the first function stage picked up in a fault, as needed with auxiliary information (phases, ground, direction)
PU time	Display of the entire pickup duration of the fault
Operate indication	Display of the first function stage triggered in a fault, as needed with auxiliary information (phases)
Trip time	Display of the operate time related to the beginning of the fault (pickup start)
Fault distance	Display of the measured fault-location distance
Operate result indication	Display of the control or switching device triggered in a fault, with auxiliary information (phases) where necessary

Acknowledgment of the Spontaneous Fault Display on the Device

After faults, the last occurred fault is always displayed to you. In cases where more than one circuit breaker is configured, several stored fault displays can be present after faults, with the latest being displayed. These displays remain stored in the device until manual acknowledgment or release by LED reset.

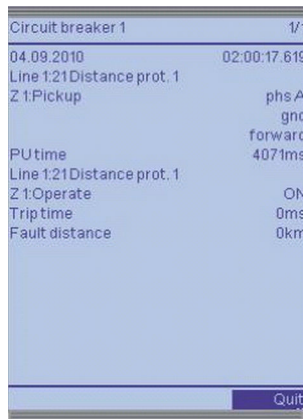

[scstfanz-090413-01.tif, 1, en_US]

Figure 8-10 Spontaneous Fault Display on the Device

Method 1: Manual acknowledgment

- Press the softkey button **Quit** in the base bar of the display. The display is irretrievably closed. Repeat this step until no further spontaneous fault displays appear.
- After completion of all confirmations the last display view is showed before the faults.

Method 2: Acknowledgment via LED reset

- An LED reset (device) causes the reset of all stored LEDs and binary output contacts of the device and also to the confirmation of all fault displays stored in the display.

You can find more details on the topic of LED reset in chapter [8.4.7 Stored Indications in the SIPROTEC 5 Device](#)

8.4.7 Stored Indications in the SIPROTEC 5 Device

In your SIPROTEC 5 device, you can also configure indications as **stored**. This type of configuration can be used for LEDs as well as for output contacts. The configured output (LED or contact) is activated until it is acknowledged. Acknowledgment occurs via:

- On-site operation panel
- DIGSI 5
- Binary input
- Protocol of substation automation technology

Configuration of Stored Indications with DIGSI 5

In the **Information Routing** of each device set up in DIGSI 5, you can route binary signals, among others, to LEDs and output contacts.

- To do this, proceed in the project tree to:
Project → Device → **Information routing**
- Right-click the routing field of your binary indication in the desired LED or binary output column in the routing range of the targets.

You are offered the following options:

Table 8-5 Overview of Routing Options

Routing Options		LEDs	BOs	BIs	Description
H	(active)			X	The signal is routed as active with voltage.
L	(active)			X	The signal is routed as active without voltage.
V	(unlatched)	X	X		The signal is routed as unlatched. Activation and reset of the output (LED, BO) occurs automatically via the binary-signal value.
G	(latched)	X	X		The binary signal is latched when the output (LED) is activated. To reset, a targeted confirmation must occur.

Routing Options		LEDs	BOs	BlS	Description
NT	(conditioned latching)	X			Fault indications are stored during control of the output (LED) as a function of the parameter (_ : 91 : 139) Fault-display. In the event of a new fault, the previously stored states are reset. - If the fault gets terminated via a trip command from the assigned circuit breaker, the status of an indication remains as latched with the setting option with trip. Without a trip command, the status is displayed before the fault (if necessary, the status of the last fault) is restored. - With the setting option with pickup the current indication image of a pickup gets stored. The image comprises all indications of functions that are effective in the event of tripping on the same circuit breaker, like the picked up function. The following applies to the busbar protection: - If the fault gets terminated via a trip command, the status of an indication remains as latched with the setting option with trip. This occurs separately for the following tripping cases: - Trippings caused by busbar protection (busbar differential protection, busbar tripping following a circuit-breaker failure protection trip in the bay or busbar tripping due to external tripping) - Trippings caused by functions within the corresponding bay (for example, end-fault protection, circuit-breaker failure protection trip repeat or overcurrent protection) - With the setting option with pickup, the current indication image is saved using the same rules as with the setting with trip but together with the pickup of the protection function.
TL	(stored only with tripping)		X		Routing option TL (tripping stored) is only possible for the switching object circuit breaker. The output is saved with protection tripping. The contact remains activated until acknowledged. Control commands are not affected. A control command is pending above the parameterized command period until feedback has been successfully received. Note: You can realize the functionality of the Lockout (ANSI 86) by storing the output relay with the routing option TL.

8.4.8 Acknowledgment of Stored Indications

Acknowledgment on the On-Site Operation Panel

Acknowledgment via **LED Reset** key

Operating the key first causes the activation of all LEDs (LED test) when pressed, and when released, the resetting of all stored indications. Stored LEDs, output contacts, and spontaneous fault displays are reset.

Acknowledgment via the **operating menu**

- Log on to the device.
- In order to reach the **reset functions** from the main menu, use the navigation buttons of the on-site operation panel.
- Select on the device display:
Main menu → Device functions → **Reset functions**

You will be offered different **Reset functions**.

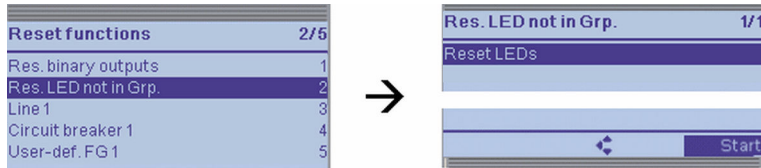


Figure 8-11 Reset Functions on the On-Site Operation Panel (Example)

Detailed overview of the **Reset functions**:

Res. Binary Outputs

- Log on to the device.
- Use **Res. binary outputs** to reset stored output contacts.
- Actuate the softkey **Start** in the base bar.

The device display will then briefly display the indication **Cmd. exec. Succeeded**.

Res. LED not in Grp.

- Log on to the device.
- Use **Res. LED not in Grp.** to reset stored LEDs that are not assigned to a special function group.
- Actuate the softkey **Start** in the base bar.

The device display will then briefly display the indication **Order successfully saved**.

Depending on the device configuration, other protection function groups are displayed to you as submenus for which separately corresponding, stored LEDs can be reset. Proceed with the other function groups as shown in the following example.

Line 1 (example)

- Go to the submenu of the selected function group (example **Line 1**).
- Use **Reset LEDs** to reset stored LEDs in the selected function group.
- Actuate the softkey **Start** in the base bar.

The device display will then briefly display the indication **Order successfully saved**.



Figure 8-12 Reset Functions on the On-Site Operation Panel (for Example, Line FG)


Acknowledgment of Stored Indications via Binary Inputs

Acknowledgment by binary input **>LED-Reset** switches on all LEDs (LED Test). After signal dropout, all stored indications, stored LEDs, output contacts, and spontaneous fault displays are reset.

Acknowledgment of Stored Indications with DIGSI 5

You can acknowledge stored indications via DIGSI 5 in online mode.

- For this, go to the project tree.
- Select:
Online access → Interface → Device → **Device information**
- Select the **Device information** tab.

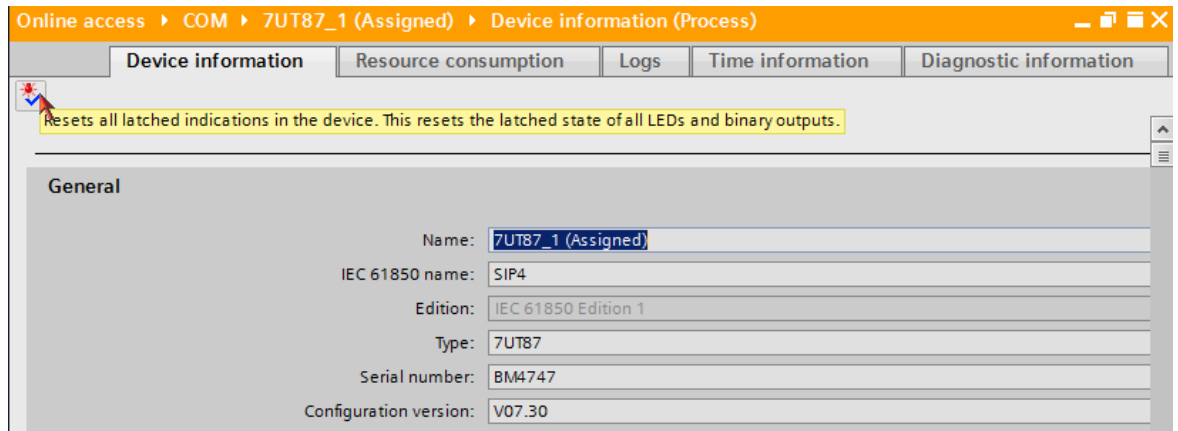

[scquiled-140912-01, 2, en_US]

Figure 8-13 LED Reset via DIGSI 5

- Click the LED reset button.

Stored LEDs, output contacts, and spontaneous fault displays are reset on the assigned device.

Acknowledgment of Stored Indications via Log

You can also initiate acknowledgment of stored indications by communicating through connected substation automation technology. This can occur in conformance to standards (IEC 61850, IEC 60870-5-103) or via configuration (mapping) of the LED reset input signal for any protocol. Stored LEDs, output contacts, and spontaneous fault displays are reset.



NOTE

As long as there are no active **unstored** indications at the output contacts and configured LEDs, the acknowledgment of **stored** indications resets the LEDs and output contacts.

8.4.9 Test Mode and Influence of Indications on Substation Automation Technology

If the test mode of the device or of individual functions is switched on, the SIPROTEC 5 device marks indications sent to substation automation technology station control system with an additional test bit. This test bit makes it possible to determine that an indication was set during a test. Necessary reactions in normal operation on the basis of an indication can thus be suppressed.

8.5 Logs

8.5.1 General

Indications are saved in logs inside the device and are available for later analyses. Different logs allow categorization of indication logging based on operating states (for example, operational and fault logs) and based on fields of application.

Table 8-6 Log Overview

Log	Logging
Operational log	Operational indications
Fault log	Fault indications
Ground-fault log	Ground-fault indications
Setting-history log	Setting changes
User-defined log	User-defined indication scope
Security log	Access with safety relevance
Device-diagnosis log	Error of the device (software, hardware) and the connection circuits
Communication log	Status of communication interfaces
Motor-startup log	Information on the motor startup
Communication-supervision log	Communication supervision (GOOSE)

Log Management

Logs have a ring structure and are automatically managed. If the maximum capacity of a log is exhausted, the oldest entries disappear before the newest entries. If the maximum capacity of the fault or ground-fault log is reached, the number of the last fault is generated via the signal **Fault log is full**. You can route this signal in the information routing. If indications in the information routing of DIGSI 5 are routed to a log, then they are also saved. During a supply-voltage failure, recorded data are securely held by means of battery buffering or storage in the flash memory. You can read and analyze the log from the device with DIGSI 5. The device display and the navigation allow you to read and evaluate the logs on site using keys.

Configurability of Logs

The indication capacity to be recorded in configurable logs (for example, ground-fault log) is laid down in columns of the information routing (matrix) of DIGSI 5 specifically defined for this purpose.


Procedure

To reach the information routing of your SIPROTEC 5 device, use the project-tree window. Access is only through the project:

- Open the information routing.
Project → Device → **Information routing**
- Select the appropriate routing column.
Destination → Logs → Column **Ground-fault log (G)**

The routing of the selected indication is done via right click.

- Select one of the options in the list box shown:
 - Routed (X)
 - Unrouted

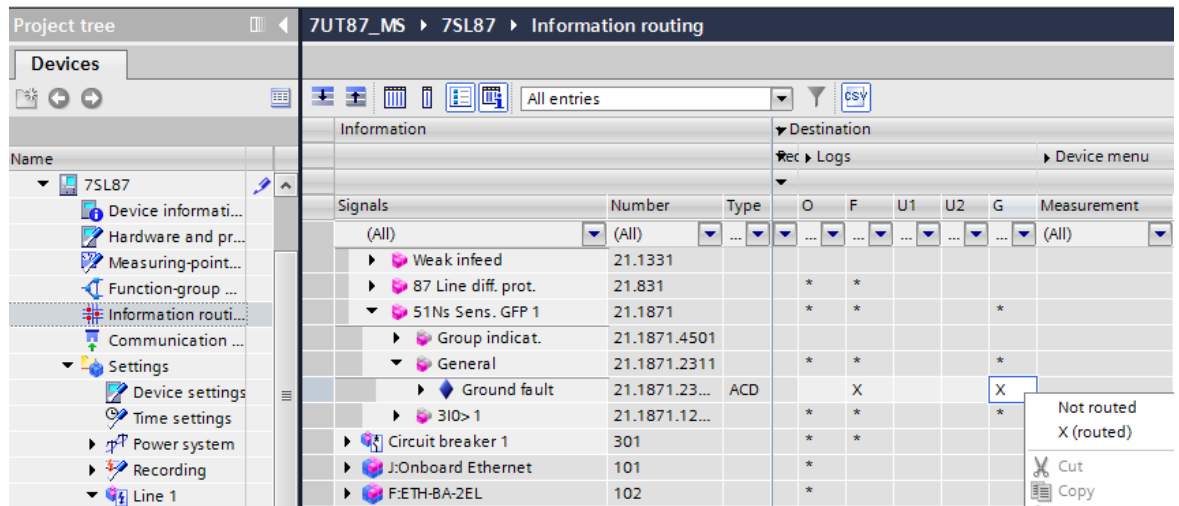

[scinfuf-191012-01, 2, en_US]

Figure 8-14 Indication Configuration in DIGSI 5 (Example: Ground-Fault Log, Column G)

For non-configurable logs (for example, setting-history logs) scope and type of logged indications are described separately (see following chapter about logs).

8.5.2 Operational Log


Operational indications are information that the device generates during operation. This includes information about:

- State of device functions
- Measured data
- Power-system data

Exceeding or dropping below limiting values is output as an operational indication. Short circuits in the network are indicated as an operational indication **Fault** with sequential fault number. For detailed information about the recording of system incidents, please refer to the description of the fault log (chapter [8.5.3 Fault Log](#)). Up to 2000 indications can be stored in the log.

Reading from the PC with DIGSI 5

- To reach the operational log of your SIPROTEC 5 device, use the project-tree window.
Project → Device → Process Data → Log → **Operational log**
- The status of the operational log last loaded from the device is shown to you. To update (synchronization with the device), click the button **Read log entries** in the headline of the indication list ([Figure 8-15 a](#)).

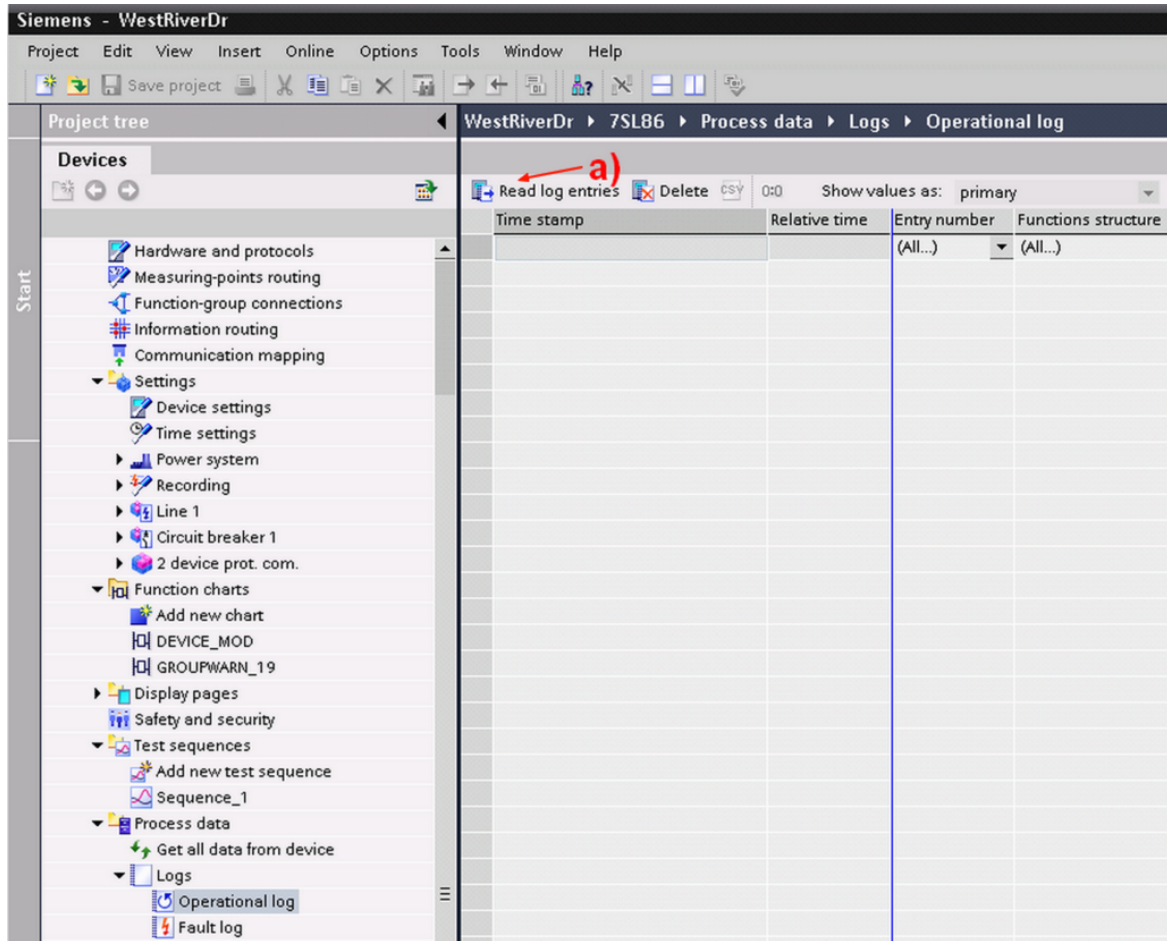

[scbetrm-d-030211-01, 1, en_US]

Figure 8-15 Reading the Operational Log with DIGSI 5

Reading on the Device via the On-Site Operation Panel

- To reach the operational log via the main menu, use the navigation keys of the on-site operation panel. Main Menu → Indications → **Operational log**
- You can navigate within the displayed indication list using the navigation keys (up/down) on the on-site operation panel.
- Using the **Info** softkey, you can retrieve auxiliary information on the entry depending on the context.

Operational log 117/222	
08.12.2016	08:19:24.117
Tap changer 1	
Tap changer:Position	
	OPR+ lower
08.12.2016	08:19:25.616
Tap changer 1	
Tap changer:Lower command	
	off
08.12.2016	08:19:34.116
Tap changer 1	
Tap changer:Position failure	
	on
08.12.2016	08:19:34.116
Tap changer 1	
Tap changer:Position	
	invalid
	CMT-
Delete	Info

Operational log 117/222	
08.12.2016	08:19:24.117
Tap changer 1	
Tap changer:Position	
	OPR+ lower
08.12.2016	08:19:25.616
Tap changer 1	
Tap changer:Lower command	
	off
08.12.2016	08:19:34.116
Tap changer 1	
Tap changer:Position failure	
	on
Additional information	
bay control	
superv. time expired	
Esc	

[scoperlog1-081217-01, 1, en_US]

Figure 8-16 On-Site Display of an Indication List (Example: Operational Indications)

Deletability

The operational log of your SIPROTEC 5 device can be deleted. This is done usually after testing or commissioning the device. To know more about this, read chapter [8.5.12 Saving and Deleting the Logs](#).

Configurability

The indication scope of the operational log is configured in a specifically defined column of the information routing (matrix) of DIGSI 5:

Target → Log → **Operational log** column

Selected application templates and functions from the library bring with them a predefined set of operational indications which you can adjust individually at any time.

8.5.3 Fault Log

Fault indications are events which arise during a fault. They are logged in the fault log with real-time stamp and relative-time stamp (reference point: fault occurrence) . Faults are numbered consecutively in rising order. With fault recording engaged, a corresponding fault record with the same number exists for every fault logged in the fault log. A maximum of 128 fault logs can be stored. A maximum of 1000 indications can be recorded in each fault log.

Fault Definition

In general, a fault is started by the raising pickup of a protection function and ends with the cleared pickup after the trip command.

When using an automatic reclosing function, the complete reclosing cycle (successful or unsuccessful) is preferably integrated into the fault. If evolving faults appear within reclosing cycles, the entire clearing process is logged under one fault number even in multiple pickup cycles. Without automatic reclosing function every pickup is also recorded as its own fault.

User-defined configuration of a fault is also possible.



NOTE

The definition of the fault is done through settings of the fault recording (see Device manual). Events are logged in the fault log even when fault recording is switched off.


Apart from the recording of fault indications in the fault log, spontaneous display of fault indications of the last fault on the device display is also done. You will find details about this in chapter [8.4.6 Spontaneous Fault Display on the On-Site Operation Panel](#).

Deletability

The fault log of your SIPROTEC 5 device can be deleted. You will find details about this in chapter [8.5.12 Saving and Deleting the Logs](#).

Reading on the Device through the On-Site Operation Panel

- To reach the fault log from the main menu, use the navigation keys of the on-site operation panel.
Main Menu → Indications → **Fault logs**
- You can navigate within the displayed indication list using the navigation keys (up/down) on the on-site operation panel.

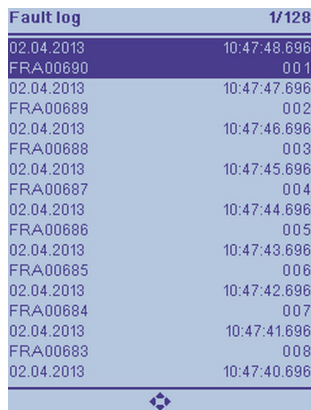

Fault log	1/128
02.04.2013	10:47:48.696
FRA00690	00.1
02.04.2013	10:47:47.696
FRA00689	00.2
02.04.2013	10:47:46.696
FRA00688	00.3
02.04.2013	10:47:45.696
FRA00687	00.4
02.04.2013	10:47:44.696
FRA00686	00.5
02.04.2013	10:47:43.696
FRA00685	00.6
02.04.2013	10:47:42.696
FRA00684	00.7
02.04.2013	10:47:41.696
FRA00683	00.8
02.04.2013	10:47:40.696

[scfaullg-090413-01.tif, 1, en_US]

Figure 8-17 Reading the Fault Log on the On-Site Operation Panel of the Device

Configurability

The indication scope of the fault log is configured in a specifically defined column of the information routing (matrix) of DIGSI 5:

Target → Log → **Fault log** column

Selected application templates and functions from the library already bring a predefined set of operational indications with them which you can adjust individually at any time.

The operational measured values and the measured values of the fundamental components and symmetrical components (see Device Manual) are calculated every 9 cycles (at 50 Hz, this is every 180 ms). However, this can mean that the data are not synchronized with the sampled values of the analog channels. The recording of these measured values can be used to analyze the slowly changing processes.

8.5.4 Ground-Fault Log

Ground-fault indications are events which arise during a ground fault. They are logged in the ground-fault log with real-time stamp and relative-time stamp (reference point: ground-fault occurrence). Ground faults are numbered consecutively in rising order. A maximum of 10 ground-fault logs are stored, and for each ground-fault log it is guaranteed that at least 100 indications are recorded.

The following functions can start the logging of a ground fault with the raising ground-fault indication:

- **Directional sensitive ground-fault protection for deleted and isolated systems** (67Ns)
- **Sensitive ground current protection with I0** (50Ns/51Ns)
- **Intermittent ground-fault protection**


The logging ends with the clearing ground-fault indication.

Reading from the PC with DIGSI 5

- To reach the ground-fault log of your SIPROTEC 5 device, use the project-tree window.
Project → Device → Process data → Logs → **Ground-fault log**

The status of the device-diagnosis log last loaded from the ground-fault log is shown to you.

- To update (synchronization with the device) click the button **Read log entries** in the headline of the indication list ([Figure 8-18 a](#))).

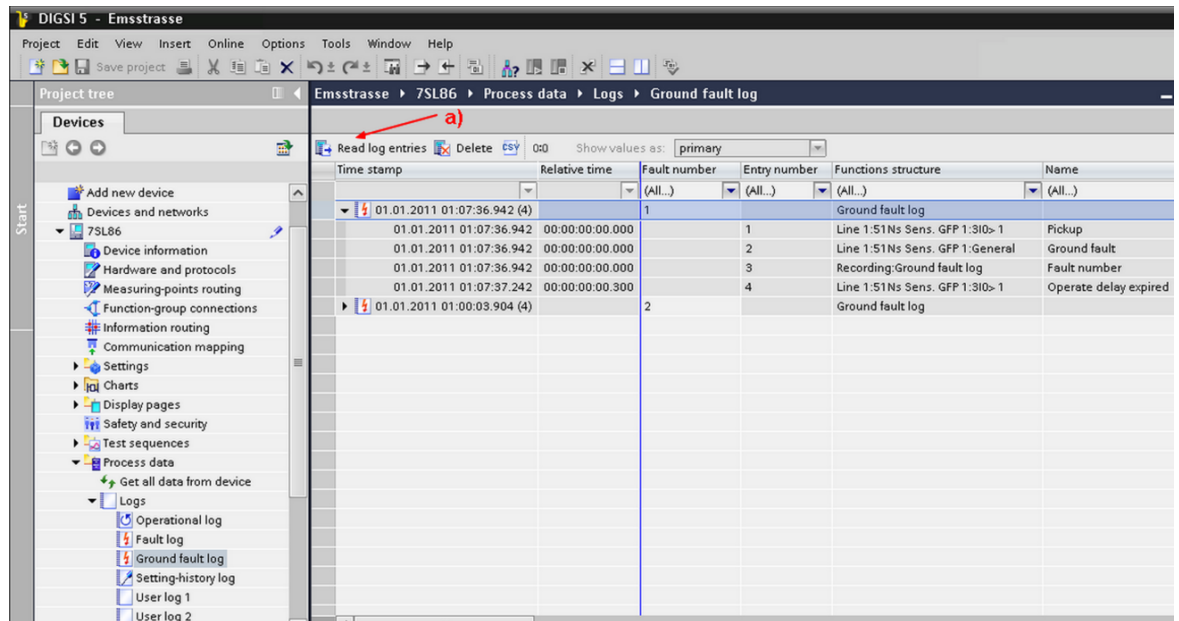


[scgrflmd-191012-01, 1, en_US]

Figure 8-18 Reading the Ground-Fault Log with DIGSI 5

Reading on the Device through the On-Site Operation Panel

- To reach the ground-fault log from the main menu, use the navigation keys of the on-site operation panel.
Main menu → Indications → **Ground-fault indication**
- You can navigate within the displayed indication list using the navigation keys (up/down) on the on-site operation panel.

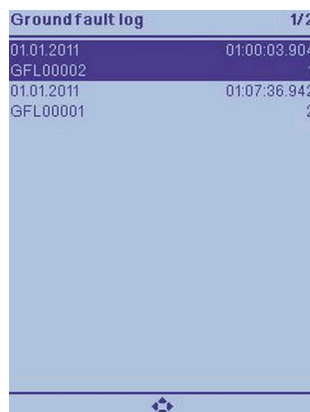

[scgflg1-191012-01.tif, 1, en_US]

Figure 8-19 Reading the Ground-Fault Log on the On-Site Operation Panel of the Device

Deletability

The ground-fault log of your SIPROTEC 5 device can be deleted. Read details about this in chapter [8.5.12 Saving and Deleting the Logs](#).

Configurability

The indication scope of the ground-fault log is configured in a specifically defined column of the information routing (matrix) of DIGSI 5:

Target → Log → Column **Ground-fault log**

Selected application templates and functions from the library already bring a predefined set of operational indications with them which you can adjust individually at any time.

8.5.5 Setting-History Log


All individual setting changes and the downloaded files of entire parameter sets are recorded in the log for setting changes. This enables you to determine setting changes made are associated with events logged (for example faults). On the other hand, it is possible to obtain verification with fault analyses, for example, that the current status of all settings truly corresponds to their status at the time of the fault. Up to 200 indications can be stored in the setting-history log.

Reading from the PC with DIGSI 5

- To reach the log for setting changes of your SIPROTEC 5 device, use the project-tree window.
Project → Device → Process data → Log → **Setting changes**

The status of the setting-history log last loaded from the device is shown to you.

- To update (synchronization with the device), click the **Read log entries** button in the headline of the indication list ([Figure 8-20](#)).

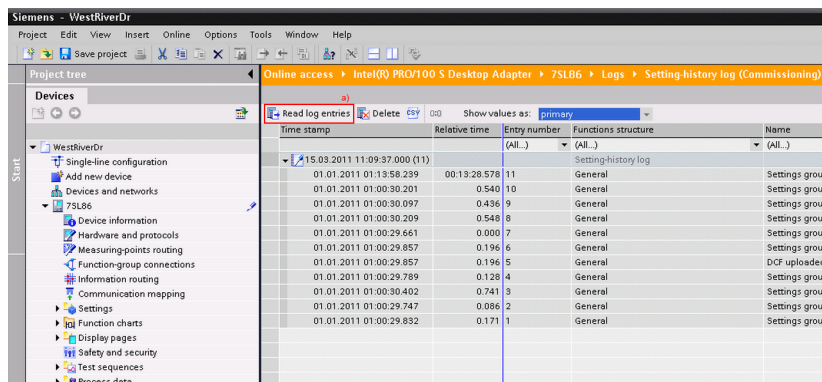

[scparamd-030211-01, 1, en_US]

Figure 8-20 Reading the Setting-History Log with DIGSI 5

Reading on the Device through the On-Site Operation Panel

- To reach the setting-history log from the main menu, use the navigation keys of the on-site operation panel.
Main menu → Indications → **Setting changes**
- You can navigate within the displayed indication list using the navigation keys (up/down) on the on-site operation panel.



[schislog-090413-01.tif, 1, en_US]

Figure 8-21 Reading the Setting-History Log on the On-Site Operation Panel of the Device

Indication Categories in the Setting-History Log

For this log, there is selected information that is stored in case of successful as well as unsuccessful setting changes. The following list gives you an overview of this information.

Table 8-7 Overview of Indication Types

Displayed Information	Explanation
Selection edit+	Selection of settings group to be edited
Cancellation+	Cancelling of all changes successful
SG activation+	SG activation via command successful
SG activation-	SG activation via command failed
Set+	Parameter value was changed
Confirmation+	Confirmation of change successful
Confirmation-	Confirmation of change failed
DCF uploaded	DCF loaded into device
SG 1	Settings group 1
SG 2	Settings group 2
SG 3	Settings group 3
SG 4	Settings group 4
SG 5	Settings group 5
SG 6	Settings group 6
SG 7	Settings group 7
SG 8	Settings group 8



NOTE

- The logged indications are preconfigured and cannot be changed!
- The log, which is organized as a ring buffer, cannot be deleted by the user!
- If you want to archive security-relevant information of the device without loss of information, you must regularly read this log.
- You cannot route additional indication objects to the setting-history log.

8.5.6 User Log


With the user-defined log (up to 2), you have the possibility of individual indication logging parallel to the operational log. This is helpful, for example, in special monitoring tasks but also in the classification into different areas of responsibility of the logs. Up to 200 indications can be stored in the user-defined log.

Reading from the PC with DIGSI 5

- To reach the user-defined log of your SIPROTEC 5 device, use the project-tree window.
Project → Device → Process Data → Log → **User log 1/2**

The status of the user-defined log last loaded from the device is shown to you.

- To update (synchronization with the device) click the button **Read log entries** in the headline of the indication list (Figure 8-22 a)).

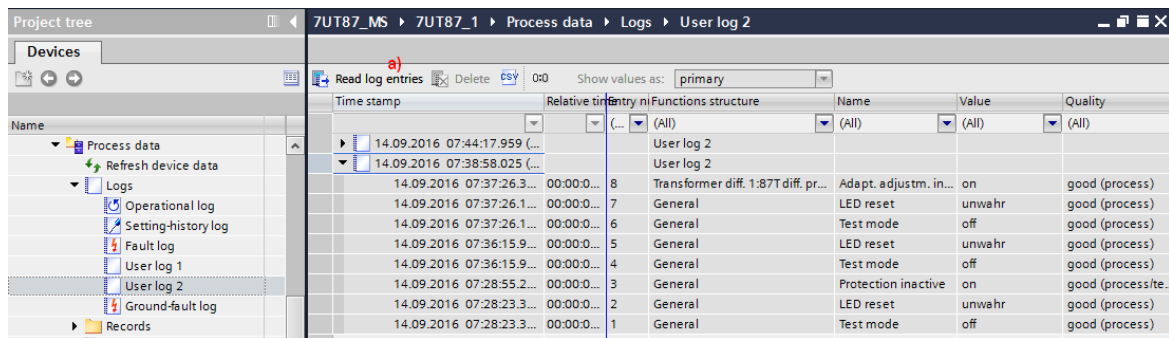


Time stamp	Relative time	Entry nr	Functions structure	Name	Value	Quality
14.09.2016 07:44:17.959 (...)			User log 2			
14.09.2016 07:38:58.025 (...)			User log 2			
14.09.2016 07:37:26.3...	00:00:0...	8	Transformer diff. 1:87T diff. pr...	Adapt. adjustm. in...	on	good (process)
14.09.2016 07:37:26.1...	00:00:0...	7	General	LED reset	unwahr	good (process)
14.09.2016 07:37:26.1...	00:00:0...	6	General	Test mode	off	good (process)
14.09.2016 07:36:15.9...	00:00:0...	5	General	LED reset	unwahr	good (process)
14.09.2016 07:36:15.9...	00:00:0...	4	General	Test mode	off	good (process)
14.09.2016 07:28:55.2...	00:00:0...	3	General	Protection inactive	on	good (process/te...
14.09.2016 07:28:23.3...	00:00:0...	2	General	LED reset	unwahr	good (process)
14.09.2016 07:28:23.3...	00:00:0...	1	General	Test mode	off	good (process)

[scanwnmd-030211-01, 2, en_US]

Figure 8-22 Reading the User-Defined Log with DIGSI 5

Reading on the Device through the On-Site Operation Panel

- To reach user-specific logs from the main menu, use the navigation keys of the on-site operation panel.
Main Menu → Indications → **User-defined log 1/2**
- You can navigate within the displayed indication list using the navigation keys (up/down) on the on-site operation panel.
- Using the **Info** softkey, you can retrieve auxiliary information on the entry depending on the context.

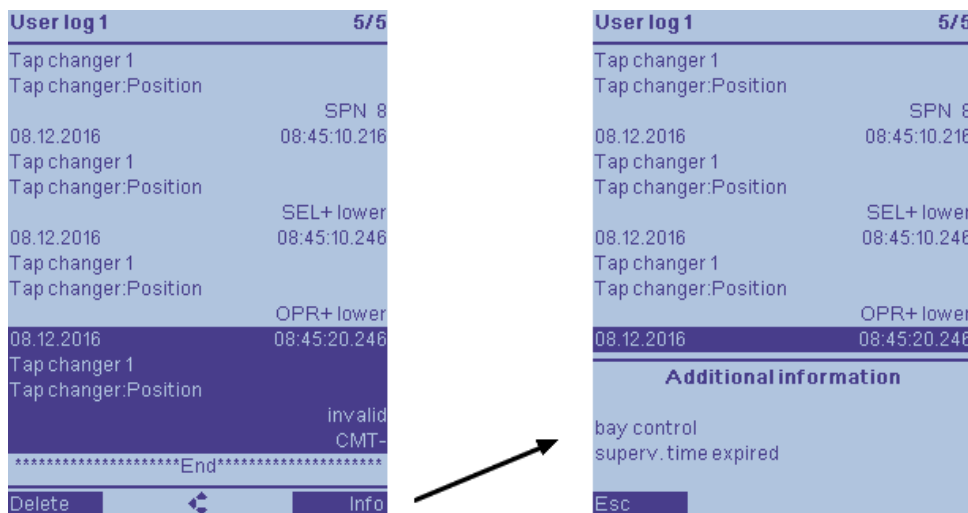

User log 1 5/5	
Tap changer 1	
Tap changer:Position	SPN 8
08.12.2016	08:45:10.216
Tap changer 1	
Tap changer:Position	SEL+ lower
08.12.2016	08:45:10.246
Tap changer 1	
Tap changer:Position	OPR+ lower
08.12.2016	08:45:20.246
Tap changer 1	
Tap changer:Position	invalid
*****End*****	
Delete	Info

User log 1 5/5	
Tap changer 1	
Tap changer:Position	SPN 8
08.12.2016	08:45:10.216
Tap changer 1	
Tap changer:Position	SEL+ lower
08.12.2016	08:45:10.246
Tap changer 1	
Tap changer:Position	OPR+ lower
08.12.2016	08:45:20.246
Additional information	
bay control	
superv. time expired	
Esc	

[scuserlog1-081217-01, 1, en_US]

Figure 8-23 Reading the User-Defined Log on the On-Site Operation Panel of the Device

Deletability

The user-defined log of your SIPROTEC 5 device can be deleted. You will find details about this in chapter [8.5.12 Saving and Deleting the Logs](#).

Configuration of a User-Defined Log

The indication capacity of a created user-defined log can be configured freely in the associated column of the information routing (matrix) of DIGSI 5:

Target → Log → U1 or U2

All entries															
Information			Destination												
			LEDs				Recorder				Logs				Device
			Basismodul												
Signals		Number	Type	2	1.13	1.14	1.15	1.16	Signal	O	F	U1	U2	G	Measure
(All)		(All)	...	...	...	...	...	...	(All)	...	...	...	...	...	(All)
▶ Switch onto fault 1		21.1341							*	*	*				
▶ External trip 1 pole 1		21.291							*	*	*				
▶ 50/51 OC-3ph 1p 1		21.221							*	*	*				
▶ 50N/51N OC-gnd-A1		21.211							*	*	*				
▶ 50 high-speed 1pol 1		21.981							*	*	*				
▼ 67N GFP gnd.sys.1		21.1111							*	*	*	*	*		
▶ Group indicat.		21.1111.4501							*						
▼ General		21.1111.2311							*						
▶ >Test of direction		21.1111.23...	SPS							X					
▶ Test direction		21.1111.23...	ACD												
▼ Definite-T1		21.1111.4861							*	*	*	*	*		
▶ >Block stage		21.1111.48...	SPS							X					
▶ Inactive		21.1111.48...	SPS							X					
▶ Behavior		21.1111.48...	ENS							X					
▶ Health		21.1111.48...	ENS							X					
▶ Mode 1p dead-tm...		21.1111.48...	SPS									X			
▶ Prot.PU blocks op...		21.1111.48...	SPS										X		
▶ Pickup		21.1111.48...	ACD								X				
▶ Operate delay exp...		21.1111.48...	ACT												
▶ Operate		21.1111.48...	ACT								X				

[scdiu1u2-280415-01, 1, en_US]

Figure 8-24 Indication Configuration in DIGSI 5 (Example: User-Defined Log U1/2)

8.5.7 Security Log

Access to areas of the device with restricted access rights is recorded in the security log. Unsuccessful and unauthorized access attempts are also recorded. Up to 2048 indications can be stored in the security log.

Reading from the PC with DIGSI 5

- To reach the security log of your SIPROTEC 5 device, use the project-tree window. The device must be in Online access.

Project → Online access → Device → Device Information → **Logs** tab → Security logs

The state of the security log last loaded from the device is displayed.

- Before this, refresh the contents by clicking the update arrows in the headline.

Time stamp	Message number	Severity	Indication
26.06.2018 10:02:40...	9	Warning	'7UT85_S': A user has ended an interactive session.
26.06.2018 10:02:40...	4	Warning	'7UT85_S': A user has initiated a remote session from '...
26.06.2018 10:12:38...	4	Warning	'7UT85_S': A user has initiated a remote session from '...
26.06.2018 10:12:45...	9	Warning	'7UT85_S': A user has ended an interactive session.
26.06.2018 10:29:36...	4	Warning	'7UT85_S': A user has initiated a remote session from '...
26.06.2018 10:30:46...	9	Warning	'7UT85_S': A user has ended an interactive session.
26.06.2018 11:36:56...	4	Warning	'7UT85_S': A user has initiated a remote session from '...
26.06.2018 11:37:04...	63	Alert	'7UT85_S': Restart initiated from '192.168.100.100' [...]
26.06.2018 11:38:01...	29	Warning	'7UT85_S': Configuration settings were uploaded from...
26.06.2018 11:38:01...	63	Alert	'7UT85_S': Restart initiated from '192.168.100.100' [...]
26.06.2018 11:38:01...	9	Warning	'7UT85_S': A user has ended an interactive session.
26.06.2018 11:38:04...	4	Warning	'7UT85_S': A user has initiated a remote session from '...
26.06.2018 11:38:41...	4	Warning	'7UT85_S': A user has initiated a remote session from '...
26.06.2018 11:38:47...	9	Warning	'7UT85_S': A user has ended an interactive session.

[scsecmld-180816-01, 2, en_US]

Figure 8-25 Reading the Security Indications with DIGSI 5

Reading on the Device through the On-Site Operation Panel

- To reach the security log from the main menu, use the navigation keys of the on-site operation panel.
Main menu → Test & Diagnosis → Logs → **Security log**
- You can navigate on the on-site operation panel using the navigation keys (top/bottom) inside the displayed indication list.

Time stamp	Indication
26.06.2018 13:14:31.570	'7UT85_S': User 'Siemens' changed settings related to user authentication: 'Module port' [set to value '*'].
26.06.2018 13:14:31.591	'7UT85_S': Configuration settings were uploaded from '192.168.100.100'.
27.06.2018 08:00:20.550	'7UT85_S': A user has ended an interactive session.
28.06.2018 06:55:12.480	'7UT85_S': A user has ended an interactive session.
28.06.2018 07:01:41.260	'7UT85_S': Audit log was viewed.

[scseclog-280618, 1, en_US]

Figure 8-26 Reading the Security Log on the On-Site Operation Panel of the Device



NOTE

- The logged indications are preconfigured and cannot be changed!
- This log, which is organized as a ring buffer, cannot be deleted by the user!
- If you want to archive security-relevant information of the device without loss of information, you must regularly read this log.

8.5.8 Device-Diagnosis Log

Concrete take-action instructions are logged and displayed in the device-diagnosis log for the following items:

- Required maintenance (for example, battery supervision)
- Identified hardware defects
- Compatibility problems

Up to 500 indications can be stored in the device-diagnosis log. In normal operation of the device, it is sufficient for diagnostic purposes to follow the entries of the operational log. This specific significance is assumed


by the device-diagnosis log when the device is no longer ready for operation due to hardware defect or compatibility problems and the fallback system is active.

Reading from the PC with DIGSI 5 in Normal Operation

- To reach the device-diagnosis log of your SIPROTEC 5 device, use the project-tree window.
Project → Online access → Device → Device information → **Logs** tab → Device-diagnosis log

The status of the device-diagnosis log last loaded from the device is shown to you.

- Before this, refresh the contents by clicking the update arrows in the headline.

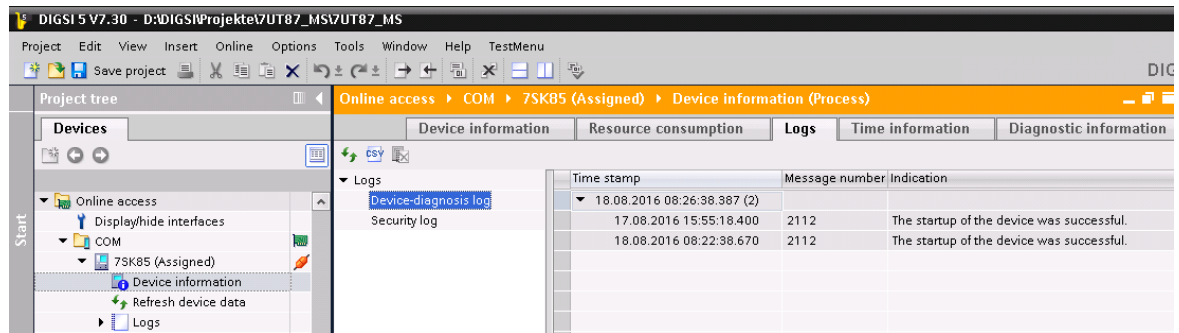

[scdevdia-180816-01, 1, en_US]

Figure 8-27 Reading the Device-Diagnosis Log with DIGSI 5

Reading on the Device through the On-Site Operation Panel in Normal Operation

- To reach the diagnosis log from the main menu, use the navigation keys of the on-site operation panel.
Main Menu → Test & Diagnosis → Logs → **Device diagnosis**
- You can navigate on the on-site operation panel using the navigation keys (top/bottom) inside the displayed indication list.



[scdevdia-280618, 1, en_US]

Figure 8-28 Reading the Device-Diagnosis Log on the On-Site Operation Panel of the Device



NOTE

- The device-diagnosis log cannot be deleted!
- The logged indications are preconfigured and cannot be changed!

8.5.9 Communication Log


The logging of the respective status such as ensuing faults, test and diagnosis operation, and communication capacity utilizations is done for all hardware-based configured communication interfaces. Up to 500 indications can be stored in the communication log. Logging occurs separately for each communication port of the configured communication modules.

Reading from the PC with DIGSI 5

- Use the project-tree window to reach the communication logs of your SIPROTEC 5 device.
Online access → Device → Test suite → Communication module
- Then select:
J:Onboard Ethernet → **Communication log**

The communication log is shown to you in the state last loaded from the device.

- Before this, refresh the contents by clicking the update arrows in the headline.

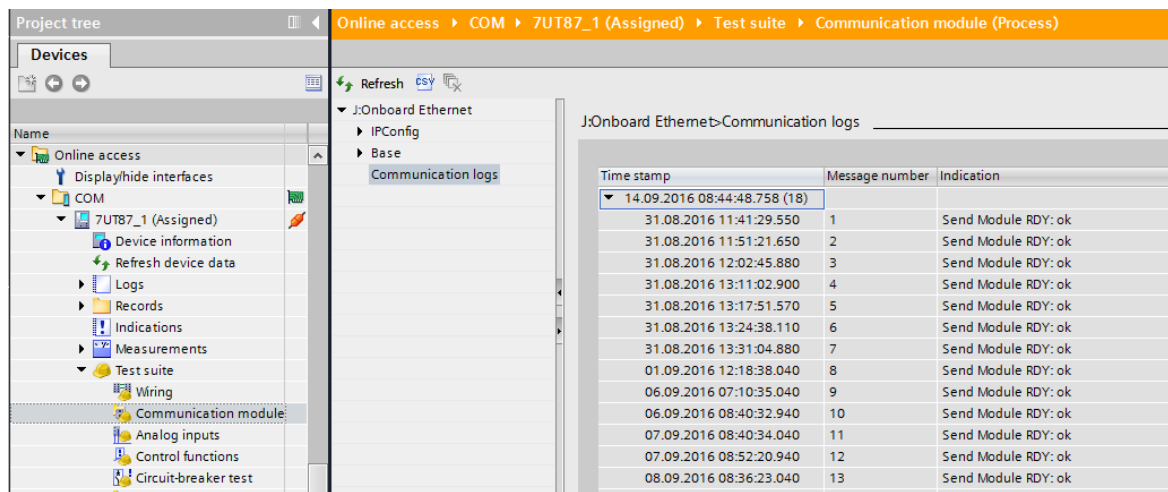

[sccompuf-140912-01, 2, en_US]

Figure 8-29 Reading the Communication Log with DIGSI 5

Reading on the Device through the On-Site Operation Panel

- To reach the communication log from the main menu, use the navigation keys on the on-site operation panel.
Main Menu → Test & Diagnosis → Logs → **Communication logs**
- You can navigate within the displayed indication list using the navigation keys (up/down) on the on-site operation panel.

Communication log 1/5	
Mainboard	1
Comm. port E	2
Comm. port F	3
Comm. port N	4
Comm. port P	5

[sccommlog-270618, 1, en_US]

Figure 8-30 Reading the Communication Log on the On-Site Operation Panel of the Device

Deletability

The communication logs of your SIPROTEC 5 device can be deleted. Read details about this in chapter [8.5.12 Saving and Deleting the Logs](#).

Configurability

The communication logs are not freely configurable. The entries are preconfigured.

8.5.10 Communication-Supervision Log

The communication-supervision log is used to log communication events.

The following events are currently logged:


- Status for each GOOSE subscription (if configured)
A log is kept of whether the GOOSE subscription has received valid messages or not.
- Aggregated status for all GOOSE subscriptions
The status is **TRUE** if at least one GOOSE subscription does not receive any valid message.
- Subscriber in simulation mode
GOOSE messages are processed with a simulation flag. The status is **TRUE** if at least one GOOSE subscription processes simulated messages.

Reading from the PC with DIGSI 5

- To reach the communication-supervision log of your SIPROTEC 5 device, use the project-tree window.
Project → Device → Process data → Logs → **Com supervision log**

The status of the communication-supervision log last loaded from the device is shown.

- To update (synchronization with the device), click the button **Read log entries** in the headline of the indication list.

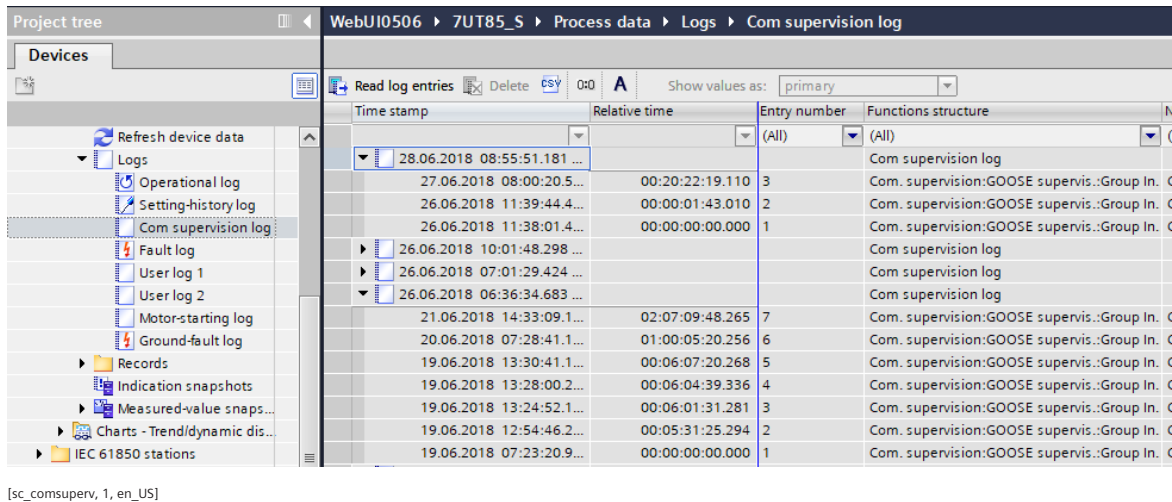

[sc_comsuperv, 1, en_US]

Figure 8-31 Reading the Communication-Supervision Log with DIGSI 5

Reading on the Device through the On-Site Operation Panel

- To reach the communication-supervision log from the main menu, use the navigation keys on the on-site operation panel.
Main menu → Logs → **Com supervision log**
- You can navigate within the displayed indication list using the navigation keys (up/down) on the on-site operation panel.



[sc_comsupervlg, 1, en_US]

Figure 8-32 Reading the Communication-Supervision Log on the On-Site Operation Panel of the Device

Deletability

The communication-supervision log of your SIPROTEC 5 device can be deleted. Read details about this in chapter [8.5.12 Saving and Deleting the Logs](#).

Configurability

The communication-supervision log cannot be freely configured. The entries are preconfigured.

8.5.11 Motor-Starting Log

The motor-starting log records the starting current, starting voltage and the start duration each time a motor starts. The motor-starting current and the motor-starting voltage are displayed as primary values. Up to 200 indications can be stored in the motor-starting log.

Measurement of the motor statistics starts when the motor state changes to **Start**. Measurement of the motor starting time ends as soon as the motor state changes to **Standstill** or **Running**. The motor state is obtained from the **Motor-state detection** function.

No entry is recorded in the motor-starting log if the motor state changes to **Start** and the current drops below the motor starting current within 500 ms.

Table 8-8 Motor-Starting Log


Measured Values		Primary
Start duration	Motor starting time	s
Starting current	Motor-starting current (primary)	A (or kA)
Starting voltage	Motor-starting voltage (primary)	V (or kV)

Reading from the PC with DIGSI 5

- Use the project-tree window to reach the motor-starting log of your SIPROTEC 5 device.
Project → Device → Process data → Logs → **Motor-starting log**

The state of the motor-starting log last loaded from the device is shown to you.

- To update (synchronization with the device), click the **Read log entries** button in the headline of the indication list ([Figure 8-33](#)).

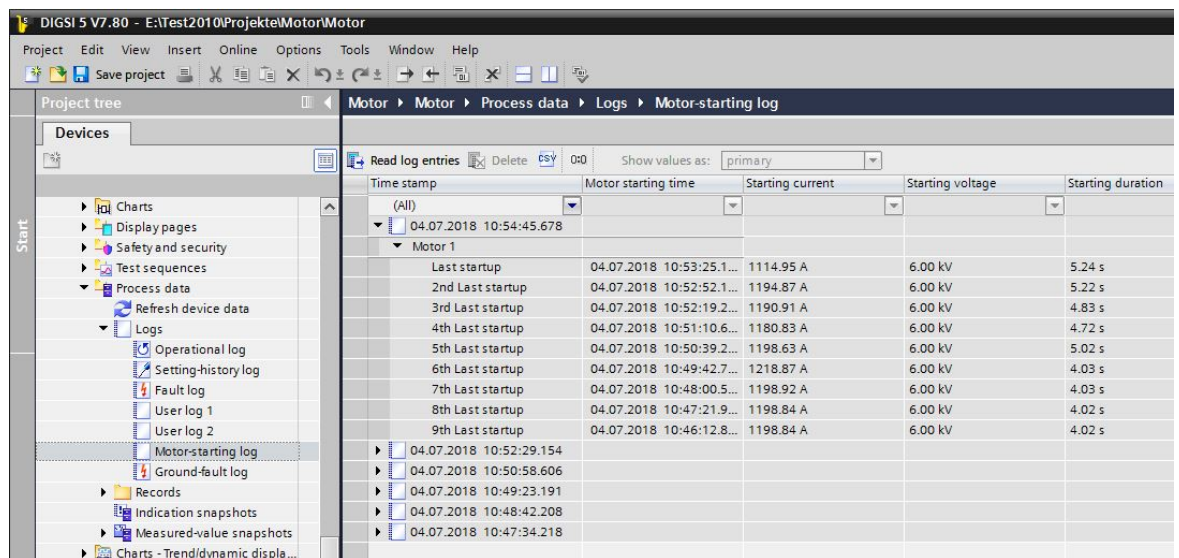

[scmotmlp-160713-01, 2, en_US]

Figure 8-33 Reading the Motor-Starting Log with DIGSI 5

Reading on the Device through the On-Site Operation Panel

- To reach the motor-starting log from the main menu, use the navigation keys of the on-site operation panel.
Main Menu → Indications → **Motor-starting log**
- You can navigate within the displayed indication list using the navigation keys (up/down) on the on-site operation panel.



[ScMotLog-280618, 1, en_US]

Figure 8-34 Reading the Motor-Starting Log on the On-Site Operation Panel of the Device

Deletability

The motor-starting log of your SIPROTEC 5 device can be deleted. Read details about this in chapter [8.5.12 Saving and Deleting the Logs](#).

Configurability

The motor-starting log is only present in the **Motor** function group. There is no column for the motor-starting log in the DIGSI information routing. The entries in the motor-starting log are preconfigured and cannot be changed.

8.5.12 Saving and Deleting the Logs

Deleting the logs of the device in the operating state is unnecessary. If storage capacity is no longer sufficient for new indications, the oldest indications are automatically overwritten with new incoming events. In order for the memory to contain information about the new faults in the future, for example, after a revision of the system, a deletion of the log makes sense. Resetting the logs is done separately for the various logs.



NOTE

Before you delete the content of a log on your SIPROTEC 5 device, save the log with DIGSI 5 on the hard disk drive of your PC.



NOTE

Not all logs of your SIPROTEC 5 device can be deleted. These limitations apply especially to logs with relevance for security and after-sales (security log, device-diagnosis log, setting-history log).



NOTE

Upon deletion of the fault log, the associated fault records are also deleted. In addition, the meters for fault number and fault-record number are reset to 0. In contrast, if you delete fault records, the content of the fault log, including the allocated fault numbers, remains.



NOTE

If the device executes an initial start, for example after an update of the device software, the following logs are automatically deleted:

- Operational log
- Fault log
- Ground-fault log
- Setting-history log
- User-defined log
- Motor-starting log
- Communication-supervision log

Back up the deletable logs using DIGSI 5.



NOTE

If a ground fault is currently active, the ground-fault log cannot be deleted.

Deleting Logs on the On-Site Operation Panel

- To reach the selected log from the main menu, use the navigation keys of the on-site operation panel (example operational log):

Main menu → Logs → **Operational log**

Operational log 70/70	
22.02.2011	08:03:30.934
Line 1:87 Line diff. prot.	
I-DIFF:inactive	
22.02.2011	08:03:30.934
General:Health	
alarm	
22.02.2011	08:03:30.949
Line 1:87 Line diff. prot.	
General:Test local device	
22.02.2011	08:03:30.949
Line 1:87 Line diff. prot.	
General:Test all devices	
22.02.2011	08:15:01.973
Device:DIGSI active	
on	
*****End*****	
Delete	

[scoprllog-090413-01.tif, 1, en_US]

Figure 8-35 Deleting the Operational Log on the On-Site Operation Panel

- You can navigate within the displayed indication list using the navigation keys (up/down) on the on-site operation panel.
- The option to delete the entire log is offered to you in the footer of the display at the bottom left. Use the softkeys below under the display to activate the command prompts. Confirm the request to **Delete**.
- After being requested, enter the password and confirm with **Enter**.
- After being requested, confirm the **Deletion of all entries** with **Ok**.

Deleting Logs from the PC with DIGSI 5

- To reach the selected log of your SIPROTEC 5 device, use the project-tree window (for example operational log).

Project → Device → Process data → Logs → **Operational log**

8.6 Edit Measured and Metered Values

8.6.1 Overview of Measured and Metered Values

The SIPROTEC 5 devices have numerous measured and metered values. The following [Table 8-9](#) gives you an overview of the scope and sequencing principle. Measured and metered values will be referred to hereafter as measured values.

Please refer to the Device manual of your SIPROTEC 5 device for detailed information and setting instructions.

Table 8-9 Overview of Measured Values

Measured / Metered Values	Description
Operational measured values	RMS value calculation and power calculation by definition, convertible to primary, secondary or percentage values • Phase currents I_A, I_B, I_C • Ground current I_N, I_{NS} (sensitive) • Phase-to-ground voltages V_A, V_B, V_C • Phase-to-phase voltages V_{AB}, V_{BC}, V_{CA} • Residual voltage V_{NG} • Frequency f • Powers P, Q, S (3-phase and phase-specific) • Power factor λ
Fundamental and symmetrical components	Calculation of indicator quantities via Fourier filter or according to the transformation rule • Phase currents $\underline{I}_A, \underline{I}_B, \underline{I}_C$ • Ground current $\underline{I}_N, \underline{I}_{NS}$ (sensitive) • Phase-to-ground voltages $\underline{V}_A, \underline{V}_B, \underline{V}_C$ • Phase-to-phase voltages $\underline{V}_{AB}, \underline{V}_{BC}, \underline{V}_{CA}$ • Residual voltage $\underline{V}_{NG}$ • Symmetrical components $3\underline{I}_0, \underline{I}_1, \underline{I}_2, \underline{V}_0, \underline{V}_1, \underline{V}_2$
Protection-specific Measured values	Measured values that are especially calculated for individual protection functions such as • Distance protection (reactances and resistances of conductor loops) • Differential protection (differential and restraint current conductor) • etc.
Average values	Average values can be formed on the following basis: • Operational measured values • Symmetrical components The time slot for average-value generation and the output interval are parameterizable.

Measured / Metered Values	Description
Minimum and maximum values	The minimum and maximum values can be formed on the following basis: • Operational measured values • Symmetrical components • Selected measured values (for example of average values) The display of minimum and maximum values contains the time of their occurrence. The calculation is stabilized against smaller value fluctuations in currents and voltages.
Energy values	These metered values are determined for active and reactive energy. Restore time, restore interval and counting mode are adjustable. Restoration can be initiated via a binary input. The following metered values are available: • Active energy Wp+ (export), Wp- (import) • Reactive energy Wq+ (export), Wq- (import)
Statistical values	The following statistical values are formed: • Number of initiated switching operations of the circuit breaker (operation counter); the contactor trips and switch actuations by the control are counted. • Number of initiated switching operations of the circuit breaker, separated by circuit-breaker pole • Sum of total primary breaking currents • Sum of the primary breaking currents, separately for each breaker pole
User-defined measured values	These metered values can be determined for any metered amounts received via a binary input. • The unit and significance of a pulse, restore time, restore interval, and meter mode can be set. • Restoration can be initiated via a binary input

8.6.2 Reading Measured Values and Metered Values

You can read measured and metered values on the device display or with DIGSI 5. You can find these values in the respective function groups such as the **Line** function group. Take note that the scope of measured values is determined by the type and number of assigned measuring points. If only one measuring point, for example **3-phase current**, is assigned to the function group, then all measured values linked to the voltage (voltage, power, energy) are omitted. These measured values are hidden automatically.

In the following, you will find an example how to reach the individual measured or metered values.

Reading Measured Values on the Device

You can read the measured values in the function group **Line 1** as follows:

- In the main menu of the device display, switch to
Main menu → Measured values → Line 1

The following measured-value group is displayed for you, and you can find the available measured and metered values in [Table 8-9](#).

- Operational measured values
- Fundamental component/symmetrical components
- Functional measured values (protection-specific measured values)
- Minimum/maximum/mean values
- Energy
- User-defined measured values

You can read the measured values in the function group **Circuit Breaker 1** as follows:

- In the main menu of the device display, switch to
Main menu → Measured values → Circuit breaker 1

The following measured-value group is displayed for you, and you can find the available measured and metered values in [Table 8-9](#).

- Fundamental component/symmetrical components
- Functional measured values (protection-specific measured values)
- Statistics
- User-defined measured values

Reading Measured Values with DIGSI 5

You can read the measured values of the individual function groups with DIGSI 5.

- Establish an online connection to the device with DIGSI 5.
- Select the desired device from the Online access.
- Open the menu item **Measurements**.
- Double-click the respective function group and the measured value view appears in the working area.
- Select the respective tab of the desired measured value group.

The ordering of the measured-value groups follows the ordering principle in [Table 8-9](#).


[Figure 8-36](#) shows you an example of a measured-value view. You can select whether the measured values are shown to you as primary, secondary, or percentage values. Furthermore, you have the possibility of saving the measured values.

If you want to save the measured values, proceed as follows:

- Click the **Snapshot** button in the menu bar.

You can now read the saved measured values in the offline folder of the project tree as required.

- To do this, click device.
- Open the menu item **Process Data**.
- Double-click the desired function group on **Measured value-snapshot**.

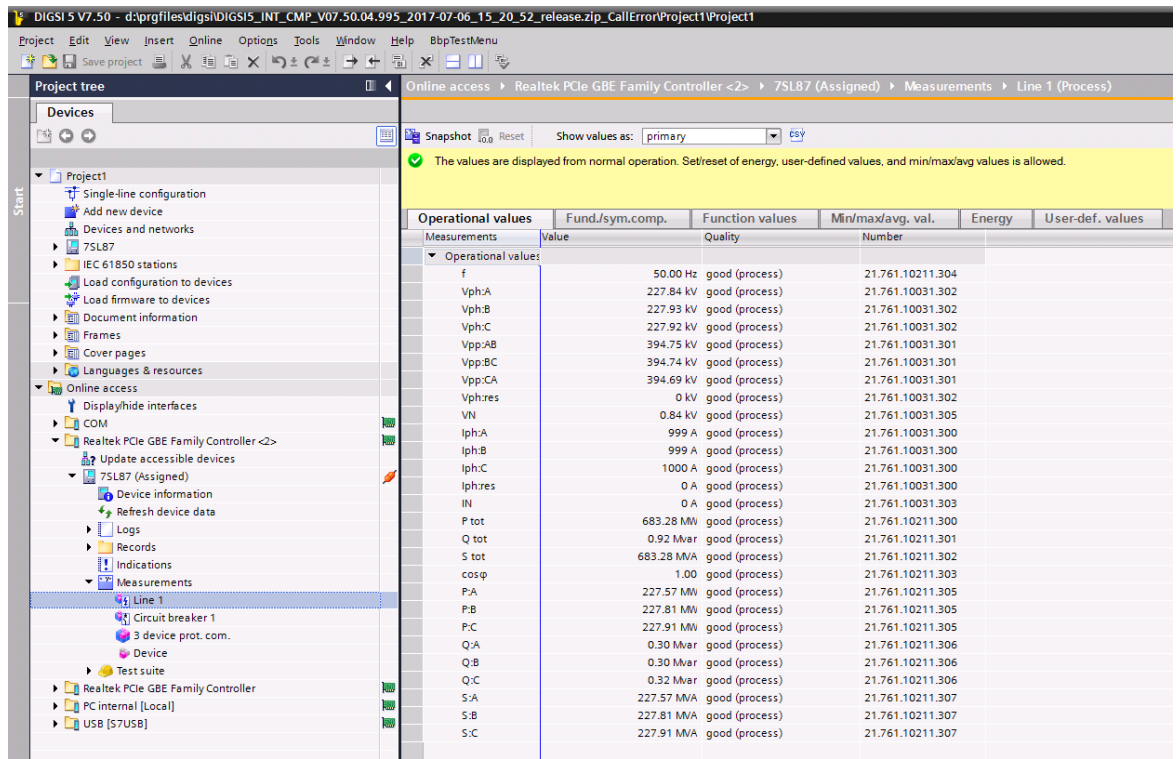

[scmswesi-080413-01.tif, 1, en_US]

Figure 8-36 Example of the Measured-Value View for the Function Group Line 1

8.6.3 Setting and Resetting Energy Values

Setting and resetting energy values on the device:

- ✧ To set and reset on the device use the **Measured values** menu.
- ✧ In the corresponding function group, mark the **Energy** measured values.
- ✧ You can reset the energy values using the right context-sensitive **Reset** key on the display.
- ✧ When you open the energy values, you see the current values displayed as primary values.
- ✧ You can set each measured value to the desired value via the right context-sensitive **Change** key. The input value is converted to the data format according to IEC 61850. Because of the associated quantization, the resulting display value can differ from the input. In addition, the input value is rounded to 6 digits. The display is limited to 6 digits. Therefore please note that, in case of small pulse weighting, minor changes to large metered values can not be reflected in the display.
- ✧ Set the new value and activate acceptance with **Enter**.

Setting and resetting energy values with DIGSI 5:

- ✧ Start the online mode with DIGSI 5.
- ✧ Click (in the project-tree bottom left) the **Measured values** menu item.
- ✧ Double-click the **Line** function group and the measured-value window appears in the operating range.
- ✧ If you open the **Energy** tab in the measured-value window, you are shown the current meter readings of the four-quadrant meter (see [Figure 8-37](#)).
- ✧ If you click the **Reset** button, you can reset the current meter readings to 0.

Alternatively, you can set the meter to a value:

- ✧ Enter the desired value in the **Current value** column. The input value is converted to the data format according to IEC 61850. Because of the associated quantization, the resulting display value can differ from the input. In addition, the input value is rounded to 6 digits. The display is limited to 6 digits. Therefore please note that, in case of small pulse weighting, minor changes to large metered values can not be reflected in the display.
- ✧ To transfer the value to the device, click the **Set** button.

Fundament./sym.comp.	Function values	Min/max/average values	Energy
Measurements	Current value	Number	Set/reset value
Wp+	~ 171.860 GWh	21.1021.10811.300	Set
Wq+	~ 271.262 MVarh	21.1021.10811.301	Set
Wp-	~ 0 MWh	21.1021.10811.302	Set
Wq-	~ 235.559 MVarh	21.1021.10811.303	Set

[scnrgwer-080413-01.tif, 1, en_US]

Figure 8-37 Overview of Energy Values

8.6.4 Setting and Resetting User-Defined Metered Values

Setting and resetting metered values on the device:

- ✧ To set and reset, open the **Measured values** menu on the device.
- ✧ Switch to the corresponding function group (for example, **Line**) in the **User-defined values** menu in which the metered values have been arranged.
- ✧ Select the metered value.
- ✧ Reset the metered values if needed. Use the context-sensitive **Reset** key on the on-site operation panel.
- ✧ If you select one level lower, you are brought to the metered values.
- ✧ You can set the metered value to the desired value via the context-sensitive **Change** key. The input value is converted to the data format according to IEC 61850. Because of the associated quantization, the resulting display value can differ from the input. In addition, the input value is rounded to 6 digits. The display is limited to 6 digits. Therefore please note that, in case of small pulse weighting, minor changes to large metered values can not be reflected in the display.
- ✧ Set the new value and activate acceptance with **Enter**.

Setting and resetting metered values with DIGSI 5:

- ✧ Start the online mode with DIGSI 5.
- ✧ Click (in the project tree bottom left) the **Measured values** menu item.
- ✧ Double-click the function group (for example, **Line**) and the measured-value window appears in the operating range.
- ✧ If you open the **User-def. values** tab in the measured-values window, the corresponding values can be viewed.
- ✧ If you click the **Reset** button, you can reset the current meter readings to 0.

Alternatively, you can set the meter to a value.

- ✧ Enter the desired value in the **Current value** column. The input value is converted to the data format according to IEC 61850. Because of the associated quantization, the resulting display value can differ from the input. In addition, the input value is rounded to 6 digits. The display is limited to 6 digits. Therefore please note that, in case of small pulse weighting, minor changes to large metered values can not be reflected in the display.
- ✧ To transfer the value to the device, click the **Set** button.

8.6.5 Resetting Min./Max./Average Values

Resetting minimum/maximum/average values on the device:

- ✧ To reset, open the **Measured values** menu on the device.
- ✧ Switch to the corresponding function group and to the **Minimum/maximum/average values**.
- ✧ You can reset the minimum/maximum/average values using the context-sensitive right **Reset** key.

Resetting minimum/maximum/average values with DIGSI 5:

- ✧ Start the online mode with DIGSI 5.
- ✧ Click (in the project tree bottom left) the **Measured values** menu item.
- ✧ Double-click the selected function group and the measured-value window appears in the operating range.
- ✧ If you open the **Min/Max/Average values** tab in the measured-value window, you are shown the current minimum/maximum/average values.
- ✧ If you click the **Reset** button, you can reset the current values to 0.

8.6.6 Setting and Resetting Statistical Values

Setting and resetting statistical values on the device:


- ✧ To set and reset, open the **Measured Values** menu on the device.
- ✧ Switch to the **Circuit Breaker** function group.
- ✧ You can reset the values if you select **Statistical Values** on the display via the context-sensitive **Reset** key.
- ✧ If you select one level lower, you are brought to the statistical values. The measured values are displayed in primary values.
- ✧ You can set the statistical values to the desired value via the right context-sensitive **Change** key. The input value is converted to the data format according to IEC 61850. In addition, the input value is rounded to 6 digits. The display is limited to 6 digits. Therefore please note that, in case of small pulse weighting, minor changes to large metered values can not be reflected in the display.
- ✧ Set the new value and activate acceptance with **Enter**.

Setting and resetting statistical values with DIGSI 5:

- ✧ Start the online mode with DIGSI 5.
- ✧ Click (in the project tree bottom left) the **Measured values** menu item.
- ✧ Double-click the **Circuit breaker** function group and the measured-value window appears in the operating range.
- ✧ If you open the **Statistics** tab in the measured-values window, you are shown the current statistical values (see [Figure 8-38](#)).
- ✧ You can reset the current values to 0 by clicking the **Reset** button.

Alternatively, you can set a value:

- ✧ Enter the desired value in the **Current value** column. The input value is converted to the data format according to IEC 61850. In addition, the input value is rounded to 6 digits. The display is limited to 6 digits. Therefore please note that, in case of small pulse weighting, minor changes to large metered values can not be reflected in the display.
- ✧ To transfer the value to the device, click the **Set** button.

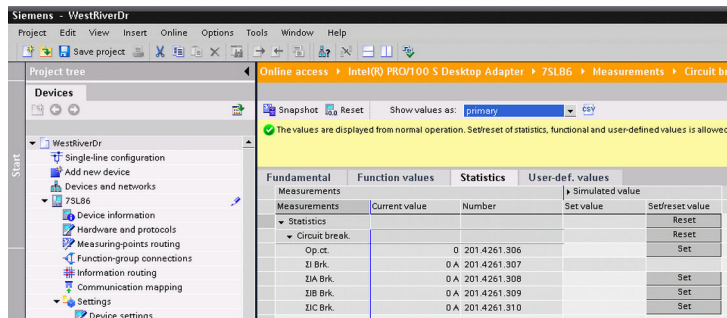

[scubstwe-080413-01.tif, 1, en_US]

Figure 8-38 Overview of Statistical Values

8.7 Fault Recording

8.7.1 General

Fault data relates to events or records that are recorded during a device fault. Sampled values of analog measurement inputs and calculated measured values of the device are recorded in the fault recording. A fault record can also be used for recording binary events as traces. Fault events are logged with time stamp in the fault log. A corresponding fault exists in the fault log for each recorded fault record. The unique assignment is formed by the time stamp and the fault defined with an automatically incrementing number.

After a fault the most important data of the fault is spontaneously shown on your device display. You can select whether the spontaneous fault display is updated with each fault or only in case of faults with tripping (**no Trip – no Flag**). Spontaneous fault displays such as LEDs fall back again in case of pickup without tripping.



NOTE

Events are always logged in the fault log.

The control settings of the **fault recording** are described in the Device manual. The starting condition, recording length, and the storage criterion are selected with these parameters.

You can rename the signals in the DIGSI information routing matrix. You can change the order of the binary signals and measured-value channels to be recorded in DIGSI under **Signal sequence**. For further information, you will find help in DIGSI 5 version V07.50 and higher (ordering number: C53000-D5000-C001-D). The following chapter describes the readout and editing of fault records.

Fault Definition

A fault is started by the incoming pickup of a protection function and ends after the trip command with the cleared pickup.

When using an automatic reclosing function, the full reclosing cycle (successful or not) is integrated in the fault. If evolving faults appear within reclosing cycles, the entire clearing process is logged under one fault number even in multiple pickup cycles. Without automatic reclosing function every pickup is also recorded as its own fault.

User-defined fault configuration and initiation by an external starting signal are also possible.



NOTE

- Define the extent of the fault recordings using the control settings of the **Fault recording** function.
- Logging of events in the fault log always occurs.

8.7.2 Reading Fault Records

You can read out the fault record recorded in the device via the communication interfaces. You can do this from a PC with DIGSI 5 or by way of standard (IEC 61850, IEC 60870-5-103) from a central controller upon request. The fault records read out via DIGSI 5 are saved on the PC in the COMTRADE format. You can analyze the fault records with the analytical software SIGRA.

Procedure

- Use the project-tree window to reach the fault records of your SIPROTEC 5 device.
Project → Device → **Records**


The fault records that have been loaded from the device to date are displayed with time stamps and fault numbers.

- To read all fault records stored in the device, click the **Read records** button in the headline of the indication list.



NOTE

- Take note that when accessing via online access points the fault records read replace all fault records previously shown in the window. If you wish to save special fault records, then export the fault records (see chapter [8.5.12 Saving and Deleting the Logs](#)).
- When accessing via a device created in the project, older fault records no longer in the device remain kept. If you wish to delete no longer needed fault records, read chapter [8.5.12 Saving and Deleting the Logs](#).

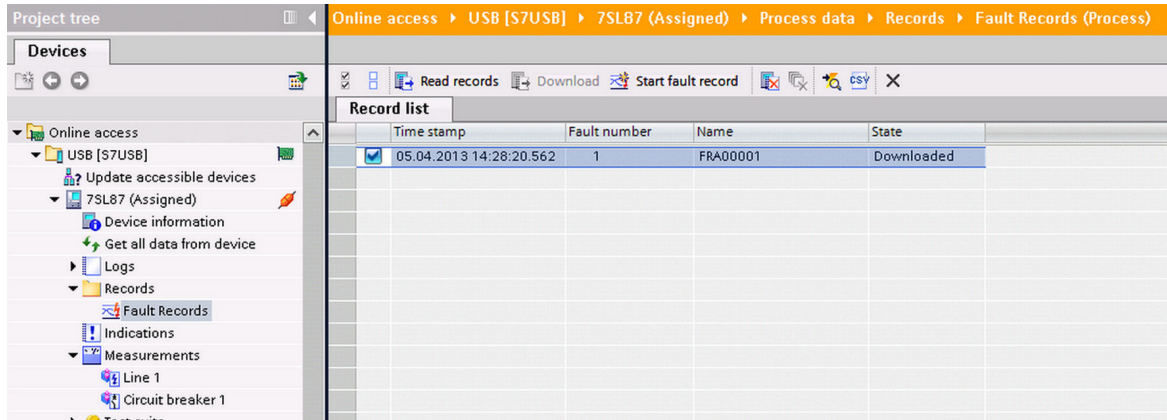

[scasistr-080413-01.tif, 1, en_US]


Figure 8-39 Reading Fault Records with DIGSI 5

8.7.3 Displaying Fault Records

Procedure

- To be able to display and analyze a fault record, you must open the fault record of your choice in the list of read fault records by double-clicking.

After opening, the fault record is automatically displayed on the **COMTRADE Viewer**. You can select between primary and secondary values. If you wish to do expanded analyses of fault records using the options of the COMTRADE viewer, you can optionally press the **Open record with SIGRA** button to start the analytical software SIGRA. You must have the analytical software SIGRA installed on your PC.

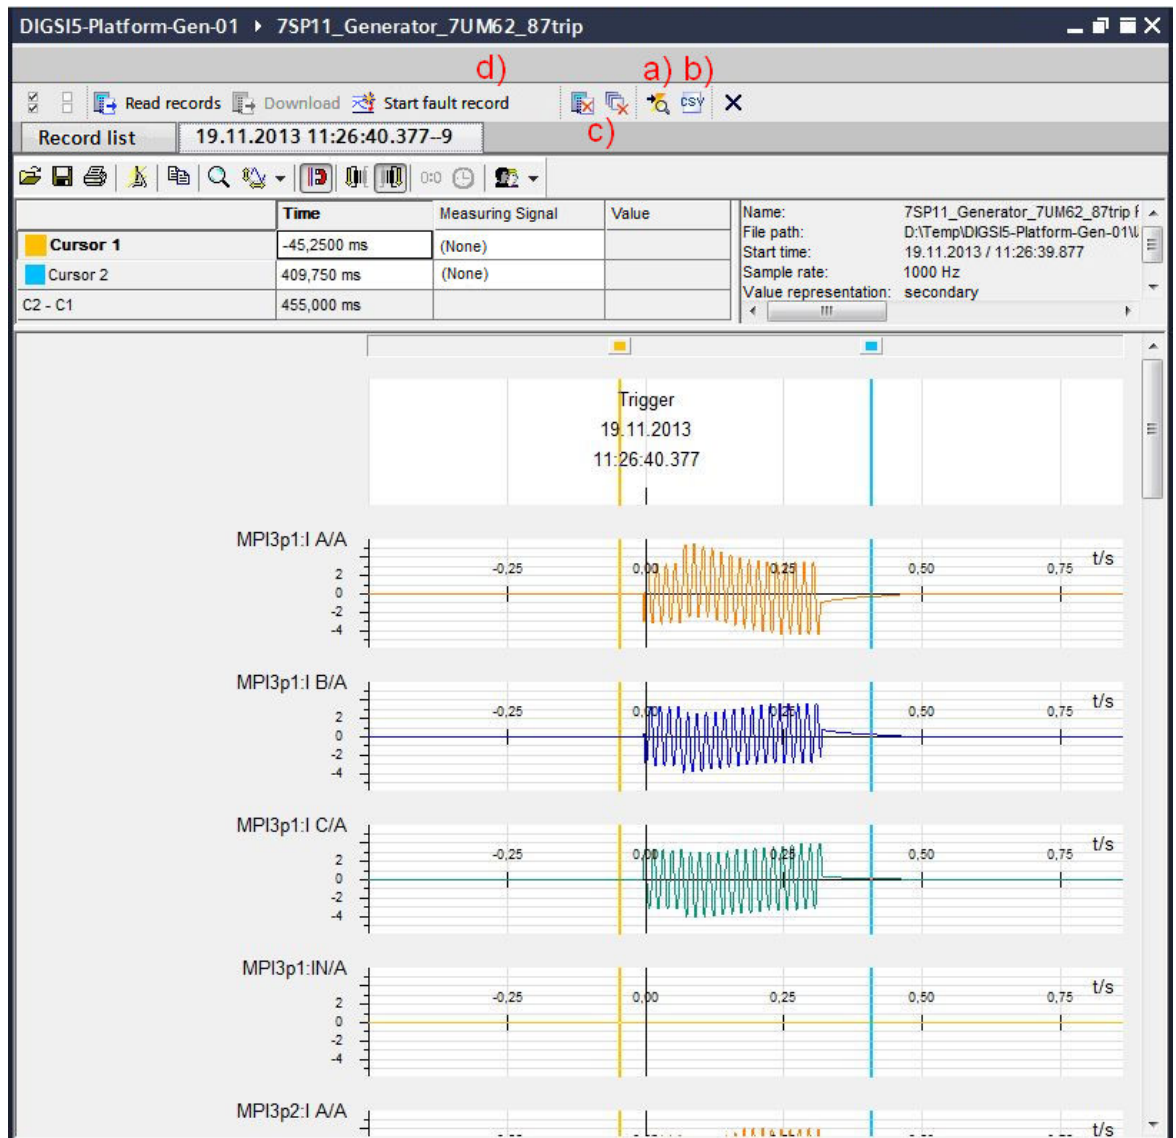

[scttrecd-080211-01.tif, 2, en_US]

Figure 8-40 Displaying a Fault Record with the COMTRADE Viewer

8.7.4 Saving and Exporting Fault Records

For the analysis of important fault records you can save them as files on your DIGSI 5 PC. You have 2 export options available in DIGSI 5.

Procedure

- Start the standard export of the fault record in COMTRADE format (CFG file) by pressing the **Export** button in the headline of the display window (Figure 8-40 a)). The fault record is now available to SIGRA and other analytical tools.
- Start the export of the fault record as a CSV file in tabular form by pressing the **CSV** button in the headline of the display window (Figure 8-40 b)). You can, for example, open this file with Excel and individually edit or analyze it.

8.7.5 Deleting Fault Records

The recorded fault records are managed in a ring buffer in the device. So that new records can always be created securely, the oldest records are deleted automatically when the maximum storage capacity is reached. However, you can also delete targeted fault records. This differentiates whether you wish to delete the fault records stored or selected in the device in a DIGSI 5 project.

Deleting Fault Records via the PC with DIGSI 5

- To delete the fault records stored in the device, click the **Delete fault records** button in the headline of the display window ([Figure 8-40 c](#))).
- You can delete selected fault records within a DIGSI 5 project. To do this, tag the respective fault records and right-click with the mouse. Complete the delete action with the offered **Delete** option.



NOTE

Recorded events of corresponding faults in the fault log are also deleted with the fault records.

8.7.6 Recording a Test Fault Record

For test purposes, SIPROTEC 5 devices can record fault records of fixed length. You must manually initiate this recording from the PC via DIGSI 5. The recording length of the test fault records is independent and is set to 1 second.

Procedure

- To start a test fault record, click the **Start fault record** button in the headline of the display window ([Figure 8-40 d](#))). Then read the current fault records to view and analyze them from your SIPROTEC 5 device.

8.7.7 Configuration of Fault-Record Channels


While the **Fault Recording** function contains the control settings for recording data, you must configure the channels to be recorded with DIGSI 5 in the configuration matrix. Every application template contains a preset configuration of channels to be recorded that you can adjust individually.

Fault-Record Channels

The following values are available for fault-record channels:

- Sampled values of analog measuring inputs (currents and voltages)
- Internal measured values of measured value preprocessing
- Internal function and operational measured values
- Binary status signals (internal or external)

Fault-record channels are configured in the information routing of DIGSI 5 (matrix). The **Recorder** column is provided especially for this purpose.

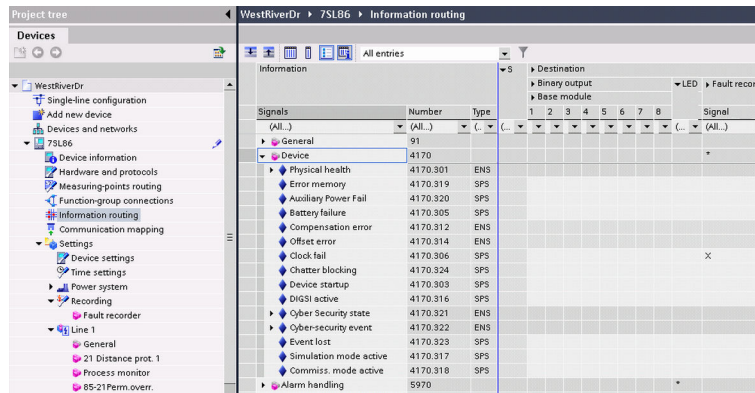

[sccnfrec-080413-01.tif, 1, en_US]

Figure 8-41 Configuration of Fault-Record Channels with DIGSI 5



NOTE

The sampled values of analog measuring inputs (currents and voltages) are not freely configurable in the fault record. The values are specified automatically by the routing of measuring points to the analog input modules of the device.



NOTE

The maximum recording length of an individual fault record and the sum of fault records stored in the device are affected by the following factors:

- Sampling rate setting
- Number of fault-record channels
- Type of fault-record channels

The **Fault Recording** chapter in the device manual gives an overview of attainable recording times.


8.7.8 Configuration of the Start Criterion

The start criterion for recording a fault record and the duration of a fault record are determined by the control settings in the **Fault Recording** function. Read the **Fault Recording** chapter in the Device manual of your SIPROTEC 5 device.

Start Criterion

A start criterion is the fault which is formed by the pickups of protection functions and which also takes account of a reclosing cycle duration during the respective parameter setting.


- You can configure the start criterion for each parameter setting **using your own user definitions**. A **Recorder** column especially provided for this purpose is then displayed in the information routing of DIGSI 5 (matrix).

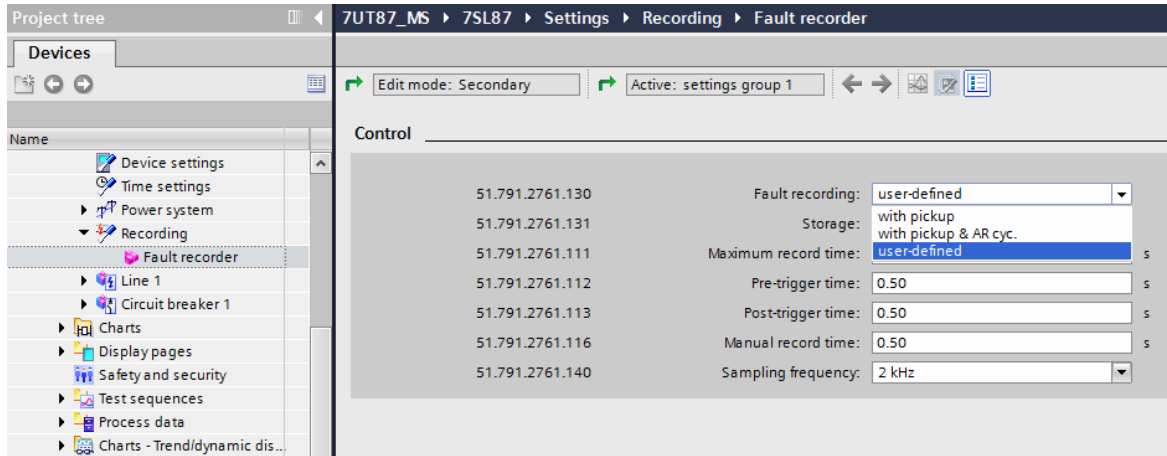

[scusrrec-051016-01, 1, en_US]

Figure 8-42 User-Defined Configuration of the Start Criterion for Fault Recording

- You can also set parameters for the start criterion via an external start signal in the **Fault recorder** function. (>External start). With this you can, for example, initiate recording of a fault record using an external protection device without internal fault recording in case of pickup.
- A test fault record can also be initiated manually and directly via the on-site operation panel of the device (for example, via function key) or via DIGSI 5. For this, a freely configurable starting signal (>Manual start) is available.

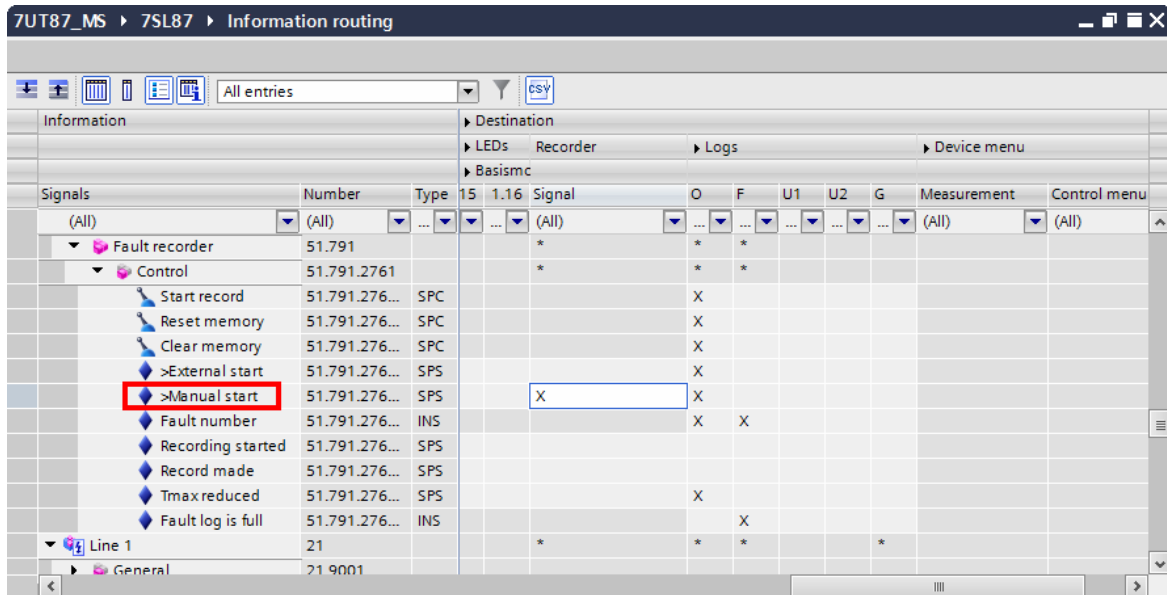

[scmnstr-051016-01, 1, en_US]

Figure 8-43 Manual Start via DIGSI 5

Fault recording can also be initiated via communication. This can happen via the standards IEC 61850 and IEC 60870-5-103 through a connected substation automation technology system.

8.8 Change Device Settings

8.8.1 Date and Time Synchronization

The integrated date and time synchronization of your SIPROTEC 5 device allows you to assign the precise time of events to an internally maintained device time. Events in the logs are stamped with the device time. These time stamps are also transmitted during transmission to substation automation technology or via a protection interface. You can synchronize the device time using external time sources. You can also take local time zones and daylight-saving time arrangements into consideration.

8.8.2 Setting Time and Date

You can set the date and time of your SIPROTEC 5 device through the on-site operation panel as well as the DIGSI 5.

Setting via DIGSI 5

Date and time are internal device quantities. DIGSI 5 access is via online access in the project-tree window. Here you will see the status of configured time sources and the current device time.

Online access → Interface → Device → Device information → **Time information**

- To be able to enter your local device time and the date, go to the **Device time** section and select the **Edit time** button.

Time information

Time source 1

Source time: 1970-01-01 00:00:00.000000 [00:00] Received at device time: 1970-01-01 00:00:00.000000 [00:00]
Clock failed: Yes Type: T103
Clock synchronized: No

Time source 2 Synchronizing device

Source time: 2012-01-01 00:01:05.000000 [00:00] Received at device time: 2012-01-01 00:01:05.000000 [00:00]
Clock failed: No Type: IRI G_B
Clock synchronized: Yes

Device time

January 01, 2012 12:01:05 AM Edit time Set time

[scztinfo-030311-01.tif, 1, en_US]

Figure 8-44 Time Information in the DIGSI 5

- After finishing the input, press the **Set time** button to transfer it to the device.
- The display for modified values for date, time, and their cyclical updates will confirm the successful transfer.



NOTE

The **Edit time** button is inactive until data have been queried from the online device for the first time.

Settings on the Device Using the On-Site Operation Panel

To reach the settings for date and time from the main menu, use the navigation keys on the on-site operation panel.

- Select Main menu → Device functions → **Date & Time**.

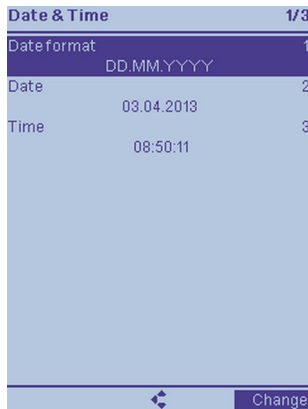


Figure 8-45 Date and Time Setting

- From the **Date format** menu item, select a display option.
- To change the format, press the **Change** softkey.
- Enter the change and then confirm the entry by selecting the **Ok** softkey.

The **Date** and **Time** menu items show you the current values with ongoing update.

- To change **Date** or **Time**, select the desired menu item and press the **Change** softkey.
- Enter the changes and then confirm the entry by selecting the **Ok** softkey.

8.8.3 Setting Time Keeping Parameters

Input the time keeping settings of your SIPROTEC 5 device preferably using DIGSI 5. You have access here to all possible settings. You can only access some of the settings using the on-site operation panel while the device is being operated.

Settings Using DIGSI 5

To reach the time settings of your SIPROTEC 5 device, use the project-tree window.

- Select
Project → Device → Parameter → **Time settings**
- Select the desired date format.
- Configure up to 2 external timers (time source, latency, time zone) and the time by which failures should be logged.

First decide whether your PC settings should be accepted or whether you wish to enter the settings manually.

- Enter the settings for your local time zone and daylight saving time. The settings include the local time zone (relative to GMT) as well as the daylight saving time options (activation, start, end, and offset of daylight saving time).

You will find application and setting information in the Device manual, chapter System Functions.

Time configuration

General

Date format: YYYY-MM-DD

Time source

Time source 1: port G:IRIG-B
Sync. latency time src.1: 0.00 µs
Time zone time source 1: UTC

Time source 2: port F:Ch1:IEC 60870-5-103
Sync. latency time src.2: 0.00 µs
Time zone time source 2: UTC

Fault indication after: 600 s

Time zone and daylight saving time

Time zone offset to UTC: 60 min

☒ Switch daylight sav. time

Start of daylight sav. time: Last Sunday in March at: 02 : 00 AM o'clock
End of daylight sav. time: Last Sunday in October at: 03 : 00 AM o'clock
Offset daylight sav. time: 60 min

[ScZtkonf-040718, 1, en_US]

Figure 8-46 Time Settings via DIGSI 5

Settings on the Device Using the On-Site Operation Panel

You can only access some of the settings using the on-site operation while the device is being operated. To reach the settings for time synchronization from the main menu, use the navigation keys on the on-site operation panel.

- Select Main menu → Parameter → General → **Time sync.**

Time sync. 5/5

Time source 1 1
[102] none
Time zone time source 1 4
[108] local
Time source 2 5
[105] none
Time zone time source 2 8
[109] local
Fault indication after 9
[101] 600 s

Fault indication after
(0...3600/ step size: 1)s
600

Esc Enter

[sctimsync-080413-01.tif, 1, en_US]

Figure 8-47 Time-Synchronization Settings

- Configure up to 2 external time sources. There are port and channel numbers in communication interfaces for every configured time source. This depends on the configured hardware of your SIPROTEC 5 device.
- Select the time-zone arrangement (UTC or local) for each time source.
- Select the time by which time synchronization failures should be logged.

For each change in the settings, select the desired menu item and press the **Change** softkey.

- Enter the changes and then confirm the entry by selecting the **Ok** softkey.

You will find application and setting information in the System Functions Device manual.



NOTE

Make sure that the settings for the time sources coincide with the actual hardware configuration of your SIPROTEC 5 device. In any event, incorrect settings cause the status indications of time sources to pick up.

8.8.4 Status and Monitoring of Time Keeping

Time Information in DIGSI 5

The compact overview of the status of time synchronization in your SIPROTEC 5 device will give you support information about the DIGSI 5 especially during commissioning. You reach the overview in the project-tree window via Online access.

Online access → Interface → Device → Device information → **Time information**

Time information	
Time source 1	
Source time:	1970-01-01 00:00:00.000000 [00:00]
Received at device time:	1970-01-01 00:00:00.000000 [00:00]
Clock failed:	Yes
Clock synchronized:	No
Type:	T103
Time source 2	
Synchronizing device	
Source time:	2012-01-01 00:01:05.000000 [00:00]
Received at device time:	2012-01-01 00:01:05.000000 [00:00]
Clock failed:	No
Clock synchronized:	Yes
Type:	IRIG_B
Device time	
January 01, 2012 12:01:05 AM	
[Edit time] [Set time]	

[scztinfo-030311-01.tif, 1, en_US]

Figure 8-48 Time Information in DIGSI 5

For every time source, you see the following:

- Last received time (with date)
- Receipt time of the last received time telegram
- Configured type of timer
- Indication of timer outage or failure
- Whether the device time is currently synchronized from the time source

The lower section displays the device time, which is continuously updated. If the internal device time and the infeed time source were synchronous at the time of telegram receipt, both displayed times are identical.




NOTE

All indicated times (even of time sources) take account of settings for local time (zone and daylight saving time of the device) in the form of a numeric offset to UTC (universal time).

Time Information on the On-Site Operation Panel

To reach the settings for date and time from the main menu, use the navigation keys on the on-site operation panel.

Main menu → Device functions → **Date & Time**

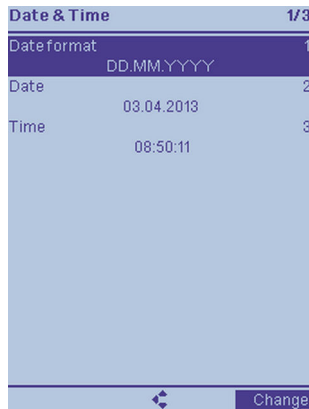

[scdtime-080413-01.tif, 1, en_US]

Figure 8-49 Date and Time Setting

The menu items **Date & Time** show the current values, which are permanently updated. You can also change entries here.

Time Synchronization Indications

Internal time synchronization is monitored cyclically. Important synchronization processes, the status of time sources and errors detected are reported and entered in the operational log. For this purpose, see the list of indications for internal date and time synchronization in the System Functions Device manual.



NOTE

In case of a missing or discharged battery, the device starts without active external time synchronization with the device time 2011-01-01 00:00:00 (UTC).

8.8.5 Setting the Contrast of the Device Display

You can enter the contrast setting only on the device via the navigation keys on the on-site operation panel.

Procedure

- Open the contrast menu by pressing the **Left + Right** navigation keys simultaneously.
- If prompted, change the contrast intensity +/- using the **Right/Left** navigation keys.
- You can restore the basic setting by simultaneously pressing the **Up + Down** navigation keys.
- Then confirm the setting changes with **Enter**.



[sckontra-080413-01.tif, 1, en_US]

Figure 8-50 Contrast Setting of the Device Display


8.8.6 Changing the Language on the Device

If the **Language of the operation panel** was configured in DIGSI 5, you can select between the national language and US English on the device at any time.

- To reach the setting dialog for the language selection, press the function key **<F9>**.
- Use the **up/down** navigation keys to select the languages.
- Finally, confirm the setting changes with **Ok**.


Changing the Units System on the On-Site Operation Panel

- To reach the settings dialog for selecting the units, select the **Localization** menu in **Device functions**.
- To select the units system, press the **Change** softkey.
- Use the **Up/Down** navigation keys to select the units system.
- Finally, confirm the setting changes with **Ok**.

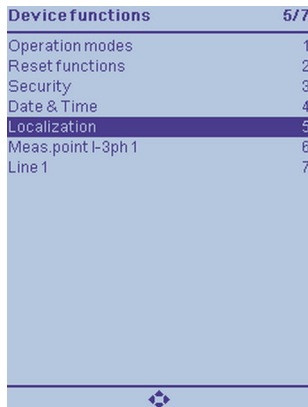

[scchggun1-050413-01.tif, 1, en_US]

Figure 8-51 Units System of the Country

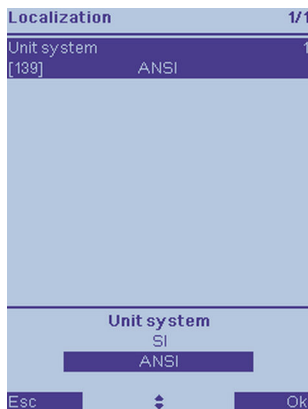


[scchggun2-050413-01.tif, 1, en_US]

Figure 8-52 Switching the Units System

Changing the Device Language on the PC in DIGSI 5

- To reach device information of your SIPROTEC 5 device in the menu, use the project-tree window. You can reach the device optionally via online access or via the project in which it must be created:
Online access → Interface → Device → **Device settings**
Project → Device → Settings → **Device settings**
- In the project-tree window, click **Device settings**.
- Select the language via the **Operation-panel language** parameter.

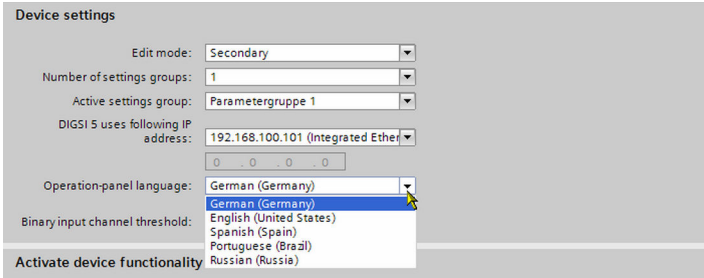

[scsprums-040613-01.tif, 1, en_US]

Figure 8-53 Language Change with DIGSI 5

- The setting is accepted in the device through **Load configuration in devices**.
- When prompted, enter the confirmation ID and finally click **Ok**.

The operation panel language changes automatically after it is downloaded from the PC to the device.

8.8.7 Changing Confirmation IDs

Authorization for security-relevant operations on the device directly via the on-site operation panel or DIGSI 5 is assured by the assignment of confirmation IDs. These confirmation IDs are assigned exclusively using DIGSI 5. You can find more information in the Security Manual.


Changing Confirmation IDs on the PC in DIGSI 5

To reach the menu for the confirmation IDs of your SIPROTEC 5 device, use the project-tree window.

Project → Device → **Security**


The confirmation IDs for 4 different access types will appear in the main window.

- Activate or deactivate a confirmation ID by setting or removing a check mark in the **Active** column.
- To change a confirmation ID, click the change button in the **Action** column. The change window opens.
- Enter the new confirmation ID (comprising 6 digits from 0 to 9) twice, and then confirm it with **OK**. The confirmation IDs are set ex factory as default (see table [Table 8-13](#)).

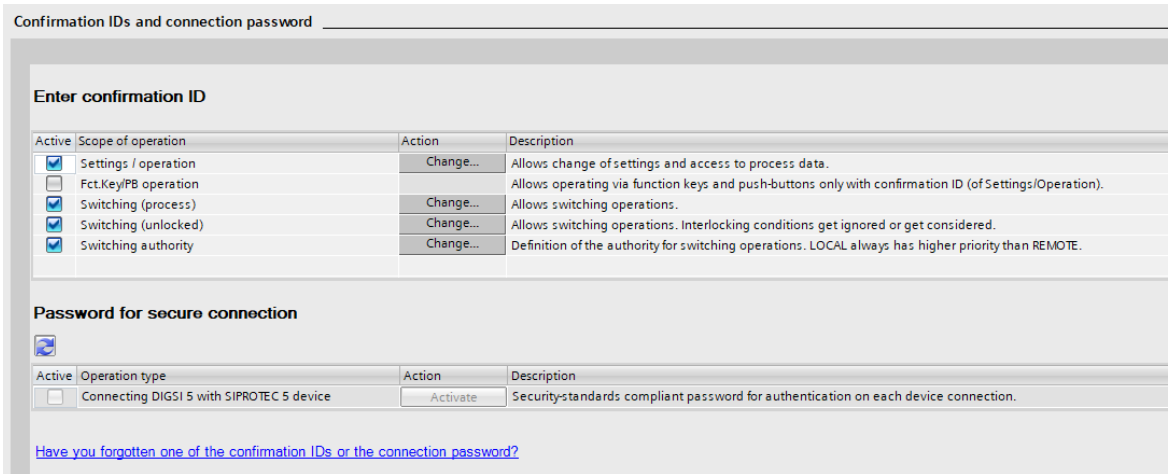

[sc_security_password_confirmationID, 2, en_US]

Figure 8-54 Window for Activating Confirmation IDs

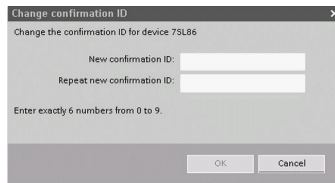

[scbstcod-210311-01.tif, 1, en_US]

Figure 8-55 Window for Changing Confirmation IDs

Table 8-10 Default Setting of Confirmation IDs

Operating Range	Default Setting
Read access	111111 ²
Set/operate	222222
Switching (operation)	333333
Switching (unlocked)	444444
Switching authority	666666

8.8.8 Setting Function Settings

Enter the function settings of your SIPROTEC 5 device preferably using the DIGSI 5. You have access here to all possible settings. Using the on-site operation panel you can make individual setting changes while the device is in operation.

Offline Settings Using DIGSI 5

To reach the function parameter settings of your SIPROTEC 5 device, use the project-tree window.


- Select Project → Device → Parameters → Function group → Function → **Function block**

The settings of the selected function block are displayed in the main window.

If multiple settings groups (see chapter [8.8.9 Settings Group Switching](#)) have been activated, first ensure that you are making your changes in the correct settings group. You can change this in the header of the main window if necessary. In another column of the main window, you can compare the setting values with those in another settings group.

- To change a setting value, click the setting arrows of the parameter concerned.
- For selection of settings, select a value from the displayed list of possible settings.
- For decimal parameters, you can change the setting value incrementally using the setting arrows, or enter the setting value directly via your PC keyboard. Setting values that are not permitted are indicated by a red background color and red exclamation marks in the affected areas of the project-tree window. DIGSI 5 cannot load invalid setting values into the device.


² This confirmation ID is automatically used internally for read operations; user details are not required for this non-modifiable confirmation ID.

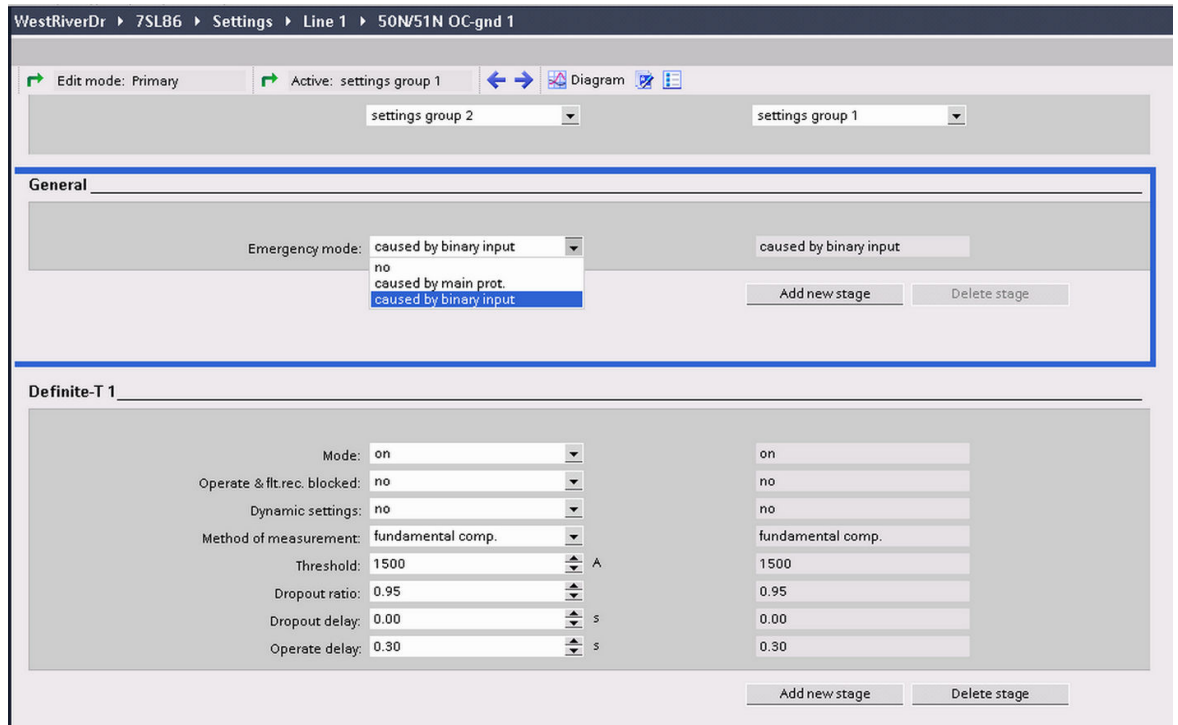

[scstfugr-030311-01.tif, 1, en_US]

Figure 8-56 Setting Function Settings in DIGSI 5

- When you are finished changing your settings, load the entire device configuration into the device.
- To do so, click with the right mouse button the **Load configuration in device** context menu.
- To load the setting changes for multiple devices via the system, press the project-specific **Load configuration in device** button in the project-tree window.

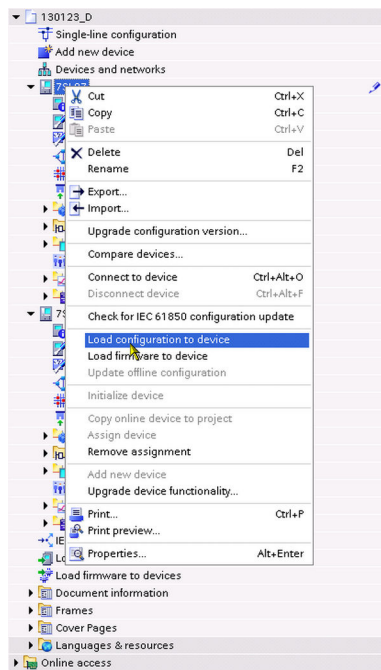

[scladknf-040613-01.tif, 1, en_US]

Figure 8-57 Loading Function Settings in the Device

Online Settings via DIGSI 5

You should always use the online setting if you want to change individual function settings of a device in operation. To reach the function settings of your SIPROTEC 5 device, use the project-tree window.

- Select Online access → Interface → Device → **Settings**

Settings on the Device Using the On-Site Operation Panel

Using the on-site operation panel you can access function settings while the device is in operation. To reach the function settings from the main menu, use the navigation keys on the on-site operation panel.

If multiple settings groups (see chapter 8.8.9 *Settings Group Switching*) have been activated, first ensure that you are making your changes in the correct settings group. You can change this as necessary.

- To do this, select Settings → General → **Change group settings** in the main menu

When the correct settings group is selected, proceed as follows:

- Select Main menu → Settings → Function group → Function → Function block

The active settings of the selected function are displayed in the device display.


- To select the parameter to be changed use the navigation keys or the number keys for direct selection according to the right sidebar.

Line data	1/10	Line data	1/10
System neutral point	03	System neutral point	03
[149] grounded		[149] grounded	
C1 per length unit	04	C1 per length unit	04
[112] 0.010µF/km		[112] 0.010µF/km	
C0 per length unit	05	C0 per length unit	05
[148] 0.010µF/km		[148] 0.010µF/km	
X per length unit	06	X per length unit	06
[113] 0.0525Ω/km		[113] 0.0525Ω/km	
Line length	07	Line length	07
[114] 60.00km		[114] 60.00km	
Line angle	08	Line angle	08
[108] 85.00°		[108] 85.00°	
Kr	09	Kr	09
[104] 1.00		System neutral point grounded suppression coil ground isolated	
Kx	10		
[105] 1.00			
CT saturation detection	18		
Change		Esc	Ok

[scaswfnk-080413-02.tif, 1, en_US]

Figure 8-58 Changing and Selecting Function Settings on the On-Site Operation Panel

- To change a parameter setting, click **Change** in the base bar dialog.
- If you are not yet authorized to access via **LOGIN**, you will be requested to input the confirmation ID.
- Use the number keys to enter the confirmation ID and confirm with **Ok**.
- For the selection of settings, use the navigation keys to select a value from the displayed list of possible settings.
- For decimal parameters, you can input the setting value directly using the number keys within the displayed setting range.
- Confirm your settings using **Ok** or **Enter**. Setting values that are not permitted are declined.
- To activate all changes made, press the left navigation key until you are prompted in the base bar to confirm or cancel the changes.
- Confirm your changes using **Ok**.



[scbstubn-080413-01.tif, 1, en_US]

Figure 8-59 Confirming Taking Over of Function Settings on the On-Site Operation Panel

8.8.9 Settings Group Switching

For different applications, you can save the respective function settings in so-called **Settings groups** and, if necessary, activate them quickly.

You can save up to 8 different settings groups in the device. In the process, only one settings group is active at any given time. During operation, you can switch between settings groups. The source of the switchover can be selected via a parameter.

You can switchover the settings groups via the following alternatives:

- Via the on-site operation panel directly on the device
- Via an online DIGSI connection to the device
- Via binary inputs
- Via communication connection to a substation automation technology
The communication protocols IEC 60870-5-103, IEC 60870-5-104, IEC 61850, DNP or Modbus TCP can be used for switching the settings groups.

A settings group includes all switchable settings of the device. Except for a few exceptions (for example, general device settings such as rated frequency), all device settings can be switched.

This section assumes multiple configured settings groups, and only describes the switching process. The function and their setting parameters are described in the chapter **Settings Group Switching** in the Device manual.

Settings Group Switching via DIGSI 5

Use the project-tree window to initiate settings group switching on your SIPROTEC 5 device. Settings group switching can be initiated both via the project (offline) and via the online access point.



NOTE

Bear in mind that the settings group in the project is switched by loading the DCF into the device. This causes an automatic device restart (reset). If you make other functional changes at the same time, a device restart can also occur in online mode or at the on-site operation panel. Switching without interrupting device operation may be performed only with online access.

Settings group switching via the project (offline)

- Select: Project → Device → Settings → Device settings → **Active settings group**
- Select the desired settings group and then load the DCF into the device.


For settings group switching via the online access point

- Select: Online access → Interface → Device → Settings → Device settings → **Active settings group**
- Select the desired settings group and then load the change into the device.

Settings Group Switching at the Device Using the On-Site Operation Panel

Use the navigation keys of the on-site operation panel to initiate settings group switching on your SIPROTEC 5 device.

- Select Main menu → Settings → General → **Change group**
- Using the navigation keys, go to the **Activat. of settings group** setting and click **Change** in the base bar dialog.
- If you are not yet authorized to access via **LOGIN**, you will be requested to input the confirmation ID.
- Use the number keys to enter the confirmation ID and confirm with **Ok**.

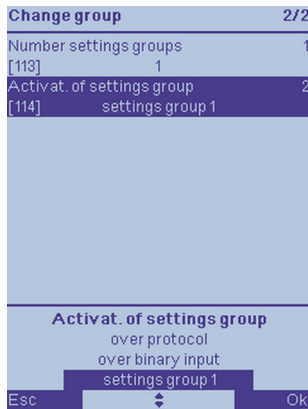

[scesakpa-080413-01.tif, 1, en_US]

Figure 8-60 Setting the Active Settings Group on the On-Site Operation Panel

- Use the navigation keys to select the settings group to be activated from the displayed list of possible settings.
- Confirm your settings using **Ok**.
- To activate settings group switching, press the left navigation key until you are requested to confirm or cancel in the base bar.
- Confirm your changes using **Ok**.



[scbstubn-080413-01.tif, 1, en_US]

Figure 8-61 Confirming Taking Over of Changes on the On-Site Operation Panel

Settings Group Switching via Binary Inputs

For settings group switching via binary inputs on your SIPROTEC 5 device, you first have to set the **Settings group activation** setting to **via binary input**.

You must also have configured the binary input signals that are necessary for switching the settings group to the contacts of your device. You will find these in DIGSI 5 under:

Project → Device → Information routing → General → >PG Selection Bit 3/Bit 2/Bit 1

100 ms after one of the 3 signals is changed (stabilization time), the signal image present will lead to a switching to the corresponding settings group. The following table shows the possible binary codes (BCD) and associated settings groups (PG). From the table you can also determine which input signals you have to route depending on the number of settings groups.

Example: To ramp up the device, the parameters **Number of settings groups = 4 (PG 4)** → >PG Selection Bit 1, and >PG Selection Bit 2 must have been routed to binary inputs.

Table 8-11 Binary Codes of the Signal Inputs and Associated Settings Groups

BCD Code via Binary Inputs	SG 1	SG 2	SG 3	SG 4	SG 5	SG 6	SG 7	SG 8
>PG selection bit 3	0	0	0	0	1	1	1	1
>PG selection bit 2	0	0	1	1	0	0	1	1
>PG selection bit 1	0	1	0	1	0	1	0	1

Settings Group Switching via Control

When using the **Control** function for switching, the settings groups can be switched via a communication connection from the substation automation technology or via a CFC chart.

The communication protocols IEC 60870-5-103, IEC 60870-5-104, IEC 61850, DNP or Modbus TCP can be used for switching the settings groups via a communication connection.

In order to use a CFC chart for switching, you must create a new CFC chart in DIGSI 5. Create the CFC chart in the DIGSI 5 project tree under **Name of the device** → **Charts** → **Add new chart**. Link the signals that control settings group switching in the CFC chart.



NOTE

The device starts in this mode after a DCF upload (offline mode), using the active settings group 1. The device is informed about a settings group change via the substation automation technology only. As long as the substation automation technology command is pending, protection runs using the settings from active settings group 1.

If the **Control** mode is changed in online mode (settings changes via DIGSI 5 or the on-site operation panel), the device continues to run with the last active settings group. If a substation automation technology command for a settings group change is sent or the mode for settings group switching is changed, this state ends. In the case of a device warm start, the device starts in the mode of the most recently active settings group.

8.9 Control System on Site


8.9.1 General

You can execute switching device control via a connected substation automation system and through DIGSI 5. You can also control the device directly via the keyboard. The large graphic display is best suited for this purpose but control is also possible with the small display.

Operation of switching devices is subject to different safety tests such as switching authority and switchgear interlocking protection-function test. You will find a detailed description of these functions in the Device manual in the chapter **Control Functions**. To facilitate access to on-site control only for authorized persons, you can set parameters of a confirmation ID using DIGSI 5.

8.9.2 Menu Structure

If you go to the main menu of the device and select the **Control** menu item, you get the following submenu:

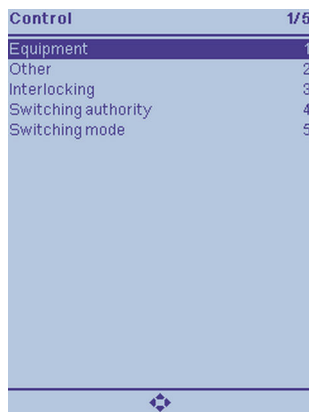

[scstemen-090413-01.tif, 1, en_US]

Figure 8-62 Control Menu on the Device Display

Table 8-12 Subitems of the Control Menu with Meaning

Menu Item	Submenu	Meaning
Equipment	Display	Display of current state of all switching devices.
	Control	Display of current state of all switching devices. You have the possibility to transmit a switching command.
	Acq.blk./man.update	Display of current state of all switching devices. If acquisition blocking is placed for the switching device, you have the option of a manual update. Acq.blk. (appears after selecting Change): allows you to place acquisition blocking for a switching device. Entry of the confirmation ID is necessary.
	Status	You are notified about the status of the individual switching devices with respect to acquisition blocking, manual update.
Other	Display	As for the Equipment item, but for user-defined objects of type DPC (double command), SPC (single command), and PLC (marker).
	Control	
	Acq.blk./man.update	
	Status	

Menu Item	Submenu	Meaning
Interlocking	One line for every switching device	Display of interlocking status of the switching devices with the letters S, D, P and B. • S = Check of switching authority • D = Check of double-activation blocking • P = Check whether position is reached • B = Check of blocking by protection
Switching authority	Switching authority = Local	Display of current switching authority. If the device does not have a key switch, a change dialog is displayed and you can enter the change via the device keyboard. If the device has a key switch, the Switching authority menu bar is static and a change can be made only via the key switch.
Switching mode	Switching mode = Interlocked	Display of current switching mode. If the device does not have a key switch, a change dialog is displayed and you can enter the change via the device keyboard. If the device has a key switch, the Switching mode menu bar is static and a change can be made only via the key switch.

8.9.3 Switching Authority

The switching authority ensures that simultaneous control can be done only from one command source. For example, you must prevent a switching command from being executed by the control center during field work. To do this, you must set the switching authority to **Local**. SIPROTEC 5 recognizes the following switching authorities:

- Local
- Remote/station
- Remote/control center

The **Remote/station** switching authority level was redefined in IEC 61850. You can deactivate the switching authority in the device. Full support for this level is ensured only in devices with the IEC 61850 protocol.

The **Remote/control center** switching authority is normally used as the remote switching authority. You can change the switching authority from **Local** to **Remote** Using the top key switch. You can also set this switch-over in devices without the key switch after entering the confirmation ID.

8.9.4 Switching Mode

Changing the Switching Mode



DANGER

Danger due to hazardous voltages during the operation of electric devices

Noncompliance with the safety notes will result in death or severe injuries.

- ✧ Only electrically qualified personnel may work on these devices. The electrically qualified personnel must be thoroughly familiar with pertinent safety regulations and precautionary measures as well as the warnings in this manual.

If you perform non-interlocked switching, for example, in the commissioning phase, you can change the switching mode during operation.

You can set the switching mode using the key switch. Non-interlocked switching is permitted in the horizontal key position (Interlocking OFF). Only interlocked switching is allowed in the vertical key position.

Proceed as follows for devices without a key switch:

- ✧ Select the menu item **Commands** in the main menu.
- ✧ Go to the menu item **Switching mode**.
- ✧ Select **Interlocked** or **Non-interlocked** and confirm with **Ok**.
- ✧ You can set this switchover after entering the confirmation ID.

8.9.5 Control with Graphic Display

Devices with a graphic display can depict a single-line diagram of the field in the control display, see [Figure 8-63](#). You can create the control display with the display editor of DIGSI 5. The display becomes active directly after activation. You can reach the display at any time by pressing the yellow <Ctrl> key.

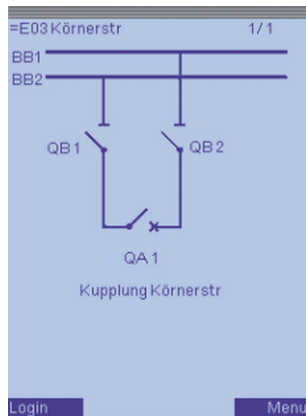


Figure 8-63 Control Display

Selecting Switching Device


From this control display you can select the individual switching devices using the navigation keys. After the position has been switched, the feedback is shown directly in the control display. A separate **default display** (single line without control capability) is not present but can be created.

Refer to the notes in chapter [5.3 Displays for Indication and Control](#).

Initiating command

- Select the switching device to be controlled using the navigation keys.
- Then enter the new target position **ON** or **OFF** with the corresponding control key (green <I> for **ON**, red <O> for **OFF**).
- Confirm the query with the softkey marked Ok in the display.


If the switching operation is permissible, it is executed, otherwise you receive a notification about the cause of rejection.

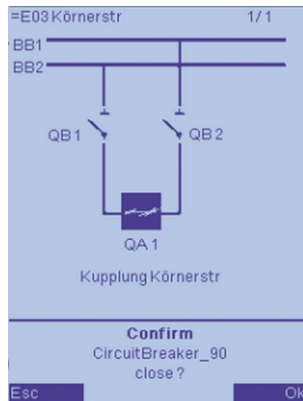

[scauswqa-090413-01.tif, 1, en_US]

Figure 8-64 Selecting a Switching Device in the Control Diagram

You can also initiate a control action via the navigation keys after selecting a switching device. To do so, select **Open** or **Close** in the menu and confirm with Ok.

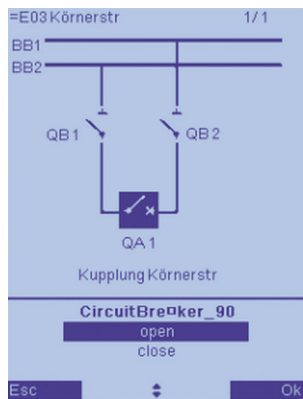

[scsteuvo-090413-01.tif, 1, en_US]

Figure 8-65 Initiating Control Action

8.9.6 Control with Small Display


For devices with the small display, you can control from the switching device list, in the same way as for devices with the large display. A single-line representation of the feeder is impossible here.

- Select the list of all switching devices in **Commands/Equipment** and then the switching device to be controlled in the **Control** menu item.

The currently recorded position is shown to you.

- You now control via the right context-sensitive key (labeled **Switch**).
- Then select the target position (**off** or **on**).
- Confirm the query of the confirmation ID.

After entering the confirmation ID for on-site control, the switching command is output while considering the interlocks (switchgear-interlocking protection conditions, switching authority, etc.).

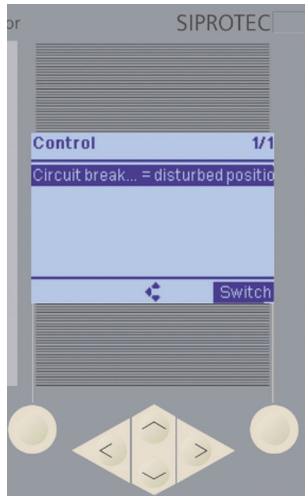

[sckIndis-090413-01.tif, 1, en_US]

Figure 8-66 Control from the List on the Small Display


8.9.7 Acquisition Blocking and Manual Updating

During commissioning, maintenance, or testing, a brief interruption of the connection between the logical signals and binary inputs may be useful. It allows you to manually update the status of a switching device that is not providing feedback correctly. Before this can take place, you must first set acquisition blocking.

To set the acquisition blocking, proceed as follows:

- Using the navigation keys, move in the **main menu** of the device display to **Commands→Equipment→Aq.blkman. update**.
- Select the appropriate device (for example, a circuit breaker) from among the several switching devices using the navigation keys.
- Press the **Change** softkey.
- Enter the confirmation ID (not relevant for active role-based access control (RBAC) in the device).
- Confirm the process with the softkey marked **OK** in the display.

After entering the confirmation ID (only with the RBAC inactive), acquisition blocking is switched on.

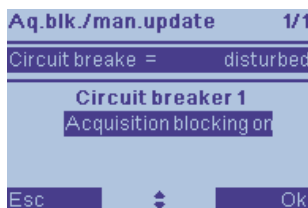


[scterfass-310816-01, 1, en_US]

Figure 8-67 Activating Acquisition Blocking


Manual updating of the switching device is possible from within the same menu.

- Select **Manual update** (Figure 8-68) using the navigation keys.
- Select the switching device setting to be updated manually using the navigation keys (for example, **off**, Figure 8-69).
- Confirm the process with the softkey marked **OK** in the display.

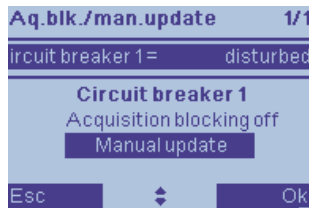

[scstatus-310816-01, 1, en_US]


Figure 8-68 Activating Manual Update

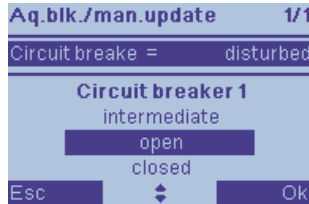

[scstatu2-310816-01, 1, en_US]

Figure 8-69 Selecting Position

The manually updated position of the switching device will be displayed.

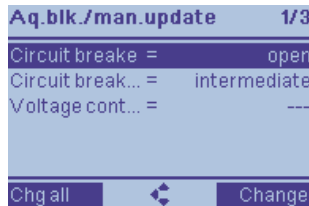

[scstatu3-310816-01, 1, en_US]

Figure 8-70 Position of the Switching Device



NOTE

For security reasons, manual updating is possible only directly through the on-site operation panel of the device and not through DIGSI 5.



NOTE

Setting acquisition blocking and the subsequent manual updating are also possible via the IEC 61850 system interface.

You can also set acquisition blocking via a binary input. If you want to put the feeder or the switching device in revision, you can set the acquisition blocking for an individual or several switching devices with an external toggle switch. For this purpose, every switching device in the **Switch** function block (circuit breaker or disconnector switch) has the input signal **>Acquisition blocking**. This signal can also be set from the CFC.

Information			Source												Destination		
			Binary input												Binary output		
			Base module												Base module		
Signals	Number	Type	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	2.1	2.2	2.3		1.1	1.2	1.3
(All)	(All)	...	...	...	...	...	...	...	...	...	...	...	...	(All)	...	...	...
▶ Trip logic	201.5341																
▼ Circuit break.	201.4261		*	*											*	*	
▶ >Ready	201.4261.500	SPS															
▶ >Acquisition blocking	201.4261.501	SPS															
▶ >Reset switch statist.	201.4261.502	SPS															
▶ >Reset AcqBlk&Subst	201.4261.504	SPS															
▶ External health	201.4261.503	ENS															

[scbeerfa-190215, 1, en_US]

Figure 8-71 Input Signals >Acquisition Block and >Release Acquisition Block & Manual Updating on the Switching Device



NOTE

Interlockings are carried out with the status changes of the switching device. Remove acquisition blocking again manually. Otherwise, position changes of the switching device are not detected and interlockings are ineffective.

If the acquisition blocking and the manually updated position are set using the operation panel of the device or the system interface IEC 61850, these are retained until the acquisition blocking is manually deactivated. When you initially start the device, the acquisition blocking is deactivated.

Except for a restart, the acquisition blocking and the manually updated position are retained.

If the acquisition blocking is activated via the input signal **>Acquisition blocking**, it is retained as long as the binary input is active.

To set the acquisition blocking of a switching device, the following sources are possible:

- Operation panel of the device
- System interface IEC 61850
- Input signal **>Acquisition blocking**

All sources undergo OR operations, that is, the acquisition blocking remains set until all the sources are deactivated.

After deactivation of the acquisition blocking, the actual position of the switching device is adopted and displayed in the operation panel of the device.



NOTE

When the acquisition blocking is activated or the switching device updated manually while the entire device or the switching device is in test mode, these states are not saved. The acquisition blocking and the manual updating are not retained after a restart.

The acquisition blocking and the manual update for the circuit breaker, the disconnector, and the tap changer are reset by way of the **>Reset AcqBlk&Subst** binary input. Setting acquisition blocking and manual update is blocked with the input activated.

8.9.8 Status Display

You reach the following display through the **Status** menu item:

Status 1/4			
Circuit breaker 1	-	-	CB
Disconnecter 1	AB	MU	-
Disconn. status 1	-	-	-
Tap changer 1	AB	-	-

[scstatus-090413-01.tif, 1, en_US]

Figure 8-72 Status Display of Switching Devices

The meaning of the status columns is as follows:

AB = Acquisition blocking active (acquisition blocking for the switching device is set)

MU = Manual update (switching device was manually updated)

CH = Chatter blocking active (Chatter blocking has been activated and is still set)

8.9.9 Setting a Marker

In order to be able to set a marker manually with a device operation, you must activate a cross in the **Control Menu** column in the DIGSI 5 information matrix (see [Figure 8-73](#)).

Information			Destination												Fault records		Logs		HMI
			LEDs																
			Expansion housing 1																
Signals	Number	Type	21	22	23	24	25	26	27	28	29	30	31	32	Recorder	O	F	Control menu	
(All...)	(All...)	(...)													(All...)			(All...)	
▶ Interlocking	-1.-1.4230																		
▶ Circuit break.	-1.-1.4260																		
▼ User-def. FB 1	-1.-1.-1																	*	
▶ Mode	-1.-1.-1.0	ENC																	
▶ Behavior	-1.-1.-1.0	ENS																	
▶ Health	-1.-1.-1.0	ENS																	
▶ Marker Com.	-1.-1.-1.0	SPC																X	

[scrangma-090413-01.tif, 1, en_US]

Figure 8-73 Routing of a Marker to the Operating Menu

The marker appears in a list, for example, under

Commands → Additional → **Display** or → **Status**.

At this point you can observe or vary the current status.



NOTE

To change the state of a marker (from **On** to **Off** or vice versa), you need to enter the confirmation ID for control.

8.9.10 Assignment of Authorizations with Confirmation ID

Sensitive operations during on-site operation are authorized by the assignment of confirmation IDs (see also Security Manual C53000-H5040-C081).

[Figure 8-74](#) shows an example of a device without a key switch. For devices with key switches, the confirmation IDs are not required for non-interlocked switching and for the switching authority. These are replaced by the corresponding key switches for non-interlocked control and for **local** switching authority.

Confirmation IDs and connection password

Enter confirmation ID

Active	Scope of operation	Action	Description
☒	Settings / operation	Change...	Allows change of settings and access to process data.
☐	Fct.Key/PB operation	Change...	Allows operating via function keys and push-buttons only with confirmation ID (of Settings/Operation).
☒	Switching (process)	Change...	Allows switching operations.
☒	Switching (unlocked)	Change...	Allows switching operations. Interlocking conditions get ignored or get considered.
☒	Switching authority	Change...	Definition of the authority for switching operations. LOCAL always has higher priority than REMOTE.

Password for secure connection



Active	Operation type	Action	Description
☐	Connecting DIGSI 5 with SIPROTEC 5 device	Activate	Security-standards compliant password for authentication on each device connection.

[Have you forgotten one of the confirmation IDs or the connection password?](#)

[sc_security_password_confirmationID, 2, en_US]

Figure 8-74 Assignment of Confirmation IDs

Table 8-13 Confirmation IDs

Name	Description
Settings/operation	Authorization to change settings on the device display and DIGSI 5
Fct.Key/PB operation	Access to process data is possible with the help of push-buttons and function keys. The confirmation ID of Settings/operation is requested.
Switching (process)	To prevent unintentional switching of combined protection and control devices, this general authorization for switching on site is available. Release for manual placement of markers
Switching (unlocked)	Only in devices without key switch authorization for unlocked switching (only effective in devices with parameterized switchgear interlocking protection conditions)
Switching authority	Only in devices without key switch release of On-site switching authority, and hence of control on the device display
Switching (without synchro-check)	Authorization for unsynchronized switching of a circuit breaker (only in devices with activated synchrocheck)

8.9.11 Control with Function Keys

8 of 9 function keys can also be used for control. Function key <F9> is hardcoded for language switching. Using a function key you can initiate a switching sequence, for example, to switch on a feeder.

- You reach the function keys by pressing the blue <Fn> key and the corresponding digit from <1> to <9> in the numerical keypad.
- Define your switching sequence using the CFC editor.
- Link a single command (type SPC) in the information routing matrix with the desired function key.
- Connect this single command with a SPC_INFO block that starts the switching sequence.

9 Commissioning

9.1	Overview	212
9.2	Test Suite Integrated in the Device	213
9.3	Initial Startup	222
9.4	Secondary Tests	225
9.5	Primary Tests	228

9.1 Overview

This chapter contains information about the commissioning of the SIPROTEC 5 device. Test functions integrated in the device support you during testing, simplify testing processes and reduce testing times. You will get an overview of the numerous possibilities of initial startup in chapter [9.3 Initial Startup](#).

The secondary test described in chapter [9.4 Secondary Tests](#) is used for checking:

- Correct setting of functions
- Routing of logical signals to the binary inputs and outputs
- Interfaces and many more


Chapter [9.5 Primary Tests](#) deals with the primary test and contains information about the test method. Information specific to protection functions can be found in the device manual.

The following chapter gives you an overview of the test functions integrated in the device. You can find the offline testing options during engineering in the DIGSI 5 online help.

9.2 Test Suite Integrated in the Device

9.2.1 Test Functions

After you complete the initial startup (see chapter [9.3 Initial Startup](#)), you can access the test functions integrated in the device. To do this, establish connection to the online device. In the project tree, open the Folder **Test Suite**. Underneath you will find the individual test points that are explained to you in the following chapters. The following figure shows the project tree.

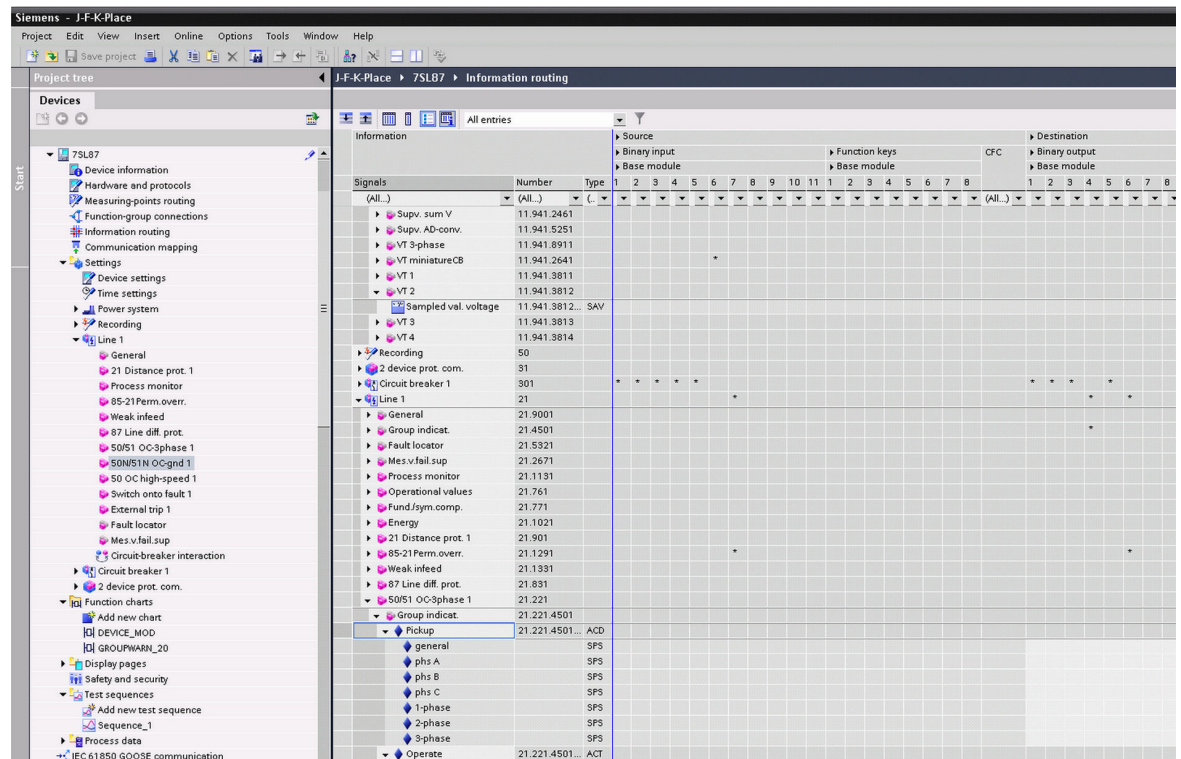

[scproans-110413-01.tif, 1, en_US]

Figure 9-1 Project Tree

If you have activated a connection password for the device, you must enter it in the corresponding dialog. After correct password entry, the connection between DIGSI 5 and device is established. In case of wrong entry, the connection is not established.

If you have configured a confirmation ID with DIGSI 5, this is queried when you access the individual test functions. Enter here the corresponding 6-digit number.

You will find details for configuring the password and the confirmation ID in the Security Manual.

If the connection between DIGSI 5 and the device is interrupted during a test function, re-establish the connection to the device. Then do a reset on the device with DIGSI 5. If no connection can be established, then do the reset directly on the device through the on-site operation panel. After successful reset, the device is now in a normal operating state [9.3.3 Initializing Device and Verifying Basic Status](#).




NOTE

The device must be set in another mode for most tests. If the tests occur in a system in operation, ensure that the running operation is interrupted.

After successful tests, bring the device back to the previous mode in the following manner:

- Confirm the link **Show device mode** in the upper right of the work window.

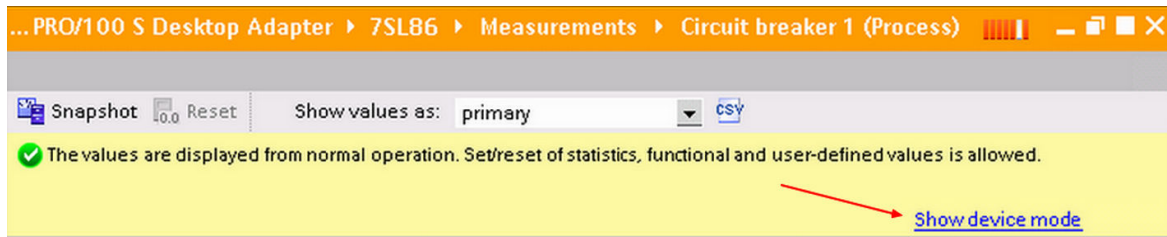

[scgemoaz-210611-01.tif, 1, en_US]

Figure 9-2 Top Rail in the Working Window

- Select the previous mode in the working area **Device information** under **Device mode**.
- Click the **Restart** button.


9.2.2 Testing Current and Voltage Inputs

If you click in the project tree according to [Figure 9-1](#) on the menu item **Analog inputs**, a visualization of the current values of the measuring points that exist in the device will appear in an editor. On the left side you will see the phasor diagram for 3-phase analog inputs (absolute value and phase). To the right the measured values are displayed as numerical values. The primarily measured values for voltage and current are shown as indicators of absolute value and phase. The reference is the voltage in phase A of measuring point 1. If no voltage is connected, the current in phase A of measuring point 1 serves as the reference. All indicated phasor values refer to the reference quantities.

You can identify and verify the following errors with measured-value control:

- Turner in the analog wiring
- Vector group
- Direction between current and voltage

Devices connected via effective connections can also represent analog measuring points of remote ends as phasors. In this case, the phasors of measuring points of up to 6 remote ends are shown. For example, the stability of a line differential protection can thus be verified.

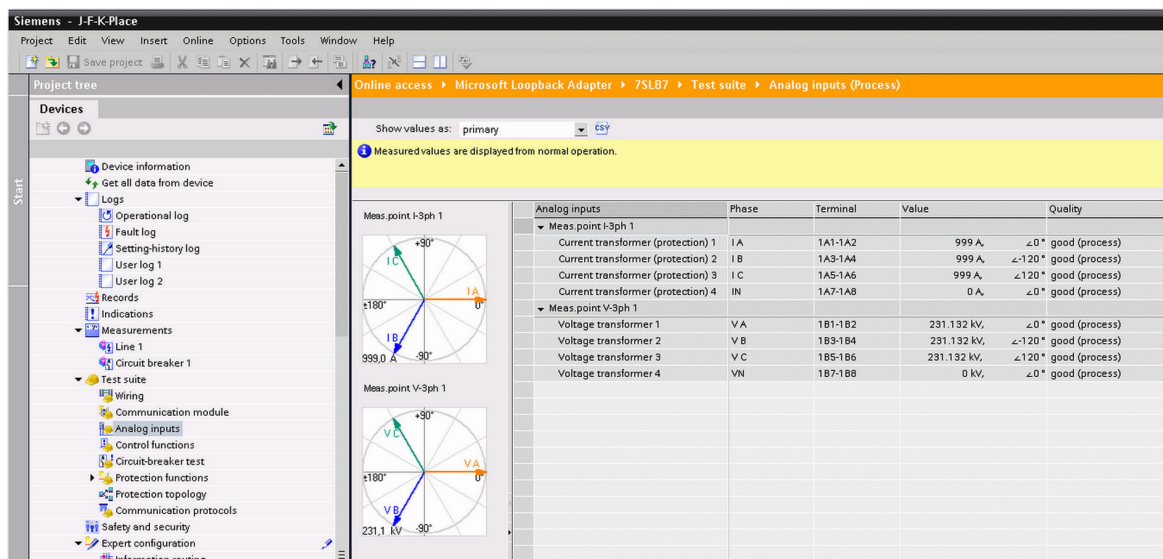

[sctstane-140211-01.tif, 1, en_US]

Figure 9-3 Example of a Check of Analog Inputs

Test sequence:

- Feed the test quantities to the terminals (for example exchange terminals in the control cabinet) using multiphase test equipment. Siemens recommends a test with the rated values and the infeed of current and voltage in phase. The test functions from 10 % of the rated quantity.
- Check the measuring result in the DIGSI 5 operating program (absolute value and phase). Make use of the phasor diagram as well as the indicated measured values. Check phase displacement between voltage and current as well.
- In the event of implausibility, first check the proper connection of the test equipment and the angle between voltage and current set in it. Then check the wiring to the device, as well as the settings (for example under **Power-system data**).

Figure 9-3 shows you the result of a successful test on a device which has 4 voltage and current inputs.



NOTE

To check the wiring between device and connected transformers, Siemens recommends that this test be done on the plant with primary measured signals. This allows you to check the correct connection of secondary circuit completely.



NOTE

The device remains in commissioning mode until you set the device in the process mode consciously or until the internal monitoring time (statement of time) has expired. You reach the process mode by clicking the link in the upper right of the working area. The settings sheet **Device information** opens. Go to **Device mode** to set the device in process mode.

You can execute more tests in this mode.

9.2.3 Testing Protection Functions

The purpose of this test is to verify the correct setting of protection functions and the routing of signals. To do this, you can feed the test signals with test equipment. Digital test equipment offers you multiple test programs and test sequences.



NOTE

Simulation mode is indicated by flashing of the top line of the device display.



NOTE

If you only want to select a graphical representation of a protection function, all available and active protection functions of your SIPROTEC 5 device are checked.

Simple tests can also be done via simulation mode on the device and DIGSI 5 interaction. To do this, use DIGSI 5 to generate test sequences which are then executed in the device without the need for external test equipment and which simulate the change in values on the inputs.


- Click the **Test sequences** folder in the project tree.
- Open this folder by double-clicking.

Under the **Create test sequence** menu item create your test sequence which, for example, consists of 3 steps: the pre-fault, the short circuit and the post-fault. You can save the created sequence and use it for other tests. You will also find the stored sequence under the **Test sequences** folder. Sequences can be copied between devices that have the same measuring points.

Figure 9-4 shows you the editor for creating test sequences. You can enter a name (for example, pre-fault, post-fault) for every test step. You can set the duration of the current test sequence, as well as the duration of

a ramp. You can define amount and phase angle for each phase of a measuring point. You can select the frequency in 3 phases for each measuring point.

Additionally you can define a ramp for each phase via amplitude, phase or frequency via the ramp functions. You can still define 3 various harmonic superimpositions per phase. This allows the setting of ramps within one test step. If additional binary inputs are effective, you can adjust that in the section below. Using a hook tag which binary input is active during the test step. If a voltage (corresponds logically to 1) is present, the binary input is active.

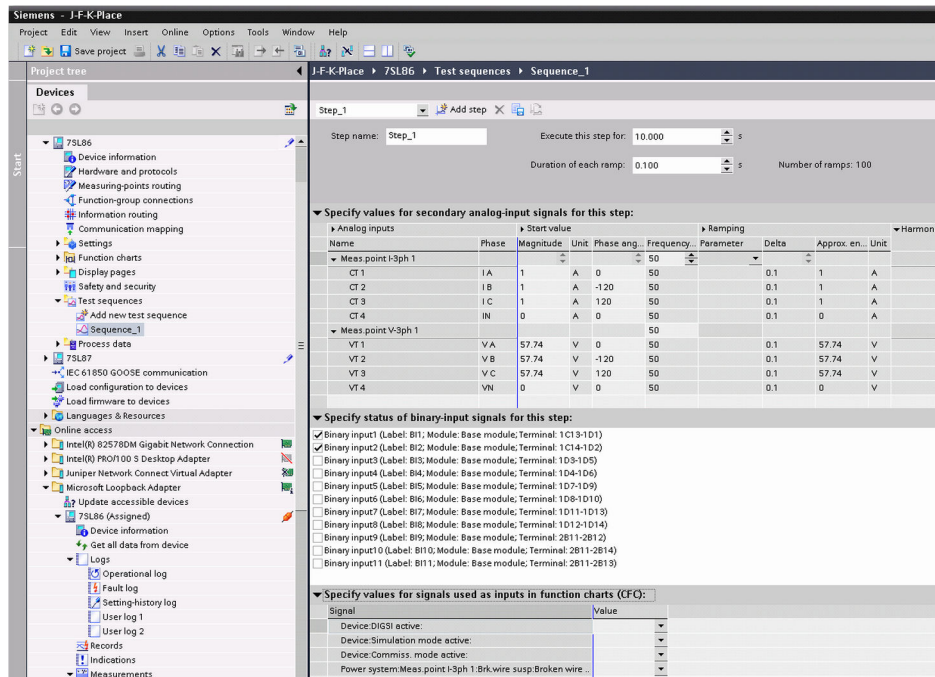

[scprfsqu-150211-01.tif, 1, en_US]

Figure 9-4 Creating a Test Sequence

You can use a created test sequence, for example, for a protection function test. Start a test sequence in the protection function test editor in DIGSI 5. You can also start a test sequence through a binary input of the device. By starting through a binary input you can play back test sequences in several devices simultaneously. You lay down the start criterion for the device using DIGSI 5 [Figure 9-5](#). The test quantities are fed as sampled values directly into the functions of the device by bypassing the analog and binary inputs. Before starting a sequence DIGSI 5 switches the device to a simulation mode that activates the internal signal generator.

To check a protection function systematically, click again in the project tree the **Test** button and open the **Protection function test** menu item. You are offered the existing protection functions and you can select which protection function is tested. The characteristic curve of the protection function appears in the operating range (see [Figure 9-5](#)). The measured values are displayed in color in the characteristic curve and the list of spontaneous indications is updated simultaneously. Feeding through a test sequence is done in this simulation mode where the protection functions work with the calculated sampled values of the sequence.


Switching to an internal sequence is done in DIGSI 5. The designated sequence is selected (it must first have been configured offline), loaded into the device and its progress activated.

A SIPROTEC 5 device has numerous protection and supervision functions that work in parallel. For the tests switch some or only the function to be tested. For this purpose, a test aid that greatly simplifies the test for you was set up in SIPROTEC 5.

The protection functions have indirectly the same setting as when you switch the mode to **Test** in the function. In this state, the protection function is active. In addition, a test bit is generated and transmitted with every indication. In the **Test** setting the routed relay in the device is not activated and the circuit breaker is thereby not actuated.

Upon exiting of the test mode, the execution of an authorized test period or the conscious switching to the normal operating state (**Process mode**) leads to the deactivation of the temporary settings. The original

setting then becomes active. You can also make use of this test menu to have a quick overview of available and enabled protection functions.

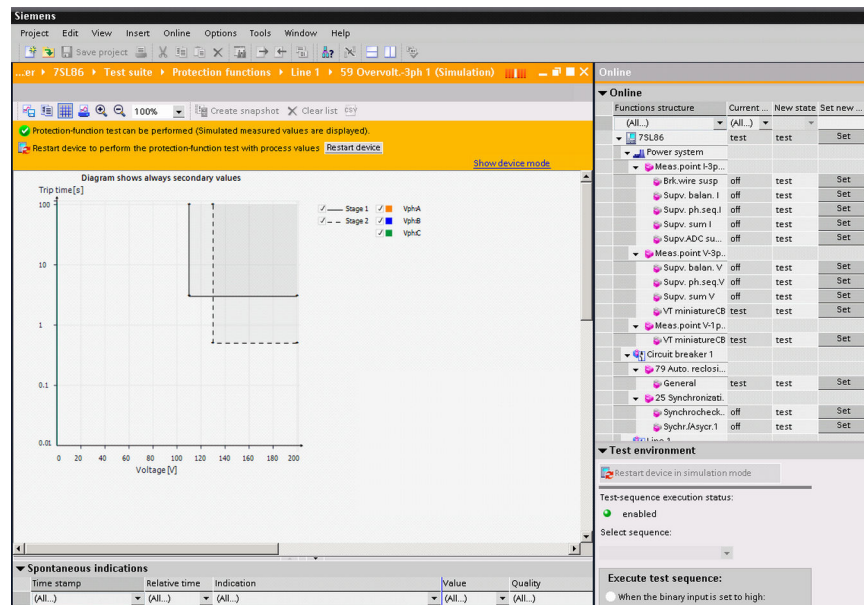

[scprscfk-160413-01.tif, 1, en_US]

Figure 9-5 Testing a Protection Function (Example, Overvoltage Protection)



NOTE

The device remains in commissioning mode until you set the device in the process mode consciously or until the internal monitoring time (statement of time) has expired. You reach the process mode by clicking the link in the upper right of the working area. The settings sheet **Device information** opens. Go to **Device mode** to set the device in process mode.

You can execute more tests in this mode.

9.2.4 Creating Signals for Communication Interfaces

The test editor serves to set signals or states in the device that are then output via the communication interfaces.

9.2.5 Testing Switching Devices

During a primary test the device in combination with DIGSI 5 offers the possibility of checking switching devices. Click again the **Test** button and open the **Control functions** menu item. The existing switching devices appear in the operating range. You can set the switching state and read in the status again. To do this, activate the respective switching device and execute the desired actions. The spontaneous indications log the behavior of the switching device (see [Figure 9-6](#)). You can verify the interlocking conditions by opening or closing disconnectors or grounding switches. This takes place via the binary feedbacks on the device. Induce unauthorized circuit states and check whether the interlocking logic stored in a CFC plan works correctly in the device.



WARNING

Warning of danger due to unauthorized switching states

Noncompliance with safety notes means that death, serious injuries, or considerable material damage can occur.

- ✧ Primary tests may be done only by personnel who are skilled electricians and who are familiar with the startup of protection systems, with the operation of the system and with safety regulations and provisions (switching, grounding, etc.).

Apart from circuit breakers and disconnectors, you can also increment transformer tap switch higher or lower and check arc-suppression coils.



NOTE

This switching function is used exclusively for testing. Operational switching operations are performed with the on-site device control or with a connected substation automation technology.

Online access ▶ Microsoft Loopback Adapter ▶ 7SL86 ▶ Test suite ▶ Control functions (Process)

CSV

✓ To start control function test, select one of the options below: Key switch of device is set to "Local"

⚠ Recommended [Switch application to test mode](#) or: [Enable control function in process mode](#)

Interlocking conditions are ignored. [Consider interlockings](#) [Show device mode](#)

▼ Control functions

Control functions	Current value	New value	Control operations			Interlocking con...	Quality
			Select	Operate	Cancel		
Circuit breaker 1:Control:Cmd. with feedback	intermediate	close	Select	Operate	Cancel	Fulfilled	good (process)
Disconnector 1:Control:Cmd. with feedback	open	open	Select	Operate	Cancel	Fulfilled	good (process)
Disconnector 2:Control:Cmd. with feedback	open	open	Select	Operate	Cancel	Fulfilled	good (process)

III

▼ Spontaneous indication responses

Time stamp	Indication	Value	Additional information	Quality
(All...)	(All...)	(All...)	(All...)	(All...)
10.03.2011 09:00:44.230	Disconnector 1:Control:C...	OPR- open	object not selected	good (process)
10.03.2011 09:00:37.493	Disconnector 1:Control:C...	OPR- close	object not selected	good (process)
10.03.2011 09:00:25.153	Circuit breaker 1:Control:...	OPR- close	object not selected	good (process)

[scschver-150211-01.tif, 1, en_US]

Figure 9-6 Checking Switching Devices and Interlocking Conditions

- ✧ If special confirmation IDs are activated for this test, these must be entered prior to the test. This applies, in particular, to non-interlocked switching. For this purpose, the switching authority must be on **Remote** and DIGSI 5 must be authorized to carry out switching operations.




NOTE

The device remains in commissioning mode until you set the device in the process mode consciously or until the internal monitoring time (statement of time) has expired. You reach the process mode by clicking the link in the upper right of the working area. The settings sheet **Device information** opens. Go to **Device mode** to set the device in process mode.

You can execute more tests in this mode.

9.2.6 Circuit-Breaker Test

- ✧ To test circuit breakers, go to **Test suite** and open the **Circuit-breaker test** menu item. The existing circuit breakers then appear in the operating range (see [Figure 9-7](#)).
- ✧ You can bypass the interlock of the circuit breaker. You can activate the circuit breaker 3-pole or every circuit-breaker pole separately depending on the type of the circuit breaker. The feedbacks from the circuit breaker are shown to you in the bottom part of the window. DIGSI 5 shows you the available test sequences. Before execution of the test, a confirmation ID is queried.

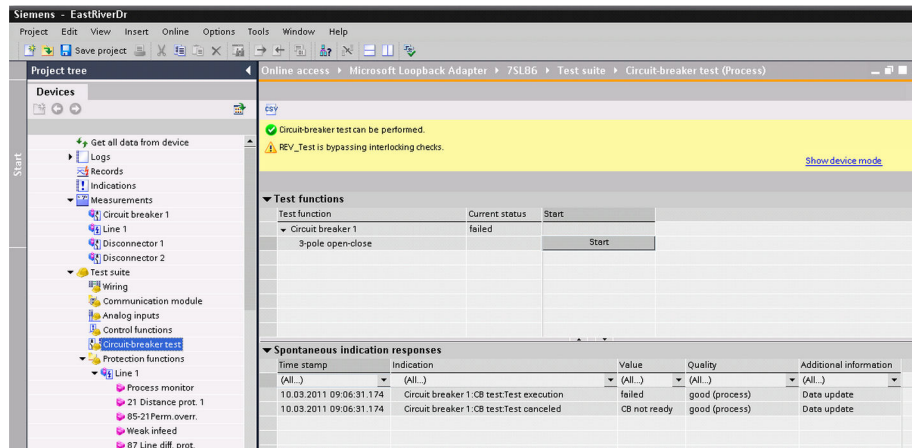

[sclsscpr-110413-01.tif, 1, en_US]

Figure 9-7 Circuit-Breaker Test




NOTE

The device remains in commissioning mode until you set the device in the process mode consciously or until the internal monitoring time (statement of time) has expired. You reach the process mode by clicking the link in the upper right of the working area. The settings sheet **Device information** opens. Go to **Device mode** to set the device in process mode.

You can execute more tests in this mode.

9.2.7 Device Information and Diagnosis

In online operation, if you open the **Device information** table in the project tree, you get a lot of information about the device. The table appearing in the operating range shows different tabs with corresponding information about the device. [Figure 9-8](#) gives you an overview of the numerous possibilities.

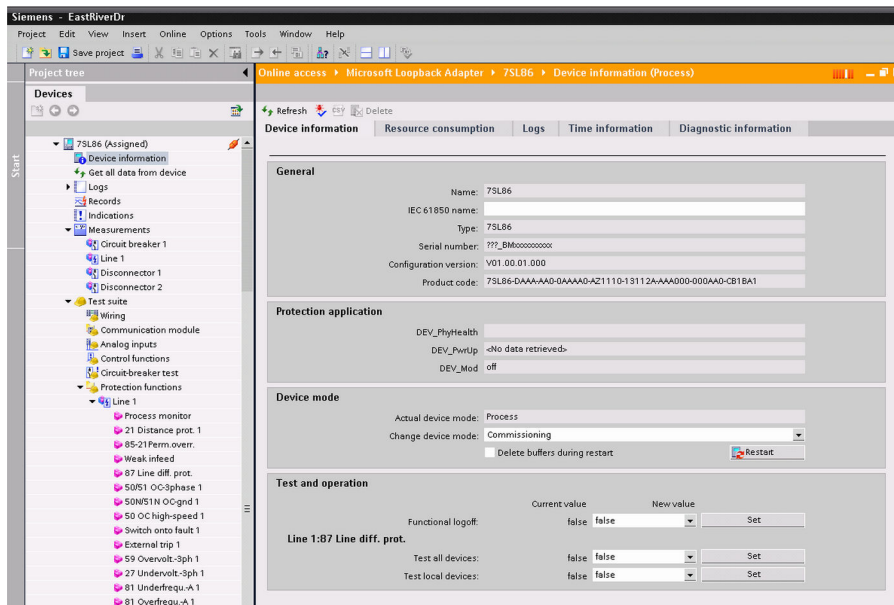

[scgerinf-100413-01.tif, 1, en_US]

Figure 9-8 Device-Information Worksheet

- **Device information:**
General information about the device such as device name, product code and serial number is indicated here. If the device uses Ethernet, you can select at this point the IP address of the device through which DIGSI 5 communicates with the device (port J, this setting only available in offline mode). You can furthermore set the device language here, as well as the operating modes (process mode, commissioning mode).
- **Resource consumption:**
The first area shows you the state of the device load offline. If it is green, the parameterization can be loaded into the device and real-time behavior ensured. If the lamp is red, functionality must be reduced. The number of used function points is shown to you in the second area. If the allowed number is exceeded, replacements must be bought for device-related function points. To reorder, use the configurator and follow the menu instructions there.
In the 3rd area you are shown the capacity utilization of the operational diagram (Continuous function chart, or CFC in short).
- **Log**
 - **Device diagnosis log:**
Monitoring indications are entered in this buffer. If, for example, a device fault is present, the required information is entered in plain text. Every result is time-stamped. Plain text means that you receive the necessary information about, say, erroneous modules and the type of error. At the same time, an operation recommendation such as replacement of the expansion module is given.
 - **Safety indications:**
In this buffer logs, entries are time-stamped when access was carried out on the device using DIGSI 5. Rejected access, for example, if you entered the password incorrectly 3 times, is registered. You cannot delete this buffer. This buffer is organized as a ring buffer. Selected indications can be transmitted to a systems control and can be archived there. This guarantees a long-term buffer for accessing the device as it is required in cyber-security recommendations such as NERC-CIP (see chapter [11.1 Security Design](#)).

- Time information:
In this setting sheet you can open diagnoses for the first and second clock and query their synchronization status. In addition, it gives information about the internal device time. This can also be set via this menu for test purposes. If a high-precision second pulse is available, its status is also shown here [8.8.3 Setting Time Keeping Parameters](#).
- Diagnostic information:
Here detailed information on the individual hardware and software components are stored.



NOTE

The device remains in commissioning mode until you set the device in the process mode consciously or until the internal monitoring time (statement of time) has expired. You reach the process mode by clicking the link in the upper right of the working area. The settings sheet **Device information** opens. Go to **Device mode** to set the device in process mode.

You can execute more tests in this mode.

9.3 Initial Startup

9.3.1 Establishing Readiness for Operation State

It is assumed that you have gone through steps in chapters 1 to 4. Check the connection of the auxiliary power supply. SIPROTEC 5 devices have 2 power-supply unit designs (type 1: DC 24 V to DC 48 V and type 2: DC 60 V to DC 250 V as well as AC 110 V to AC 250 V). You can also read the rated voltage range from the name plate. After successful testing of your voltage source, switch it on. The device is now in startup mode. The LEDs RUN (green) and ERROR (red) light up simultaneously. In addition, some LEDs on the base module start flashing. When the RUN LED is permanently **On** and the ERROR LED is permanently **Off** the device has started up. [Figure 9-9](#) and [Figure 9-10](#) show the basic status of the device display using the example of transformer differential protection.



Figure 9-9 Factory Setting of Large Display



Figure 9-10 Factory Setting of Small Display

Afterwards you can initialize the device by loading the parameterization. Before going to the chapter [9.3.3 Initializing Device and Verifying Basic Status](#), read the information in the chapter [9.3.2 Using a Project with DIGSI 5](#).



NOTE

If you find another default display after device startup, then someone before you has initialized the device. You can now load your parameterization to the device. In the DIGSI 5 project tree, use the **Load Configuration in Device** menu item.

9.3.2 Using a Project with DIGSI 5

All settings of the device are created with the DIGSI 5 operating program. The engineering department is responsible for editing. In the respective project (see chapter [6 Using DIGSI 5](#)) you will find the devices with the project-specific settings. Familiarize yourself with the project and the device settings before you execute the next steps.

Take the following procedure as your guide:

- ✧ Install the DIGSI 5 operating program on your PC/laptop. For commissioning, Siemens recommends the DIGSI 5 variant **Premium**.
- ✧ Accept the project from the engineering department and save it.
- ✧ Open the project and the devices in it.
- ✧ Check whether inconsistencies are shown. DIGSI 5 constantly performs a consistency check. If inconsistencies are detected, the corresponding position in the operating program is marked. If this is the case, clarify the cause.
- ✧ Look into device-specific parameterization. Use the sequence described below as your guide.

Procedure for checking device parameterization:

- ✧ Check whether the parameterized hardware coincides with the existing devices. In the project, click **Devices and networks**.
- ✧ If you communicate via Ethernet, check the correct setting of the IP addresses simultaneously. You can also do these checks under **Device**.
- ✧ If the project is an IEC 61850 system, go to menu item **IEC 61850 GOOSE Communication** to familiarize yourself with the respective circuitry. If you use circuiting you can view the static reports on the systems control.
- ✧ Create an overview of the settings or the routing in the individual menu items. Siemens recommends doing this when opening the device in DIGSI.

9.3.3 Initializing Device and Verifying Basic Status

SIPROTEC 5 devices are initialized via the front USB interface. Alternatively, you can initialize the devices via port J. If you connect port J to a system, you must change the previous IP address.

- ✧ Connect the device to the corresponding USB interface of your computer.
- ✧ In the DIGSI 5 operating program right-click the device to be initialized.
- ✧ Click the **Load Configuration in Device** menu item.

DIGSI 5 then accepts the connection to the device and loads the complete parameterization into the device. This process takes some time.



[scstartsc-270814-01, 1, --_]

Figure 9-11 Display during Transfer

Once the transfer is completed, the device executes a reset and is in the startup mode. Once this status is finished, the display image appears and the green LED (Run) lights up. The red LED (Error) must be off.

The display image contains information about the basic device type, for example, transformer protection, the firmware version (FW), and the loaded parameterization version. In SIPROTEC 5, this is called **Configuration** (CFG).

If a display image is adjusted in the parameterization, then the device switches to this display state after several seconds. The set display image, for example, the measured-value display, should appear.

If you wish verify the loaded parameterization randomly, you can execute a check through the on-site operation panel. Log in and follow the menu. Read the user instructions in chapter [5 Using On-Site Operation Panel](#).

Alternatively, you can also verify the parameterization with DIGSI 5. To do this, activate the online mode and establish connection to the device. Then open the settings comparison between the online device and the offline device in the project.

During the initialization, the serial number of the device is transferred to the offline project. Alternatively you can also enter the serial number by hand in the offline device.

9.3.4 Testing Readiness for Operation

By carrying out the points in chapter [9.3.3 Initializing Device and Verifying Basic Status](#), the device is ready for operation. If devices are built into cabinets, additional wiring and communication connections are necessary. Subsequent checks can be made in preparation for the secondary test. To do this, you can make use of numerous test aids available in the device, which are described in chapter [9.2 Test Suite Integrated in the Device](#).

Siemens recommends the following procedure in this order:

- ✧ Testing binary inputs and outputs
Check that the connection from the transmission terminal to the device is correct and the binary inputs and outputs as well.
- ✧ Testing voltage and current inputs
Using multi-phase test equipment, apply the corresponding test quantities and check the results. To do this, make use of the testing options in the device (see chapter [9.2.2 Testing Current and Voltage Inputs](#).) You can also check the measured values directly on the device by calling up the operational measured values in the respective function group.
You can also read the operating measured values in the operating software DIGSI 5. Under Online Access Points, open the assigned device. Under the menu item **Measurement**, you will find a clear presentation of the operational measured values in the respective function group.
- ✧ Checking communication interfaces
You can also set the state of signals transferred via communication interfaces. This action allows you to check, for example, the connection to the systems control. In the communication diagnosis, you will find helpful information, for example, about data traffic on a communication interface.
- ✧ Checking time synchronization
The device is synchronized by a maximum of 2 independent time sources. In online mode, first click in the project tree on **Device information** then on the tab **Time information**. The delivered specific values (UTC) of the 1st and 2nd time source (if available) are shown. The internal time of the device which results from the time information of the active time source is likewise shown.

9.4 Secondary Tests

9.4.1 Scope of Inspection and Methodology

The secondary test objectives are:

- Checking the transformer burdens, checking the transformer data of the main current and voltage transformer
- Checking the routing of signals to the most varied targets (binary inputs (BI), binary outputs (BO), LEDs, and interfaces)
- Checking function charts (CFC) in the device
- Checking the interactions between devices, for example, exchange of information or measured values via interface
- Checking the correct setting of protection functions and the interaction of protection functions (for example, circuit-breaker failure protection, automatic reclosing)
- Checking communication with a systems control

You can proceed in different ways depending on problem definition and test objective. To simplify the inspection effort, the application of test programs of digital test equipment is recommended. During a secondary test, you do not have to go through all characteristic-curve points. That is the subject matter of an acceptance test. Focus on characteristic values. These are pickup values, operate times, and the interaction between functions as well as devices.

In this test you can also make use of integrated test functions and hence reduce the expense on test technology. Pickup values and the reaction of the protection function can be checked easily with the sequencer (see chapter [9.2.3 Testing Protection Functions](#)).



WARNING

Warning of danger from secondary tests

Noncompliance with safety notes can result in death, serious injuries, or considerable material damage.

- ✧ Secondary tests must only be carried out by personnel who are qualified electricians and are familiar with the commissioning of protection systems, the operation of the system, and with safety regulations and provisions (switching, grounding, etc.).
- ✧ Make sure that there are no connections to the primary system during the secondary test.

In the secondary test it is assumed that there are still no connections to the primary system. But if you do this in the primary system, special safety conditions must be followed.

- ✧ Consider that no other measurands are locked in, unless otherwise indicated.
- ✧ Consider that the trip and close commands to the circuit breakers are interrupted, unless otherwise indicated.
- ✧ Take note of the general instructions in chapter [9.5 Primary Tests](#).

9.4.2 Recommendation for Testing of Functions

Only general recommendations are given in this manual. Please refer to the respective Device manual for the function-specific instructions to be followed. Remember also that a deviation from the expected functionality can have its cause in an erroneous test sequence.

Testing of Protection Functions

- Before checking, familiarize yourself first with the measuring principle of the protection function in the Device manual and consider the test recommendations given in the Device manual.
- Perform the tests using multi-phase test equipment since numerous protection functions require a 3-phase system.
- You can test most protection functions using stationary signals. Some protection functions require transient signals. Typical examples are the testing of protection reaction on power swings (power-swing blocking in distance protection and out-of-step protection) and the transient effect on transformers. They generate transient test files with a dynamic network calculation program or these test files are provided by special test programs.
- If setting values are offered only in percent or per unit, remember that the setting values refer only to rated quantities of the protected object. Secondary test quantities must be converted using the transformer ratio.
- Perform the tests successively. Activate only the function that you wish to test. Make use of DIGSI 5 support (see chapter [9.2.3 Testing Protection Functions](#)).
- Since protection functions can be assigned to different protection function groups, check the interaction between function groups as well. If you have created your own application template or modified the delivered template, Siemens recommends that you check the interaction. The application templates provided with the device have been tested.
- Check the reaction of the protection functions via the indications in the corresponding logs. The indications in the spontaneous indication log (available in online mode), which are shown at the moment of occurrence, are a good tool. Testing using the fault record (binary signal traces in relation to the input variables) is also advisable for transient processes.
- Check the correct routing of signals of the protection function.
- Check individual protection functions in the test editor using signals from test equipment or the internal signal generator (sequences). Examine the test sequence in the characteristic curve of the protection function and its spontaneous indications.

Checking Function Charts (CFC)

- Created logics (function charts) must be tested. A working relationship with the engineering department is necessary for this purpose. Familiarize yourself first with the objective of the function chart. DIGSI 5 offers you a tracing function during offline operation. This allows you to verify the correct logical sequence by loading the function chart with test sequences and following the reaction in the function chart. Switchgear interlockings and other logic can be tested easily with it.
- If the logic reacts to transient changes, you must perform dynamic tests. To do this, generate the necessary test sequences and load them into the device. You can then provide inputs or outputs for tracing in the function chart. The exact temporal sequence of signals is then logged in a fault record during the progress of the test sequence. This can be analyzed, for example, using SIGRA and the runtimes and time differences analyzed. This is a very good way of checking and simultaneously documenting behavior over time (file export in PDF format).

Checking Control Functions

- Switching of switching devices requires that the switchgear interlockings are properly executed and that the correct signals are fed to the logic. Perform the corresponding tests. Check the switchgear interlocking by simulating the corresponding input variables and checking the reaction on the output.
- If you perform on-site control with the device, check the on-site control diagram in devices with large display. Select the respective switching device and check the different switching operations. Check the reaction on the outputs.
- In devices with small display, select the switching device (selection via text) and execute the switching operation as well.

- Since measured values are also displayed apart from switching devices in the display diagram, check the proper assignment of measured values by feeding and changing the test quantities.
- Tap changer position commands and control commands for arc-suppression coils can be checked via DIGSI 5. Check the corresponding relay outputs and feedbacks via binary inputs or communication interfaces.

9.4.3 Testing Interfaces in the Compound System

Besides binary inputs and outputs, communication between devices occurs via serial communication interfaces. Test instructions are hereinafter given for the following applications:

Protection Communication Between Devices

A typical application is communication between line differential protection devices. The main protection function is differential protection which requires a functioning data connection between devices. Please refer to the Device manual for checking the Differential protection function.

A 2nd application is communication between devices by transferring binary signal and measured values (for example, remotely from the opposite end). You generate test signals with the communication test by setting signals to be transmitted systematically in the transmitter and checking their receipt. Please refer to the chapter Protection Interface in the Device manual for the necessary test items.

GOOSE Communication Between Devices

GOOSE communication is possible only with the IEC 61850 protocol. Check whether the interfaces and switches are parameterized properly. Familiarize yourself with the information that is to be transmitted via GOOSE (Generic Object Oriented Substation Event). Using external test programs such as the GOOSE Inspector, you can automatically check all GOOSE connections configured in the SCD file. In the event of missing connections, check the GOOSE parameterization of the transmitting device.

Communication Between Device and Control Center

Various protocols are available to you for communicating with a control center (station or network control center). Besides DNP3 and IEC 60870-5-103, the IEC 61850 protocol has emerged as the leading protocol. The test requires the exchange of parameterizations between the protection device and the systems and control device. Test telegrams for the communication interfaces can be created using the editor described in [9.2.4 Creating Signals for Communication Interfaces](#). When setting states in the device, the corresponding telegrams are sent via all existing systems and control protocols.

The test sequencer can be another test source (see chapter [9.2.3 Testing Protection Functions](#)). You can bring a protection function systematically towards pickup and release using the test sequencer. A fault record is also simultaneously created during the process. In the systems control, check, for example, that the correct indications are coming and the fault record was correctly received. In case of a longer sequence you can also verify the measured values. In addition, check communication in the direction of the device. If switching commands are controlled by the systems control, check proper execution.

9.5 Primary Tests

9.5.1 Testing System Integration

A requirement for the primary test is that prior tests (chapter [9.3 Initial Startup](#) and [9.4 Secondary Tests](#)) have been completed successfully. Take note of the following before starting the test:

General Notes



DANGER

Danger due to hazardous voltages during the operation of electric devices

Noncompliance with the safety notes will result in death or severe injuries.

- ✧ Only electrically qualified personnel may work on these devices. The electrically qualified personnel must be thoroughly familiar with pertinent safety regulations and precautionary measures as well as the warnings in this manual.



WARNING

Warning of hazards due to improper primary tests

Noncompliance with the safety notes can result in death, serious injuries, or considerable material damage.

- ✧ Primary trials may be performed only by qualified electricians who are familiar with the commissioning of protection systems, the operation of the system and safety regulations and provisions (switching, grounding, etc.).

You must perform switching operations for the commissioning. The described tests require that they can be done without danger. They have not been conceived for operational checks.

You must follow pertinent safety regulations (VDE 105-100/A1, BGV A3/VBG 4).

Before starting work you must take note of the **5 safety regulations**:

- Isolate from the power supply
- Safeguard against reclosing
- Establish zero potential
- Ground and short-circuit
- Cover or cordon off neighboring live parts



CAUTION

You must ground the device at the protective grounding terminal before making the connections. There may be hazardous voltages in all switching components linked to the power supply and to measurand or test quantities. There may be hazardous voltages in the device (capacitor storage of the current supply) even after disconnecting the supply voltage.

Noncompliance with the safety notes will result in death or severe injuries.

- ✧ To reach the defined initial conditions after switching off the auxiliary voltage, wait at least 10 s before restarting the auxiliary voltage.
- ✧ Do not exceed the limiting values indicated under Technical Data of the Device manuals, even during testing and commissioning.



DANGER

Hazardous voltages during breaks in secondary circuits of current transformers

Noncompliance with the safety notes will result in death or severe injuries.

- ✧ Short-circuit the secondary connections of the current transformer before the electrical lines to the device are disconnected.
- ✧ If there is a test switch which short-circuits the current-transformer secondary line automatically, it is sufficient to set this switch to the **Test** position, provided you checked the short-circuiting device beforehand.

NOTICE

Pay attention when wiring the safety cabinet to the system

Noncompliance with the safety notes will result in material damage.

- ✧ Before the 1st test, wire the safety cabinet to the system. You must check the wiring of the connections to the primary system.
- ✧ Test all connections, including the polarity of transformers. In voltage transformers with broken-delta winding make sure that they are not short-circuited.
- ✧ Activate the auxiliary voltage of the device.
- ✧ Establish an online connection to the device. You can verify the signals at the binary inputs under the **Test suite** → **Wiring** menu item.
- ✧ Compare the entries under **Binary inputs**, **Binary outputs** and **LEDs** with the system status.
- ✧ Check whether signaling contacts are connected to the correct binary input.
- ✧ Check the proper functioning of the voltage-transformer circuit breaker and the wiring on the corresponding binary input.
- ✧ Check the correct wiring of blocking and release inputs.
- ✧ Click the **Binary outputs** menu item and check the status of the entries. Apart from those in closed circuits, the contacts are open.
- ✧ To check the connection to the switching device, activate a specific binary output. Proceed very carefully here.



NOTE

Before you perform this test, make sure that the respective system part is isolated and a switching operation can be executed safely.

- ✧ Check the feedback once you have activated the switching device.
- ✧ In the menu, go to **Test-suite** → **Analog inputs** and check the voltage and current inputs. The relevant measurands must have the value **0** in the de-energized switch position.
- ✧ Using test equipment parallel to the transformers, feed stationary test quantities.
- ✧ Check the measured values. Take note of the absolute value and phase as well as the correct phase sequence.



NOTE

If additional signals such as from a substation automation technology are coupled, perform the corresponding tests (see chapter [9.4 Secondary Tests](#)).

9.5.2 Methodical Procedure for Primary Tests of Functions

The scope of primary tests depends on the type of system. To check proper system integration, various primary tests are performed in power plant systems. The generator delivers the necessary test quantities based on the operating mode. Refer to the Device manual for generator protection for details.

The scope of inspection is much smaller in power system protection applications. It boils down to a direction check in the broadest sense. Differential protection tends towards overfunction if there is a sensitive setting and a wiring error. Each function can be switched to a special mode to avoid unnecessary activation of the circuit breakers. It is ready to function but the trip command is not switched further (see Function descriptions in the Device manual). In the desired function, switch the **Mode** parameter to **Test**. The trip signal is supplied with a test bit. The tripping contacts in the device are not activated so the circuit breaker is not actuated by the protection.

If you enter this setting for the differential protection, make sure that at least one overcurrent protection is active as backup protection. Once all preparatory measures are complete, you can begin with the actual primary test.

- ✧ First check that you can produce a non-critical switch position and that you have a specific power flow. The possible load current must be greater than 10 % of the rated load. Avoid a maximum load.
- ✧ Activate the circuit breaker (for example, with a synchrocheck).
- ✧ Check the measured values.
- ✧ In online mode, open the Editor **Test suite** → **Analog inputs**.
- ✧ Check the phasor values of the measuring points in terms of plausibility (amount, phase and phase sequence).
- ✧ Check the phase displacement of the current and voltage phasors with each other.
- ✧ Check the operational measured values per function group.
- ✧ Check the direction indirectly via the measured values for active and reactive power (**Operational indications** tab.) If the power flow is to the protected object (for example, line) and an ohmic inductive load is assumed, the active and reactive power must assume positive values. The size of the measured values determines the current load. If 2 protection devices are connected, both must show the same value.
- ✧ Click the **Fund. comp./sym. comp.** tab.
- ✧ You can verify the direction of rotation using positive-sequence and negative-sequence system quantities. The negative-sequence system quantities must be 0.
- ✧ If deviations arise during the tests, check the selected settings (for example, current transformer neutral point, phase sequence, etc.) and the interface in a 2nd step.

**NOTE**

Using wiring modifications, switch the primary system to the de-energized state.

You can do tests specific to protection functions via the operational measured values.

- ✧ To do this, click the **Functional meas. values** tab. In a differential protection function, the differential currents must be 0 and the corresponding restraint current available.
- ✧ Click **Test suite** → **Protection functions**.
- ✧ In the function group, select the protection function and you will get a graphic display. Apart from the set characteristics, you see the functions relevant to protection.

To be 100 % sure about the direction setting in a directional overcurrent protection, make use of the test functionality integrated in the protection function.

- ✧ Activate the binary input signal *>Direction test*, and the protection function switches to test mode.
- ✧ Analyze the indication behavior of the protection function according to the selected setting.
- ✧ Deactivate the test mode by terminating the binary input signal again.

With active protection you can continue the testing of the switching devices.

- ✧ Check the on and off switching of the circuit breaker.
- ✧ With the circuit breaker switched off, check the activation of disconnectors and the corresponding interlocking mechanisms.

9.5.3 Testing Measured Values During Operation

Checking the operational measured values for plausibility is a simplified test of components of the primary system (transformer, wiring) and of secondary equipment (measured-value acquisition including measured-value processing). You can set a default display in the device display that also contains the measured values. Several measured-value windows are preadjustable and can be further switched if needed. Check these measured values for plausibility.

- ✧ If you wish to check measured values more precisely, follow the device menu and navigate to the corresponding measured values.
- ✧ Alternatively, you can set parameters for a function key so that directly jumping to the desired menu is possible.

Online operation with DIGSI 5 provides a good complete overview. You will find the relevant measured values in **Measurements** for the respective function group. If there is a communication connection to systems control, measured values that the operational crew can verify are also transmitted here.

10 Maintenance, On-the-Spot Assistance and Test

10.1	Execute Checks	234
10.2	Error Search and Correction	236
10.3	Replace and Return Defective Device	246
10.4	Update Firmware and Configuration	247
10.5	Test and Diagnostics	256

10.1 Execute Checks

10.1.1 General Information

No special maintenance is required for SIPROTEC 5 devices. The only maintenance measure is to replace batteries.



NOTE

To avoid data loss, Siemens recommends replacing the device battery with the device supply voltage switched on.

All measurement- and signal-processing circuits are designed full-static. All input modules are also static, and the binary outputs are equipped with protective covers.

Since the device is mainly self-monitoring, hardware and software errors are automatically forwarded. This action minimizes any downtime of the device. It also eliminates the need for frequent maintenance inspections.

Repeat Test

A routine test of characteristics or pickup values is unnecessary since this is part of the continuously monitored firmware programs. As long as you make no changes in the pickup values or characteristics, a test is not necessary.

Use the specified maintenance intervals to check and maintain the system and check the protection and control equipment. The primary purpose of maintenance is to check the interfaces of the SIPROTEC 5 device, that is, the coupling to the system.

If you discover a failure, follow the instructions in the corresponding chapters for failure search or call the Siemens hotline.

10.1.2 Protection-Function Test

General



NOTE

When performing a protection-function test, make sure that it does not lead to any undesired tripping. Likewise no information must be transmitted to a higher-level systems control where the operator may incorrectly interpret it.

-
- ✧ Make sure that the green **RUN** LED on the front cover lights up and not the red **ERROR** LED. This is how the device indicates that it is properly functioning and that no failures have been observed during self-monitoring.
 - ✧ Make sure that the LEDs on the front cover present a plausible image of the actual state of the device. If, for example, the tripping of a protection function is saved as an LED display, the device has fault indications and a fault record for this purpose.
 - ✧ Press the LED test key. All LEDs apart from the red **ERROR** LED light up. Stored LED displays are reset and only those states currently indicated by the device are shown.
 - ✧ Read the operational measured values and compare them to the actual measurands to control the analog inputs. To do this, enter a reference quantity into the device using secondary test equipment. This is how you check the proper operation of the analog section of devices.
 - ✧ Read the operational indications. You can do this directly on the device or following a clearly arranged procedure using the DIGSI 5. Make sure that they do not contain inputs about failures of the device, of measurands or other implausible information.

- ✧ If the protection equipment has picked up or disabled an error, you can verify this through the fault record and the fault log. This is how the protection equipment demonstrates its correct operation in the operating state. Additional protection-function tests can be omitted.



NOTE

The system operator is responsible for further protection-function tests within maintenance intervals. Check protection functions using secondary test equipment or the integrated test sequencer (see chapter [9 Commissioning](#)).

10.2 Error Search and Correction

10.2.1 Troubleshooting

Procedure

If the device indicated an error, then Siemens recommends that you proceed as follows:

If no LED on the operation panel of the device lights up, then verify as follows:

- ✧ Check whether the auxiliary voltage on the corresponding connections has an adequate amount and correct polarity. You will find information about this in the overview plans in the appendix of the Device manual.
- ✧ If the device shows a fault via the red **ErrorLED**, look for the cause of the fault in the operational log. You can do this directly on the device or with DIGSI 5.
- ✧ If the **Fallback Mode** display appears in the device display, then reinitialize the device through DIGSI 5. Look for the cause in the device-diagnosis log first. If a connection to the system cannot be established, initialization takes place via the USB interface on the device together with DIGSI 5.
- ✧ If the confirmation ID is queried, enter it for the device initialization.

The display first disappears in the device display. After successful initialization, the LEDs again indicate normal operation and the default display goes back into the display. If the device-specific setting values were saved in the PC during commissioning, they are again loaded into the device.

The device is ready for operation.

Additional Support


If these measures do not lead to the desired result, the Support team will help you.

- ✧ Keep the device serial number to hand for the Support team.
- ✧ Read out the version of the installed firmware.
- ✧ Read the device-diagnosis log of your SIPROTEC 5 device with DIGSI 5 so that the Support employee has all the necessary information.

If a Support employee is on site, he has the option of configuring the device with special software for further analysis of an existing problem. A signed **start-up** file is loaded onto the device by the employee. For this, a firmware version of the device, version V07.50 and higher, is required. When correction of defects is complete, the correct configuration is established and the device continues to run normally.

Read the Device Data via the Operation Panel

- ✧ With a device ready for operation, select **Main menu → Test & Diagnosis → Device information**.

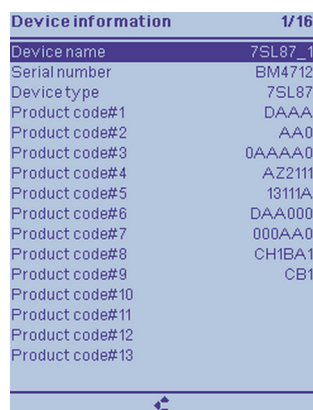


Device information		1/16
Device name	7SL87	
Serial number	BM4712	
Devicetype	7SL87	
Product code#1	DAAA	
Product code#2	AA0	
Product code#3	0AAAA0	
Product code#4	AZ211	
Product code#5	1311A	
Product code#6	DAA000	
Product code#7	000AA0	
Product code#8	CH1BA1	
Product code#9	CB1	
Product code#10		
Product code#11		
Product code#12		
Product code#13		

[scdevinf-080413-01.tif, 1, en_US]

Figure 10-1 Reading Device Information

Reading the Device Data with DIGSI 5

- ✧ Select the device in the project tree.
 - ✧ Double-click **Device information** in the project tree.
- In the **Device information** tab, you can find the data on your SIPROTEC 5 device.

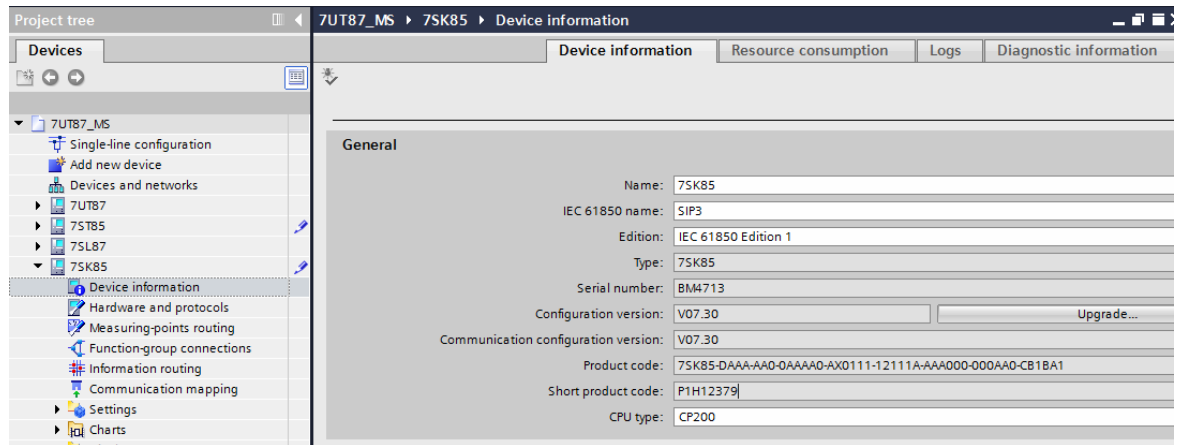

[scgerdia-230816-01, 1, en_US]

Figure 10-2 Reading Device Information

- ✧ Click the **Logs** tab.
- ✧ Read other logs such as the **Device-diagnosis log**.

10.2.2 Measures for Error Correction

Limit work on the hardware to the necessary extent.



NOTE

Defective modules can be replaced only by experienced persons. Never open modules yourself.

The following software measures are possible:

- Initializing the system
- If, for example, you would like to set a supervision function so that it becomes more insensitive since it is responding sporadically in the operating state, change the parameterization.



NOTE

If these measures do not lead to the desired result, avoid further measures during operation.

10.2.3 Fallback Mode

If an error is detected in the device that cannot automatically be cleared (hardware components, software or parameters), the device switches automatically into fallback mode. This can appear in system start or during operation of the device. The fallback mode allows you a minimum procedure with error diagnosis and error correction.




NOTE
Ensure that the protection and control functions are deactivated in fallback mode.

Fallback mode is evident from the termination of the life contact, the Error LED, and the **Fallback mode** header in the device display. In this mode the outputs of the device are brought to their initial state. Access to the hardware is impossible. A limited operating menu is available for further actions.

Fallback Mode

You can select various information areas and have them displayed in the **Fallback mode**. The reason for the fallback are shown in the lower part of the display as an indication (1 in [Figure 10-3](#)). When selecting the softkey <More> on the right-hand side, a list of entries is displayed that was generated during the diagnosis of the device (2 in [Figure 10-3](#)). Use the navigation keys to select the relevant entry or use the softkey <Details> to open the currently selected entry. Precise information about the fallback will be displayed (3 in [Figure 10-3](#)).

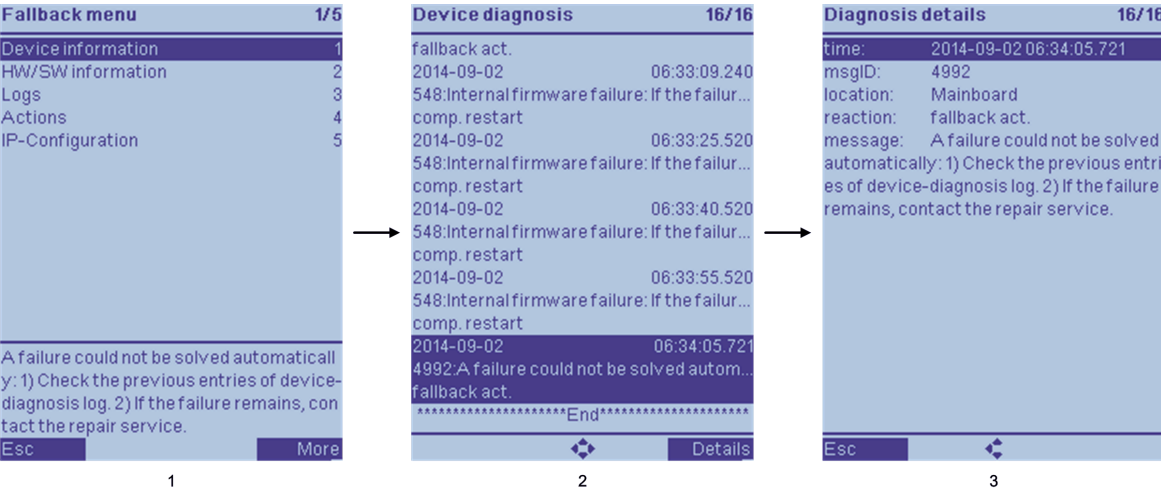


[scfbmenudet-030914-01, 1, en_US]

Figure 10-3 Start Menu of Fallback Mode

The menu items are summarized and briefly presented below.

Fallback Mode Submenus

You can use the navigation keys to select the individual menu entries and branch them into the submenus.

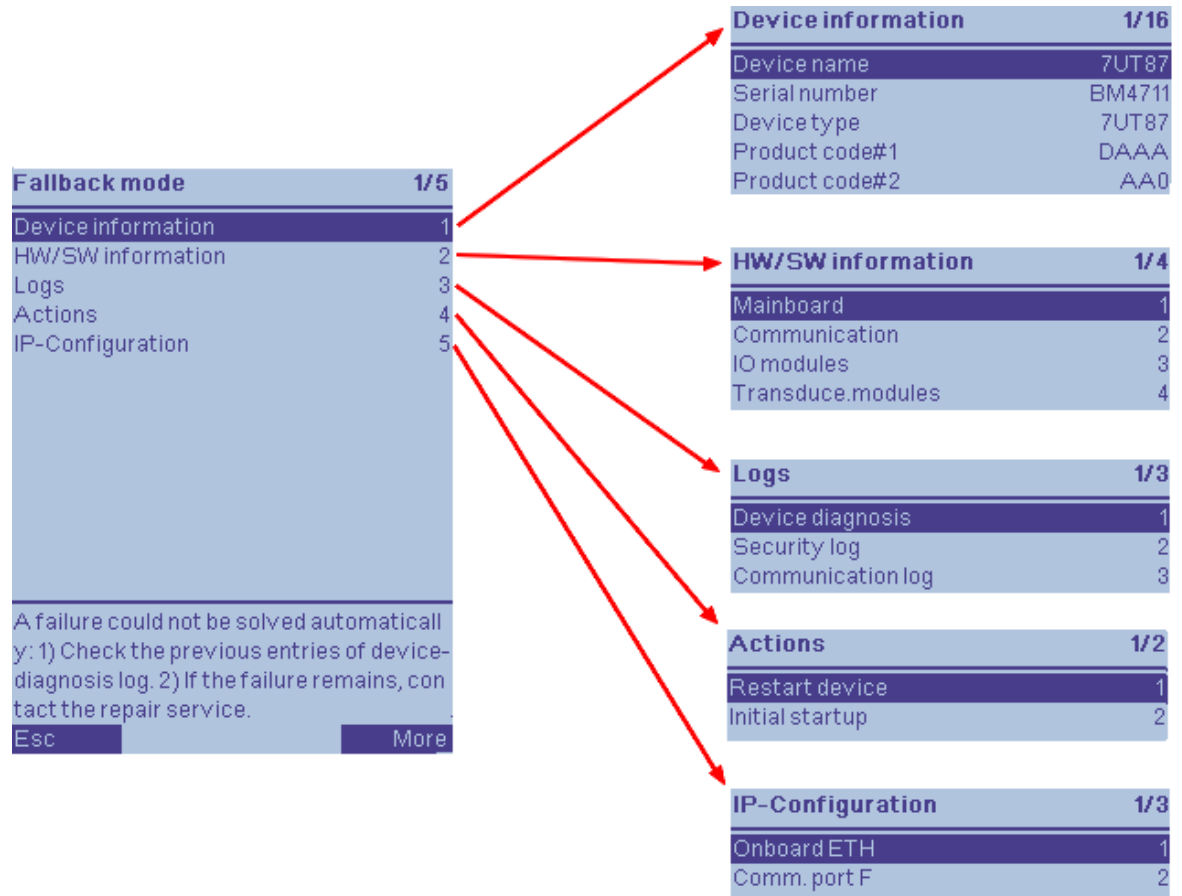


[scmbfb5ein-030914-01, 1, en_US]

Figure 10-4 Structure of the Fallback Submenu

- **Device information**
The menu item **Device information** provides data about the SIPROTEC 5 device, for example, device name, serial number, device type, and product key.
- **Hardware/software information**
The **HW/SW information** menu item offers you additional information about the hardware and software of the device (see [Structure of the HW/SW Information Menu Item, Page 239](#)).
- **Log**
Information about the entries in the logs is available via the **Logs** menu item. This entry provides you with all the information from the diagnostics, security and system start memory and you can display the history.
- **Actions**
By selecting the menu item **Actions** and clicking **Restart Device**, you can restart the device.
- **IP configuration**
During operation or commissioning, the **IP Configuration** menu offers you system information, for example the MAC or IP address of the device.

Structure of the HW/SW Information Menu Item

At this point, the submenu items **HW/SW Informat.** are explained in more detail.

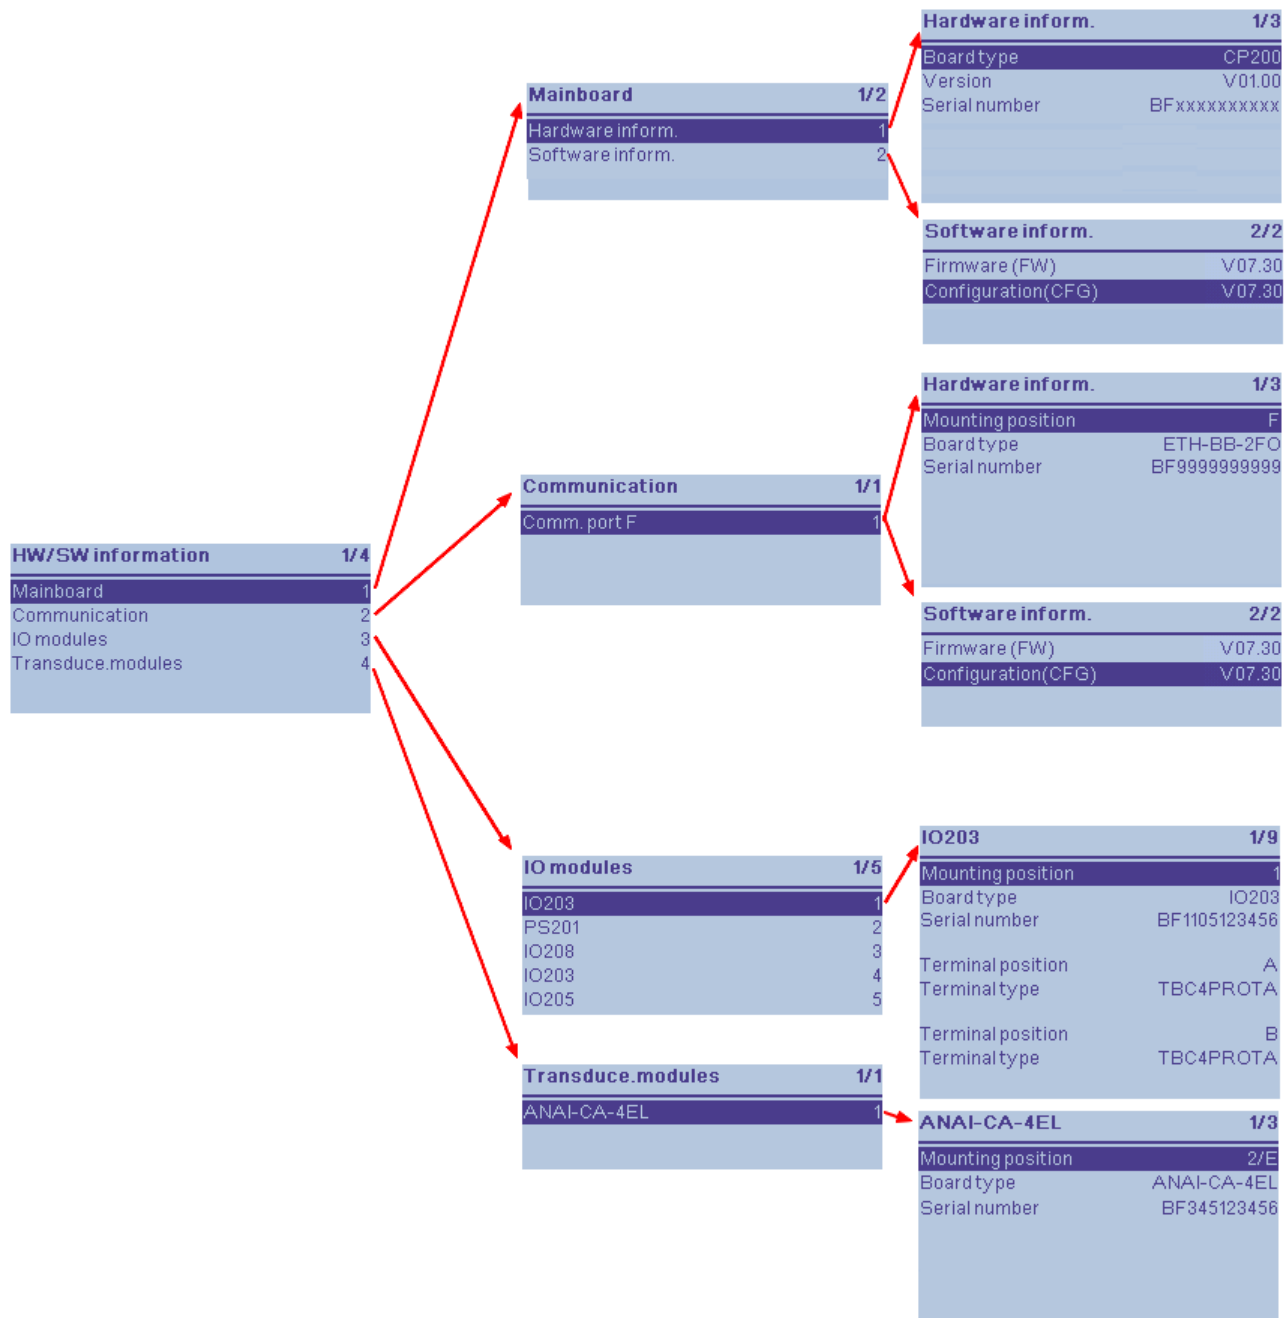

[schwswfb-020914-01, 3, en_US]

Figure 10-5 Menu Items for HW/SW Information

- **Mainboard**
This menu item informs you about the board type and the details concerning the version of the mainboard.
- **Communication**
The menu item **Communication** displays information about the assignment of the communication ports and their hardware information, for example, slot, version, and board type.
- **I/O modules**
A list of the input/output modules being used can be found under the menu item **I/O Modules**. You can select each individual printed circuit board assembly and, for example, have the slot or the terminal position displayed.

- **Transformer modules**

If using transformer modules, this menu item displays all available information about these modules (for example, slot, board type or serial number)

Fatal Error, the Device Goes into the Fallback Mode

Certain fatal device errors lead to the device falling immediately into the fallback mode. Fatal device errors are errors that cannot be resolved by a restart of the device. An indication displays the type of error. From this, you can derive additional steps (for example, contacting the repair department). The device goes permanently out of operation, a failure is avoided. In fallback mode, minimal operation of the device via the on-site operation panel and DIGSI 5 is possible. In this way you can still read information from the diagnostic log, for example.

Life contact	is terminated in fallback mode
Red error LED	is activated in fallback mode

Group-Warning Indication

Pickup of the following supervisions with entry of the device into the fallback mode does not allow output of normal supervision indications. The entry of the device into the fallback mode thus also does not lead to the activation of the group warning indication.

10.2.4 Error Indications

If the SIPROTEC 5 device is outside a normal operating mode (for example, device is in commissioning mode or in simulation mode), this is shown by an indication. By default this indication is prerouted to LED 16 and makes the red LED flash.

If you have exited one of the modes incorrectly (for example, by pulling out the DIGSI 5 PC), the red LED flashes and after 4 hours the *Device Ready* indication will go.

This function is realized in the SIPROTEC 5 device via a predefined CFC chart. This means that you can change this behavior in case of doubt. To do this, change or delete the CFC chart.

Overview of Errors

For each error indication on the on-site operation panel, a specific error code is issued additionally (see [Figure 10-3 \(2\)](#)). This error code is helpful for further analysis by the repair service.

Device-Diagnostic Log
Memory failure (recoverable): Reset initiated.
PCB link failure (non recoverable):
• Check the module configuration and interconnection. • If the failure remains, contact the repair service.
Binary-output failure at module 1-12:
Contact the repair service.
Hardware failure at module 1-12:
Contact the repair service.
Wrong module 1-12 detected:
Synchronize the hardware configuration of the device with DIGSI.
Wrong plug-in module detected at position E/F/M/N/P:
Synchronize the hardware configuration of the device with DIGSI.
Hardware failure at measuring-transducer module position E/F/M/N/P:
Contact the repair service.
A faulty display configuration was detected:
Synchronize the hardware configuration of the device with DIGSI.

Device-Diagnostic Log
Offset failure at a measuring input: • Check for the affected module in the operational log. • If the failure remains, contact the repair service.
A wrong display type was detected. Contact the repair service.
CPU failure at base module: Contact the repair service.
Communication-configuration failure: • Reload the DIGSI device configuration. • Update the device firmware or the DIGSI device configuration.
Port E/F/M/N/P: Communication module with incompatible firmware version detected. Firmware update required.
Clock failure: • Check time setting first. • Change the battery if necessary. • If the failure remains, contact the repair service.
A current terminal is missing. Check your hardware and the connections!
FPGA hardware failure at the base module: Contact the repair service.
The device is low on memory. Reduce the number of allocated functions, stages, and/or setting groups in the configuration.
Configuration error: The version of one or more functions is incompatible to the used firmware. Load a suitable DIGSI device configuration.
Failed reading significant feature
Unknown significant feature
Failed reading bay type
Wrong hardware configuration: Synchronize the hardware configuration of the device with DIGSI.
Unknown bay type
Failed reading disconnector type
Unknown disconnector type
Maximum number of feeder bays exceeded
Maximum number of coupler bays exceeded
Maximum number of coupler bays with 1 CT exceeded
Maximum number of coupler bays with 2 CT exceeded
Maximum number of coupler bays without CT exceeded
Maximum number of bus section bays exceeded
Maximum number of bus zones exceeded
Maximum number of bus zones without measuring system exceeded
Maximum number of disconnectors exceeded
Maximum number of busbar disconnectors exceeded
Maximum number of line disconnectors to busbar exceeded
Maximum number of line disconnectors exceeded
Maximum number of transfer bus disconnectors exceeded

Device-Diagnostic Log
Maximum number of sectionalizing disconnectors exceeded
Maximum number of level 2 disconnectors exceeded
Maximum number of load breaking switches exceeded
Maximum number of bays exceeded
Auxiliary power-supply failure: Check the external power supply.
Either 1 busbar disconnector or 1 line disconnector allowed
Maximum number of Busbar DC & Transferbus DC exceeded
Undefined bay type
Undefined disconnector type
At least one Feeder is necessary
Failure of device configuration: Check the logs for reasons and upload valid configuration into device.
The voltage measured values indicate a failure. There is no CFC logic available or a negative ID of measuring point is selected for Function block Voltage measuring-point selection (1ph).
The voltage measured values indicate a failure. There is no CFC logic available or a negative ID of measuring point is selected for Function block Voltage measuring-point selection (3ph).
A non-existing voltage measuring point ID is selected for Function block Voltage measuring-point selection (1ph). Please check your CFC logic.
A non-existing voltage measuring point ID is selected for Function block Voltage measuring-point selection (3ph). Please check your CFC logic.
Failure in data structure: Contact the repair service.
Firmware-version failure: • Update the device firmware. • If the failure remains, contact the repair service.
Bus link failure: • Check the connection of the modules. • Update the device firmware. • If the failure remains, contact the repair service.
The IEC 61850 protocol could not be started up successfully. Too many protection functions might be configured leading to a memory leakage problem for protocol data. Protocol health set to alarm. Reduce the amount of configured protection functions.
Error instantiating a GOOSE control block for subscription. Too many protection functions might be configured leading to a memory leakage problem for protocol data. Protocol health set to alarm. Reduce the amount of configured protection functions.
Internal power supply failure: Contact the repair service.
Module update failure: • Check the module interconnection and carry out the update again. • If the failure remains, contact the repair service.
Hardware failure: Contact the repair service.

Device-Diagnostic Log
A failure could not be solved automatically: • Check the previous entries of device-diagnosis log. • If the failure remains, contact the repair service.
Signature failure: Contact the repair service.
A failure occurred during the device startup: • Check the previous entries of device-diagnosis log. • If the failure remains, contact the repair service.
The device firmware could not be started: • Carry out the update again. • If the failure remains, contact the repair service.
Internal memory failure: . • Stored data may be lost. • Upload the firmware and the configuration again. • If the failure remains, contact the repair service.
Data transfer time-out: • Check the connections and repeat the upload. • If the failure remains, contact the repair service.
Forced Fallback mode by local user.
Arc protection: • The device hardware does not fit to the DIGSI configuration. • Correct the configuration in DIGSI 5 and transfer a valid configuration to the device.
The maximum number of sampled measured value channels (SAV) is exceeded.
PQ Flicker does not support more than one Meas. point V-3ph. Route only one Meas. point V-3ph to function group or remove PQ Flicker
PQ Flicker does not support the selected rated frequency. Use 50 Hz or 60 Hz.
PQ Flicker does not support selected connection type. Change the connection type of the voltage transformer.
Device-configuration failure: The number of signals in a GOOSE dataset/application is too big. Reduce the number of signals in the related dataset and upload a valid configuration.
Battery failure: Change the device battery. To avoid data loss, Siemens recommends replacing the device battery with the device supply voltage switched on.
Function-point violation: No adequate number of function points. Upload a valid configuration or contact your local sales organization.
Measurement calibration failure: • Check the affected module in the operational log. • If the failure remains, contact the repair service.
CPU program-sequence failure: If the failure remains, contact the repair service.
Time-synchronization masters failed: • Check the external master clocks first. • Check the external wiring. • If the failure remains, contact the repair service.

Device-Diagnostic Log
CPU overload failure: If the failure remains, contact the repair service.
CFC failure: Check your CFC chart in DIGSI for reasons and reload the configuration.
PCB link failure (sporadic): • Check the module configuration and interconnection. • If the failure remains, contact the repair service.
The connection to the detached operation panel is disturbed. Check the connection.

10.3 Replace and Return Defective Device

10.3.1 Backup Module

If you cannot correct a defect reported by the device, you can replace this device with a backup device. If the error is on the base module, only the base module is replaced. Expansion modules belonging to the device remain at the installation location and are connected to the backup base module. If the error is on an expansion module, only this expansion module is exchanged.

The backup module must be of the same type as the defective module to be replaced. If you replace the defective base module, the backup base module is configured with available project data from DIGSI.

10.3.2 Replacing a Device



NOTE

If the device comprises a base module and expansion modules, you can exchange the base module as well as the expansion modules individually for the respective replacement modules.

- Take the device out of operation.
- Remove the wired terminal blocks from the module to be exchanged or alternatively all lines from the device.
- Remove the device (see chapter [3.1.1 Fitting the Devices](#)).
- If needed, remove the defective base module from the expansion modules.

Installing a Replacement Module

- If needed, assemble the replacement base module with the expansion modules.
- Assemble the device (see chapter [3.1.1 Fitting the Devices](#).)
- Put the device back into operation (see chapter [9.3.1 Establishing Readiness for Operation State](#).)

10.3.3 Returning a Device



NOTE

If the wired terminals of the defective base module are to remain in the system, fit the defective base module with the terminals of the replacement module or order replacement terminals.

- Ensure that the devices are either shipped with the original current and voltage terminals or, alternatively – if the wired terminals are to remain in the system – with the designated transport safety devices. If there are green single-row voltage terminals, it is irrelevant in terms of transport whether or not they are plugged in. They do not require any alternative transport safety device.
- Protect the optical interfaces on the communication or arc-protection modules against the ingress of dust. Use, for example, the protective caps provided in the delivery condition.
- Pack the defective module (base module and expansion module) or the complete device (see chapter [1.1 Unpacking, Repacking, Returning, and Storing](#)).
- Return **all of** the defective module to your Siemens sales partner.



NOTE

If the base module is incomplete, for example if terminals are missing, it cannot be taken back.

10.4 Update Firmware and Configuration

10.4.1 General

You can use DIGSI 5 for updating both the configuration and the firmware. No additional tool is necessary for updating the firmware of the device or the firmware of the communication module. In order to carry out an update, you must first import the new DIGSI device driver (DDD) into DIGSI 5. You can then update the device firmware and the configuration. When updating the firmware, use a connection with at least 1 Mbit/s.

10.4.2 Importing and Managing Device Drivers

If you wish to use new functions or if the manufacturer provides an improved version of the firmware, a firmware update is necessary. The files for the firmware update are digitally signed. This prevents you from loading the device with any faulty files or firmware that is not suitable for the device.

If you have installed new communication modules in the SIPROTEC 5 device, check the firmware version of the individual components. You can find up-to-date device drivers and communication protocols (*.DDD, DIGSI Device Driver) in the Siemens download area.

DIGSI 5 device drivers contain both the firmware and the configuration data.

Siemens recommends performing the firmware update on the device locally. If you wish to start the firmware update remotely, use a data circuit with a transmission rate of at least 1 Mbit/s.

Step 1


- Download the device drivers or protocol drivers necessary for updating your SIPROTEC 5 device from the Siemens download area.
<http://www.siemens.com/siprotec>
- Click the **Downloads** link on the menu bar.
- Open the overview of download products with the **> Enter** link.
- Click the link for **SIPROTEC 5 and DIGSI 5**.

Step 2

- In the **SIPROTEC 5 and DIGSI 5 Downloads** download area, select the device (for example: 7SL87).
- Select the item **Firmware and Device Drivers**.
- Select the desired **Version** (for example: V7.3x).
- Click the device driver link.
- Save the file to any location on your DIGSI 5 PC, for example, C:\temp.
- Select the appropriate protocol driver.
- Save the file to any location on your DIGSI 5 PC, for example, C:\temp.

Step 3


- Start DIGSI 5 on your PC.
- Select the previously saved device driver file (DDD for device and protocol) in DIGSI 5 via the menu item **Tools → Import device drivers**.
- In the open window, highlight the devices and/or protocols to be updated.
- Click the **Import** button.

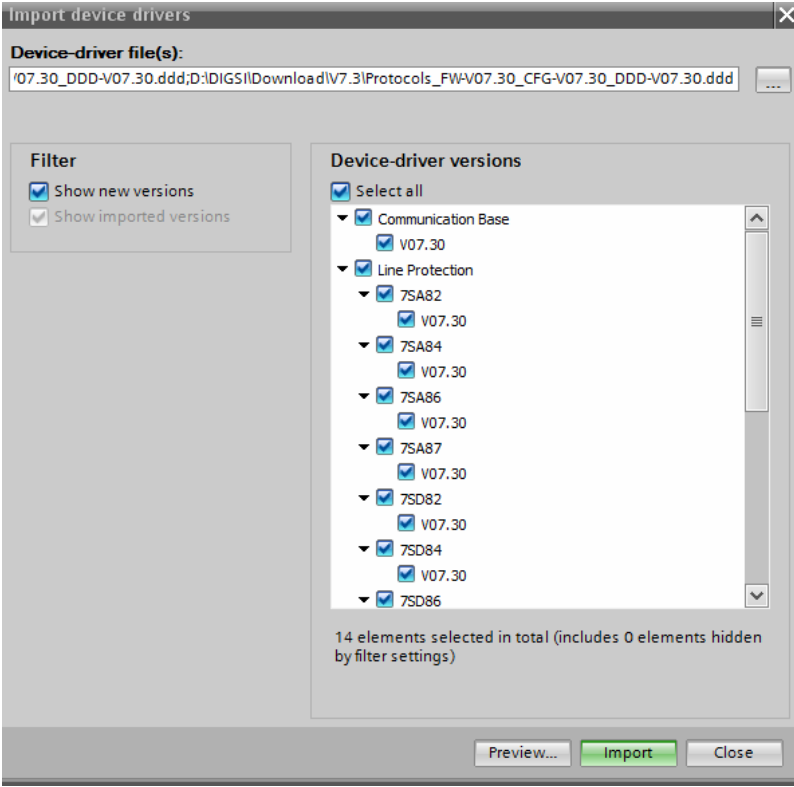

[scddcom-260716-01, 1, en_US]

Figure 10-6 Selecting the Device Drivers


If the process has been completed without errors, the following dialog will appear:

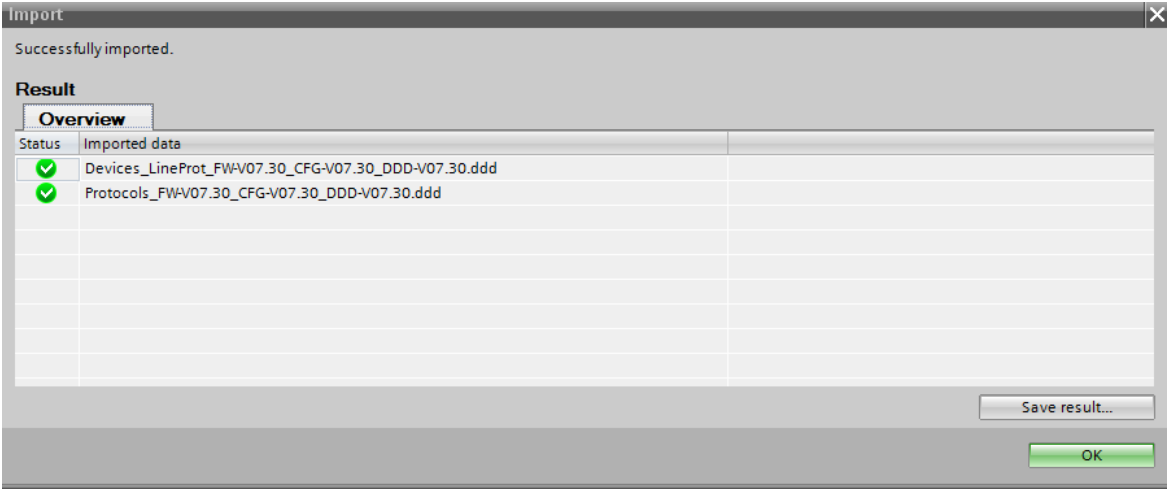

[scsucddd-260716-01, 1, en_US]

Figure 10-7 Import Status

- Click the **OK** button.
DIGSI 5 will be restarted. You can open an overview of the installed device drivers by using the DIGSI 5 **Tools** menu with **Manage device drivers**.

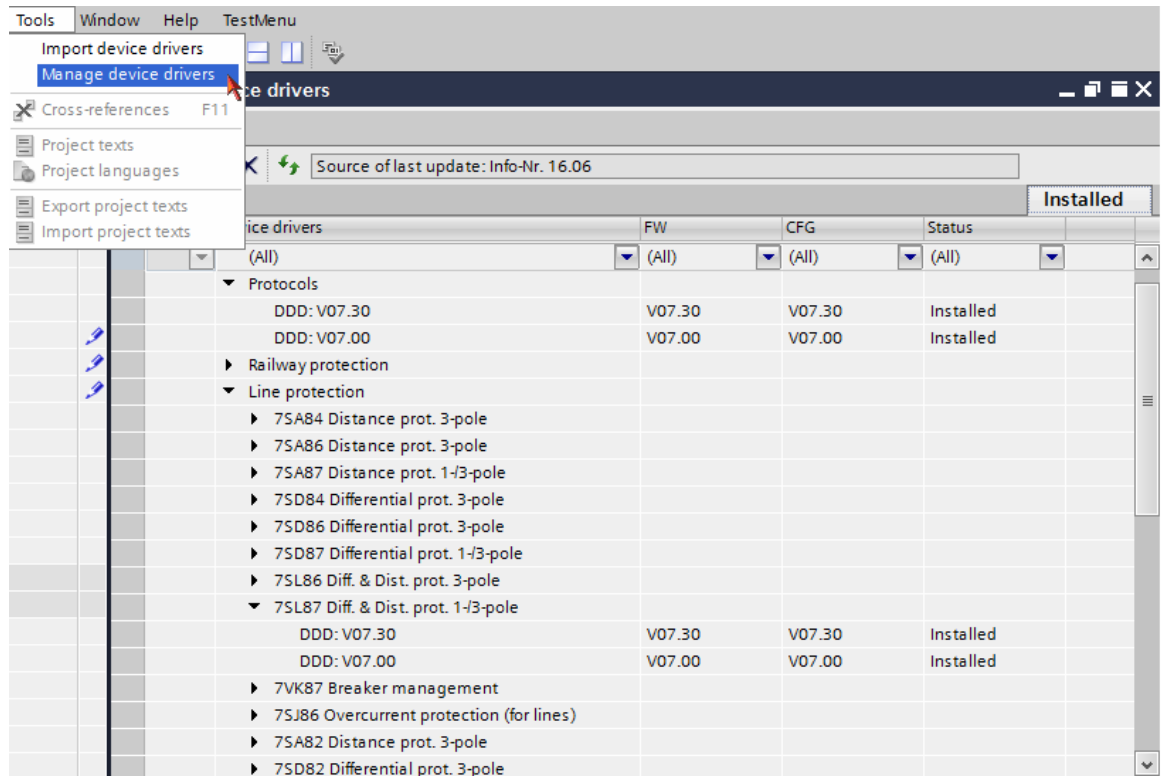

[scgetrvw-250716-01, 1, en_US]

Figure 10-8 Manage Device Drivers

Concluding Firmware Update



NOTE

Before doing a firmware update of your SIPROTEC 5 device or the communication modules, back up the data and the configuration of the device using DIGSI 5 via **Connect device and retrieve data!**




NOTE

The device will not carry out any functions during the update.

The update can take several minutes and the device can reboot several times. Do not shut off the device under any conditions during the update.

Proceed as follows to complete the firmware update:

- Click the device in the project tree.
- Open the context menu.
- Select the menu item **Load firmware to device.**

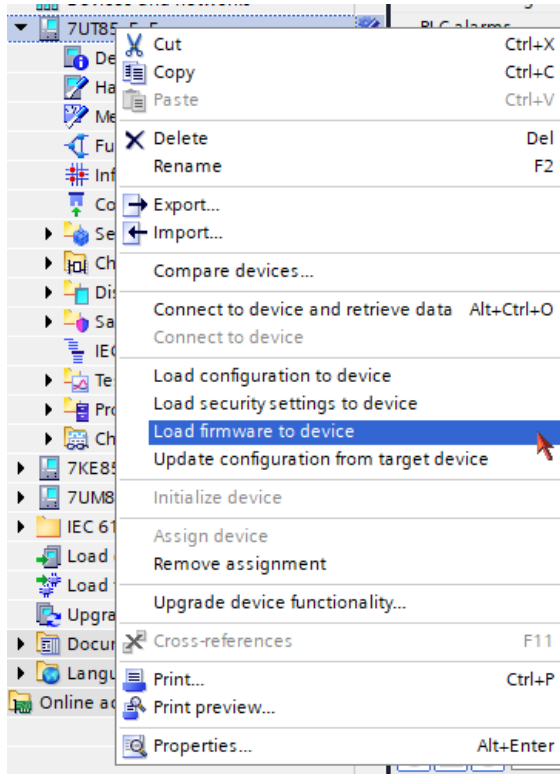


[scausfiw-011116-01, 2, en_US]

Figure 10-9 Context Menu for Firmware Update

As an alternative, you can update the firmware for all the devices on the network at the same time.

- To do this, double-click in the project tree the menu item **Load firmware to devices**.

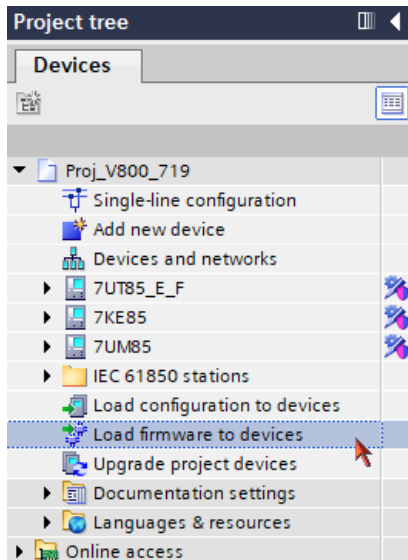

[scmlaus-260716-01, 2, en_US]

Figure 10-10 Menu Item in the Project Tree

The following dialog allows you to select the devices to be updated and their firmware components.

WebUI0506 ▶ Load firmware to devices


Update device(s) Refresh CSY

Device	Confirmation ID	Connection password	RBAC user name	RBAC password	Current version	Scheduled version	Result	Result details
7UT85_A	*****		admin	*****			Succeeded	
Firmware					V07.80	V07.80		
F:ETH-BA-2EL								
Firmware					V07.80	V07.80		
E:ETH-BA-2EL								
Firmware					V07.80	V07.80		
7UT85_S								

[scfwupsd-280716-01, 3, en_US]

Figure 10-11 Selecting Firmware Update

- Click the **Update** button to see the version differences.
- Enter the passwords based on the access protection in use.
- Select the device or the communication module that must be updated.
- Select the desired version in the **Scheduled version** column.
- Click the **Update device(s)** button.
- Confirm the subsequent dialog with **Yes** if you would like to continue with the firmware update.

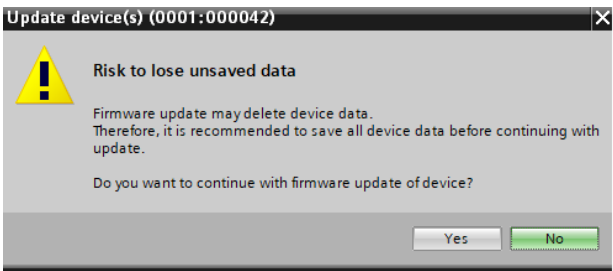

[sc_fw_req, 1, en_US]

Figure 10-12 Firmware-Update Prompt

The firmware update is performed.



[sc_transferfw, 1, en_US]

Figure 10-13 Firmware Transmissions

After the successful transmission of data to the device, the firmware update starts automatically on the SIPROTEC 5 device.



[schwdvlo-280716-01, 1, en_US]

Figure 10-14 Status of Firmware Update

After the firmware update of the device and the communication modules, all firmware components of the device have been updated.

You can find more information on this in [Structure of the HW/SW Information Menu Item, Page 239](#).

10.4.3 Special Features when Handling Protocols

The firmware for the communication modules consists of the basic firmware and all available protocols. The communication drivers depend on the device firmware and must be updated together with this firmware. When you set parameters for a protocol in DIGSI 5 and when you load the configuration into the device, the protocol firmware is loaded automatically in the device if necessary.

10.4.4 Upgrading Project Devices


To be able to use the extended functionality after a firmware update, you must perform an upgrade of the project devices. Proceed as follows:



NOTE

Before doing an update, back up the configuration of your SIPROTEC 5 device using DIGSI 5 via **Connect device and retrieve data!**

- Start DIGSI 5 on your PC.
- In the project tree, select **Upgrade project devices**.

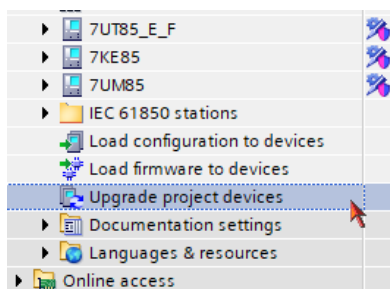

[scupgpar-041016-01, 3, en_US]

Figure 10-15 Menu Item in the Project Tree

- Select one or more devices.
- Mark the configuration or communication version that you wish to update.
- Select the desired version in the **Scheduled version** column.

Proj_V800_719 ▶ Upgrade project devices


Upgrade device(s)

Selection	Name	Current version	Scheduled version	Upgrade status	Log file
☐	▶ 7UT85_E_F				
☐	▶ 7KE85				
☐	▶ 7UM85				
☒	▼ 7UT85_V1				
☒	Configuration version	V07.90	V08.00		
☒	Communication version	V07.90	V08.00		

[scupgcnf-290716-01, 2, en_US]

Figure 10-16 Version Selection


- To start the update, click the **Update device(s)** button.
DIGSI 5 starts updating.

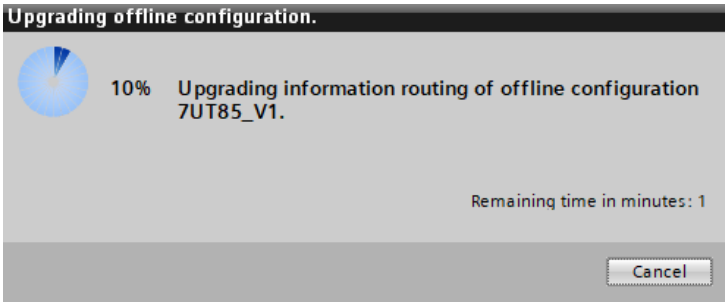

[scaktolf-290716-01, 2, en_US]

Figure 10-17 Upgrade Progress

Once the procedure has completed, the following dialog appears:

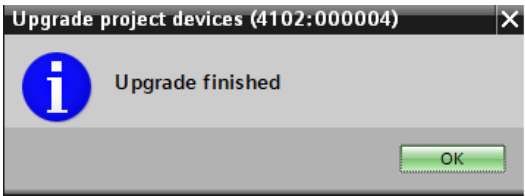

[sc_aktfin-081019, 1, en_US]

Figure 10-18 Upgrade Finished

The **Upgrade status** column shows the history of the upgrade.

Proj_V800_719 ▶ Upgrade project devices

Upgrade device(s)

Selection	Name	Current version	Scheduled version	Upgrade status	Log file
☐	▶ 7UT85_E_F				
☐	▶ 7KE85				
☐	▶ 7UM85				
☒	▼ 7UT85_V1				
☒	Configuration version	V08.00	Select	✓ Successfully upgraded device 7UT85_V1 from version V07.90/V7.90 to version V08.00/V08.00.	D:\UserData\
☒	Communication version	V08.00	Select		


[sc_aktstatus-081019, 1, en_US]

Figure 10-19 Versions and Update Status

Loading the Updated Configuration

Finally, you must load the updated configuration in the devices. There are 2 possibilities to do this.
To update multiple devices, proceed as follows:

- In the project tree, select the **Load configuration in devices** menu item.
- Select the devices that are to be updated.

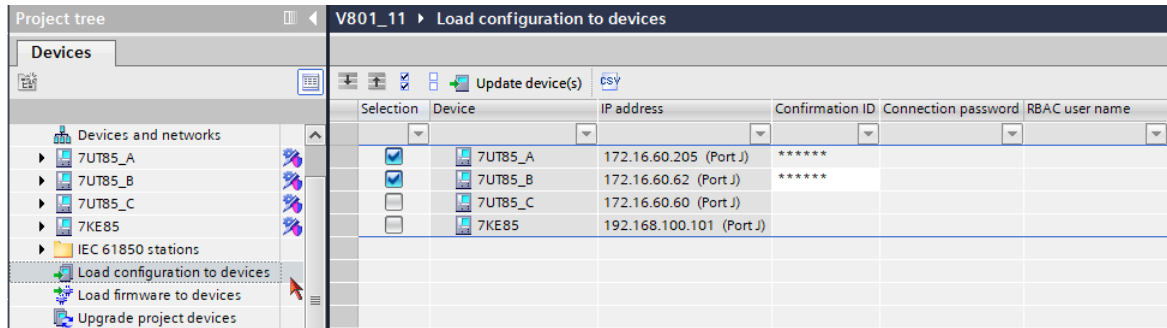

[sc_upgpa3-041119, 1, en_US]

Figure 10-20 Loading Configuration


- As needed, enter a confirmation ID or additional passwords in the columns provided.
- Click **Update device(s)**.

If the data has been successfully transferred, the devices restart.

- or -

To update a device, proceed as follows:

- Select the device in the project tree.
- Open the context menu.
- Select the **Load configuration to device** menu item.

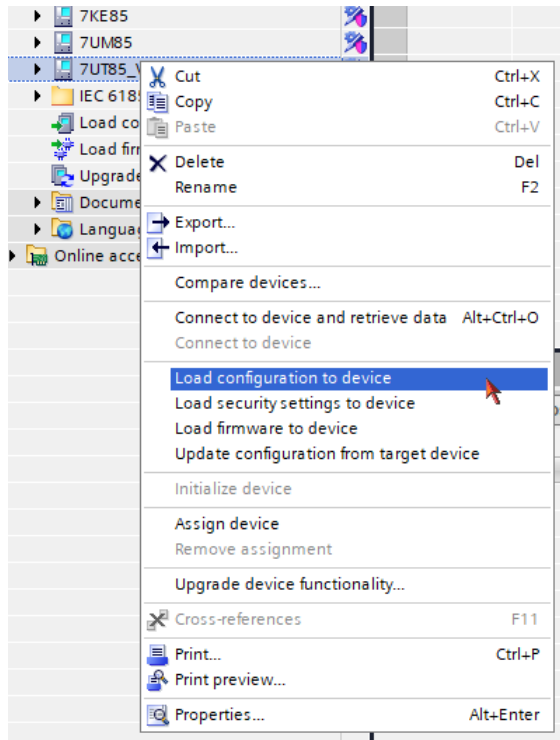

[sc_upgpa2-040718, 2, en_US]

Figure 10-21 Transmitting Configuration

Subsequently the dialog for the confirmation query appears.

- Enter the confirmation ID.
- Click **Ok** to confirm.

If the data was successfully transmitted, the device is restarted.

10.5 Test and Diagnostics

10.5.1 Establishing Test Mode

Safety Instructions



DANGER

Danger due to the execution of test functions

Noncompliance with safety instructions will result in death, serious injury, or significant material damage.

- ✧ The execution of test functions requires a high degree of qualification and precise know-how of system conditions.

Procedure

DIGSI 5 offers the possibility to start different test and diagnostic functions for a SIPROTEC 5 device in the **Online** operating mode. Chapter [9.2.1 Test Functions](#) contains a description of the test functions offered by the device together with DIGSI 5.

Activate the test functions using the menu bar and the different functions that you can reach via the list view of the device.

- ✧ Open the device in **Online** operating mode.
- ✧ Open **Test suite** in the project tree.

Project tree: Online access ▶ Realtek PCIe GBE Family Controller ▶ 7UT85_A (Assigned) ▶ Test suite ▶ Wiring (Commissioning)

Devices: 7UT85_A (Assigned)

Wiring test can be performed.

Activating process mode will restart the device. This may take up to 90 seconds.

Binary output cannot be tested. To test binary output set "Oper. bin.outp. under test" under "Device settings" as checked.

Change the state of binary inputs, outputs, and LEDs

Binary inputs/outputs and LMapped to signal(s)	Terminal	Current value	New value
Binary input 1.1	Circuit breaker 1:Circuit break.:Position	off	on
Binary input 1.2	Circuit breaker 1:Circuit break.:Position	off	on
Binary input 1.3	Circuit breaker 1:Circuit break.:Ready	on	off
Binary input 1.4		off	on
Binary input 2.1	Circuit breaker 2:Circuit break.:Position	off	on
Binary input 2.2	Circuit breaker 2:Circuit break.:Position	off	on
Binary input 2.3	Circuit breaker 2:Circuit break.:Ready	on	off
Binary input 3.1		off	on
Binary input 3.2		off	on
Binary input 3.3		off	on
Binary input 3.4		off	on
Binary input 3.5		off	on
Binary input 3.6		off	on
Binary input 3.7		off	on
Binary input 3.8		off	on
Binary outputs			
LEDs			

[sc_tstsut-040718, 1, en_US]

Figure 10-22 Test Suite

All subordinate test options appear in the data window. Select the desired test editor and start the test. If configured, enter the confirmation ID. In some test functions the device switches to an operating mode that first requires a system start of the device. Confirm this with DIGSI 5. The selected test function is then available.

**NOTE**

Depending on the device layout, not all test functions are always available. The execution of test functions is protected by a confirmation ID.


10.5.2 Switching the Simulation Mode On and Off

Procedure

If the simulation mode is switched on, indications transmitted via communication interfaces are labeled with an additional test bit, provided this is supported by the protocol. With this test bit, you can determine whether an indication is generated in a test, and all or individual functions of the device are in simulation mode. In this way, the reactions necessary in process mode due to an indication can be suppressed in other devices that receive these indications.

- If you have activated a confirmation ID or access control, these are requested by DIGSI 5 before the start of simulation mode.
- You can activate the simulation mode via DIGSI 5. All functions go into the test mode.
- You can bring selected functions into the test state. DIGSI 5 offers test sequences for this purpose.

The test suite shows you all the protection functions in the device with the current states. The state of a function is tested systematically there, using a test sequence. An activated simulation mode is marked with a check mark in the menu item.

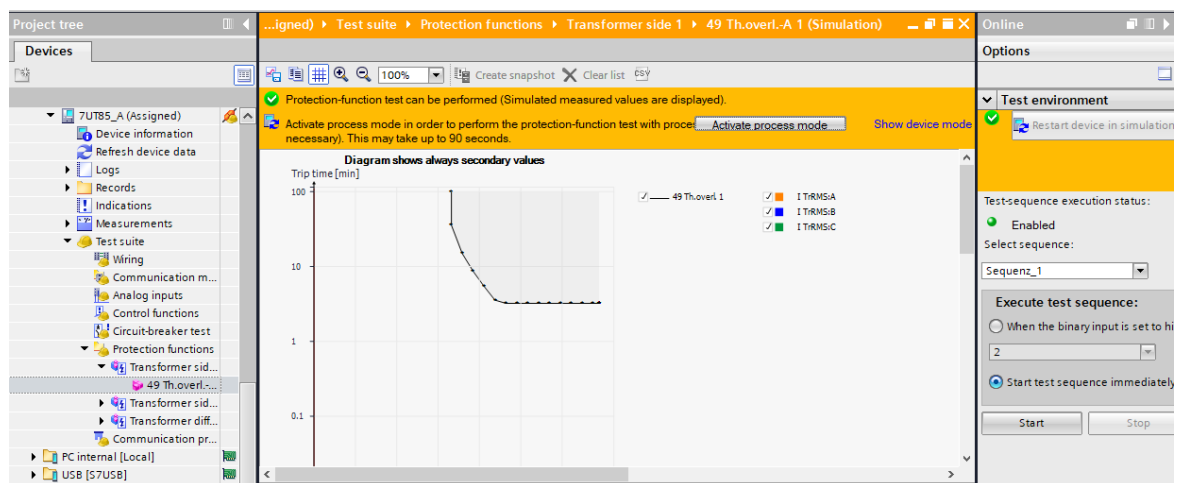

[sc_setsfk-040718, 1, en_US]


Figure 10-23 Simulation Mode

10.5.3 Switching Block Monitoring Direction On and Off

Procedure

If block monitoring direction is switched on, no indications are output via the system interface(s) of a SIPROTEC 5 device. Block monitoring direction can be switched on or off depending on the current state.


- Select block monitoring direction via the on-site operation panel.
- Enter the confirmation ID so that block monitoring direction can be activated.

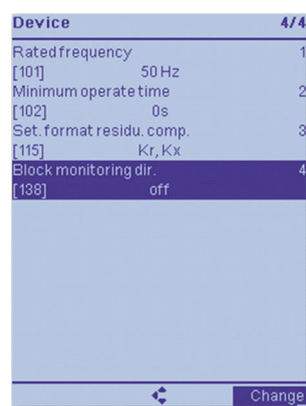

[scblkdir-080413-01.tif, 1, en_US]

Figure 10-24 Block Monitoring Direction at the Device

- Activate block monitoring direction via a binary input.
- Activate block monitoring direction via DIGSI 5.

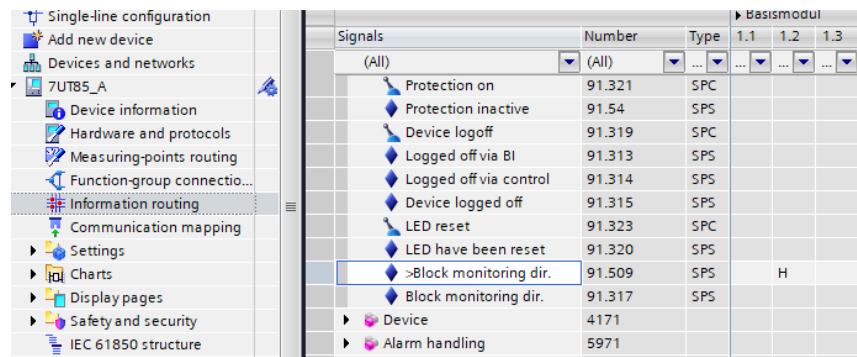

[scmemspr-081015, 2, en_US]

Figure 10-25 Block Monitoring Direction via DIGSI 5

When switching block monitoring direction on or off, an indication is output in the left area of the status bar. Bar segments inform you as well about progress of the procedure.



NOTE

The settings via the on-site operation, like the binary inputs, have no effect for the DNP3 protocol.
The *>Block monitoring dir.* signal is supported by the IEC 60870-5-103 protocol only.

11 Security Settings in the Device

11.1	Security Design	260
11.2	Multi-Level Security Concept	261


11.1 Security Design

Due to the increasing integration of bay units in Ethernet-based communication network, you must secure the communication against internal failures and attacks from outside. The specifications published by the North American Electric Reliability Council for critical infrastructure protection - NERC-CIP, for short - and the white paper published by the German Association of Energy and Water Management (BDEW) contain requirements for the safe operation of devices in critical communications infrastructure. These requirements are addressed to manufacturers and operators.

Security must be incorporated into the design of devices right from the start. This is implemented consistently in SIPROTEC 5. Measures in the hardware ensure the secure use of signed files. These are provided to protect the firmware files and data records of the device. Secure storage of key material on the device makes secure communication between DIGSI 5 and the device possible. The following items give you a high level of security when integrating the SIPROTEC 5 device in the network:

- Protection against attacks from the network
- Multi-stage safety concept in the operating state
- Logging of authorized and unauthorized access
- Logging of safety-critical actions

You can switch off unused Ethernet services. If, for example, the RSTP redundancy log is not being used, you can switch it off using DIGSI 5. This gives a potential attacker no open interfaces and only utilized services are activated in a network.

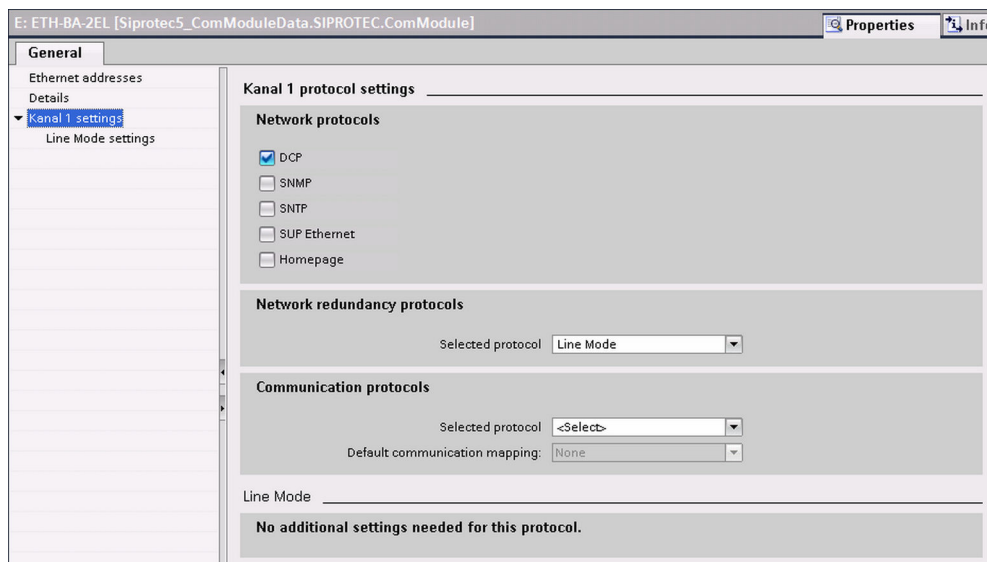

[sc_protocol settings, 2, en_US]

Figure 11-1 Switching off Unused Ethernet Protocols Using DIGSI 5

11.2 Multi-Level Security Concept

DIGSI 5 offers many useful functions for the configuration and testing of your SIPROTEC 5 devices. Constant password prompts are not sensible during this phase. During operation, however, the focus is on the reading of data. Reconfiguration and switching are safety-critical operations. These operations lead to failures in operation if they are carried out inadvertently or without authorization. After completion of commissioning, you can activate a multi-level security concept in the device.

Before DIGSI 5 can communicate with the SIPROTEC 5 device via its Ethernet services, the device carries out secure authentication. Only DIGSI 5 has the authorization for communication with the device. In addition, a connection password that meets the strict rules of NERC-CIP can be configured. The password is securely stored in the device. The password must contain upper-case and lower-case letters, digits, and special characters and must be at least 8 to 24 characters long. It is queried before connection is established. A connection to the SIPROTEC 5 device cannot be established until the correct password has been entered. You now have read access.

All write-access rights to the SIPROTEC 5 device such as, for example, changing setting values or switching are protected by other security prompts, the confirmation IDs. If changes are done via the integrated operation, these confirmation IDs are queried on the on-site operation panel. The confirmation ID contains only numbers that you must enter at the on-site operation panel or in DIGSI 5.



NOTE

The confirmation IDs are only needed if the role-based access control (RBAC) is not activated in the SIPROTEC 5 device.

The 3-level security concept consists of secure authentication, the connection password, and other confirmation IDs. This concept provides the highest possible degree of access protection during operation. Even remote access to devices is protected. You can also use an Ethernet module exclusively for the communication with DIGSI 5. Access by a substation control network with the unsecured IEC 61850 protocol and remote access with DIGSI 5 are then carried out via completely separate networks. Even though the SIPROTEC 5 device communicates with DIGSI 5 via an Ethernet module, communication between DIGSI 5 and the device is encrypted using tap-proof technology.

Wrong password entries are identified and logged. An alarm can be triggered via a telecontrol connection. Safety-critical operations are also logged and cannot be deleted in the device. If files on the PC were manipulated by malware (for example, viruses), they cannot be loaded into the device.



NOTE

You can find more information about the security settings of the device in the Security Manual (C53000-H5000-C081).

Literature

- /1/ Distance Protection, Line Differential Protection, and Overcurrent Protection for 3-Pole Tripping – 7SA82, 7SD82, 7SL82, 7SA84, 7SD84, 7SA86, 7SD86, 7SL86, 7SJ86
C53000-G5040-C010
- /2/ Distance and Line Differential Protection, Breaker Management for 1-Pole and 3-Pole Tripping – 7SA87, 7SD87, 7SL87, 7VK87
C53000-G5040-C011
- /3/ Overcurrent Protection – 7SJ82/7SJ85
C53000-G5040-C017
- /4/ Overcurrent Protection – 7SJ81
C53000-G5040-C079
- /5/ Motor Protection – 7SK82/85
C53000-G5040-C024
- /6/ Transformer Differential Protection – 7UT82, 7UT85, 7UT86, 7UT87
C53000-G5040-C016
- /7/ Generator Protection – 7UM85
C53000-G5040-C027
- /8/ Busbar Protection – 7SS85
C53000-G5040-C019
- /9/ High-Voltage Bay Controller – 6MD85/86
C53000-G5040-C015
- /10/ Paralleling Device – 7VE85
C53000-G5040-C071
- /11/ Universal Protection – 7SX85
C53000-G5040-C607
- /12/ Merging Unit 6MU85
C53000-G5040-C074
- /13/ Fault Recorder – 7KE85
C53000-G5040-C018
- /14/ Hardware Description
C53000-G5040-C002
- /15/ Communication Protocols
C53000-L1840-C055
- /16/ Process Bus
C53000-H3040-C054
- /17/ DIGSI 5 – Software Description
C53000-D5040-C001
- /18/ SIPROTEC 5 – Security
C53000-H5040-C081

- /19/ PIXIT, PICS, TICS IEC 61850
C53000-G5040-C013
- /20/ Operation
C53000-G5040-C003
- /21/ Engineering Guide
C53000-G5040-C004

Glossary

Chatter blocking

A rapidly intermittent input (for example, owing to a relay contact fault) is disconnected after a parameterizable monitoring time and therefore cannot generate any more signal changes. The function prevents the system from overloading in the event of an error.

Continuous Function Chart

The Continuous Function Chart (CFC) is a programming language. It is used for programmable logic controllers. The programming language Continuous Function Chart is not defined in the standard IEC 61131-3, but represents a current extension of IEC programming environments. CFC is a graphic programming language. Function blocks are linked to one another. This represents an essential difference from conventional programming languages, where sequences of commands are entered.

Control display

The control display becomes visible for devices with a large display after pressing the Control key. The diagram contains the switching devices to be controlled in the feeder. The control display serves for implementing switching operations. Specification of this diagram forms part of configuring.

Data window

The right area of the project window visualizes the content of the area selected in the navigation window. The data window contains for example, indications or measured values of the information lists or the function selection for parameterization of the device.

DIGSI

Configuration software for SIPROTEC

Double command

Double commands (DPC – **Double Point Control**) are process outputs which visualize 4 process states at 2 outputs: 2 defined states (for example, On/Off) and 2 undefined states (for example, disturbed positions).

DPC

IEC 61850 data type: **Double Point Control**

Drag and drop

Copying, moving, and linking function, used in graphic user interfaces. The mouse is used to highlight and hold objects and then move them from one data area to another.

Folder

This object type helps when structuring a project hierarchically.

Function group

Functions are brought together into function groups (FG). The assignment of functions to current and/or voltage transformers (assignment of functions to measuring points), the information exchange between the

function groups via interfaces as well as the generation of group indications are important for this bringing together.

General Interrogation

The state of all process inputs, of the status, and of the error image are scanned on system startup. This information is used to update the system-side process image. Likewise, the current process state can be interrogated after data loss with a general interrogation (GI).

Generic Object-Oriented Substation Event

GOOSE. Protocol of IEC 61850 for communication between bay units.

GOOSE

Generic Object-Oriented Substation Event

Ground

The conductive ground whose electric potential can be set equal to 0 at every point. In the area of grounding conductors, the ground can have a potential diverging from 0. The term **reference ground** is also used for this situation.

Grounding

The grounding is the entirety of all means and measuring for grounding.

IEC

International Electrotechnical Commission - International electrotechnical standardization body

IP

Internet Protocol

List view

The right area of the project window displays the names and symbols of the objects which are within a container selected in the tree view. As the visualization is in the form of a list, this area is also referred to as list view.

Metered value

Metered values are a processing function, used to determine the total number of discrete similar events (counting pulses), for example, as integral over a time span. In the power supply utility field, electrical energy is often recorded as a metered value (energy import/delivery, energy transport).

Navigation window

Left area of the project window, which visualizes the names and symbols of all containers of a project in the form of a hierarchical tree structure.

Offline

If there is no communication connection between a PC program (for example, configuration program) and a runtime application (for example, a PC application), the PC program is **offline**. The PC program executes in Offline mode.

Online

If there is a communication connection between a PC program (for example, configuration program) and a runtime application (for example, a PC application), the PC program is **online**. The PC program executes in Online mode.

Parameterization

Comprehensive term for all setting work on the device. You can set parameters for the protection functions with DIGSI 5 or sometimes also directly on the device.

Parameter set

The parameter set is the entirety of all parameters that can be set for a SIPROTEC device.

PB Client

Process-bus Client. The subscriber of Sampled Measured Values can also be called process-bus client.

PLC

Programmable Logic Controller

Project

In terms of content, a project is the replication of a real energy supply system. In graphic terms, a project is represented as a number of objects which are incorporated in a hierarchical structure. Physically, a project consists of a series of directories and files containing project data.

RSTP

Rapid Spanning Tree Protocol

SCD

Substation Configuration Description

Single command

Single commands (SPC – Single Point Control) are process outputs which visualize 2 process states (for example, On/Off) at an output.

SIPROTEC

The registered trademark SIPROTEC designates the product family of protection devices and fault recorders.

SIPROTEC 5 device

This object type represents a real SIPROTEC device with all the contained setting values and process data.

SPC

IEC 61850 data type: Single Point Control

SPS

IEC 61850 data type: Single Point Status

TCP

Transmission Control Protocol

Time stamp

A time stamp is a value in a defined format. The time stamp assigns a time point to an event, for example, in a log file. Time stamps ensure that events can be found again.

UTC

Universal Time Coordinated

Index

A

- Acknowledgment
 - Spontaneous fault display 153
 - Stored indication 155
- Acquisition blocking 206
- Activating the battery 22
- Adding a device to a project 142
- As-delivered condition 90
- Assembly dimensions
 - Flush-mounting device 38
 - Surface-mounted devices variant of non-modular devices 57
 - Surface-mounted devices with detached on-site operation panel 61
 - Surface-mounted devices with integrated on-site operation panel 50
- Authorizations with confirmation ID 209

B

- Backup module 246
- Battery disposal 19
- Battery fault 234
- Browser-based user interface 108
- Button
 - Alarms 126
 - Binary inputs 124
 - Binary outputs 124
 - Certificates 128
 - Date & time 117
 - Device 115
 - DiagLogs 127
 - Display pages 117
 - Fault recorder 125
 - Functional measured values 122
 - Inactive functions 127
 - Indications 118
 - LEDs 125
 - Operational measured values 121
 - Runtime data 119
 - Settings 116
 - Statistics 123
 - Support 131

C

- Change Units System 193
- Changing confirmation IDs 195
- Changing data online 105
- Check measured values 231
- Checking interfaces 227
- Checking the Rated Data 21
- Circuit-breaker test 219
- Commissioning mode 90
- Communication log 170
- Communication with control center 227
- Communication-supervision log 171
- Confirmation ID 112
- Connecting a device 22
- Connecting a Device 48
- Control device functions 138
- Control with
 - graphic display 204
 - Small display 205
- Control with Function Keys 210
- Correction of errors 237

D

- Data transfer 103
- Date and Time 189
- Device diagnosis 219
- Device identification via project tree 141
- Device information 239
- Device mode 90
- Device replacement 246
- Device-diagnosis log 168
- Diagnosis information 219
- DIGSI 5 operating software 98
- Display elements 75
 - Base module 75
 - Expansion module 75, 81
- Displays 83
- Drilling pattern
 - Flush-mounting device 38
 - Surface-mounted devices variant of non-modular devices 57
 - Surface-mounted devices with detached on-site operation panel 61

Surface-mounted devices with integrated on-site operation panel 50

E

Electrical inspection 22
Energy Values
 setting 179
Energy vValues
 resetting 179
Error indications 241
Establishing a connection to devices 141
Establishing a connection via
 Ethernet 103
 USB 103

F

Fallback Mode 237
Fault definition 183
Fault display
 Configuration 152
 Spontaneous 152
Fault log 161
Fault recording 183
Fault records
 Displaying 184
 recording 186
 retrieving 106
Fault Records
 deleting 186
 reading 183
 saving and exporting 185
Fault-record channels
 Configuration 186
 Start criterion 187
Firmware update 247
Flush-mounting device
 Expanding 26
 Fitting 46
Function settings 196

G

GOOSE communication 227
Ground-fault log 162
Grounding a Device 48

H

Hardware/software information 239

I

Importing, managing device drivers 247
Incoming inspection 21
Indication display
 Spontaneous 152
Indications 146
 Displays 149
 Read out 146
 Reading 146
 Reading with DIGSI 148
Initial Startup 212
Initializing a device 102
IP configuration 239

L

Language Selection 193
Lockout 155
Log 158
 Configuring 158
 Deleting 174
 Logs 174
 Management 158

M

Maintenance 234
Manual updating 206
Measured values 176
Menu dialogs 88
Menu structure 85
Menu Tree 86
Metered Values 176
Min./Max./Mean Average
 resetting 181
Motor-starting log 172

N

Notification windows 88

O

Offline area 100, 100
Offline operation 143
On-site operation panel 74
 Installing 65
Online area 100
Online mode 100
Online operation 140

Operating Concept 74
 Operational log 159
 Operator elements 75
 Base module 75
 Expansion module 75, 81

P

Packing 18
 Plug-in modules
 Fasteners 68
 Install 68
 Removing 69
 Plug-In Modules
 Replacement 71
 Primary tests 230
 Project navigation 98
 Protection communication 227
 Protection-function test 234

Q

Quality attributes 150

R

Readiness for operation state
 establishing 222
 Repeat test 234
 Returning 18
 Returning a device 246
 Routing 92

S

Secondary Tests 225
 Security 109
 Security concept 261
 Security design 260
 Security log 167
 Setting a Marker 209
 Setting the Contrast 193
 Setting-history log 164
 Signed file 236
 Simulation mode 90
 Simulation Mode 215
 Spontaneous fault displays 183
 Statistical values
 resetting 181
 Statistical Values
 setting 181

Stored indications 154
 Storing 18
 Surface-mounted device with detached on-site operation panel
 Expanding 33
 Fitting 64
 Surface-mounted device with integrated on-site operation panel
 Expanding 29, 30
 Surface-mounting device with integrated on-site operation panel
 Fitting 58
 System Control 202

T

Terminal screw
 tightening torque 48, 60, 66
 Test Suite 213
 Testing
 Current and voltage inputs 214
 protection functions 215
 switching devices 217
 Testing of functions 225
 Testing readiness for
 Operation 224
 Testing system integration 228
 Timeout 111
 Troubleshooting 236

U

Unpacking 18
 Upgrade project devices 252
 Upgrading Project Devices 252
 User Interface 113
 User log 166
 User-Defined Metered Values
 resetting 180
 setting 180
 Using project 222

V

Verifying basic status 223

